



TAL-CO SUPPLEMENTAL INSTRUCTION #02			
Project Name:	RW TOMLINSON - NEW HEAD OFFICE		
Project Location:	100 Nortel Drive, Ottawa, Ontario		
ARCH. SI #:	A-111 (9,2,2016)	Issued By:	Chris Simpson
STRUC. SI #:	SSI #2	Date Issued:	September 23, 2016
MECH. SI #:	Sump Pit Section	Revision #:	N/A
ELEC. SI #:	N/A	Revision Date:	N/A

Supplemental Instructions are issued by the Construction Manager to record a clarification or revision to the previously issued Contact Documentation as reflected by the attached information prepared by the identified Professionals.

The Construction Manager shall review the Supplemental Instruction and the attached information and issue to the affected Trade Contractors identifying the following course of action by the Trade Contractor.

Notify Tal-Co within 5 days of receipt, if the attached documents will require a change to Contract Price or Schedule.

Title: Revision to sump pit depth

Reference: Architectural, Structural, Mechanical Drawings

Attachments: SSI #2, A-111 (Plot Date 9,2,2016), Optimum Mechanical Sump Pit Section

Description of the Work: Position sump pit as per revised architectural slab edge drawing, additional reinforcing required to recess pit into footing pad.

Reason: To achieve a functional depth of sump pit relative to elevator pit.

STRUCTURAL SITE INSTRUCTION



Cleland Jardine Engineering Ltd., 580 Terry Fox Drive, Suite 200, Kanata, Ontario, K2L 4B9, FAX (613) 591-1703, Tel. (613) 591-1533

TO: TALCO Building Innovations DATE: August 30, 2016

ATTENTION: Chris Simpson EMAIL: csimpson@tal-co.com

PROJECT: Tomlinson – New Building PROJECT No.: 15-0179

ISSUED BY: Brian Johnson, P. Eng. BDS PAGES (Incl this one): 2

STRUCTURAL SITE INSTRUCTION No.: 002


Affected Drawings: S100R1

References: Contractor's clarification of Sump Pit Depth

Information to be Clarified: Reinforcing Steel in Footing around Sump Pit

Provide the reinforcing modifications as noted on the partial plan in SSI-S2-SK1.

SSI-SQ-SK1

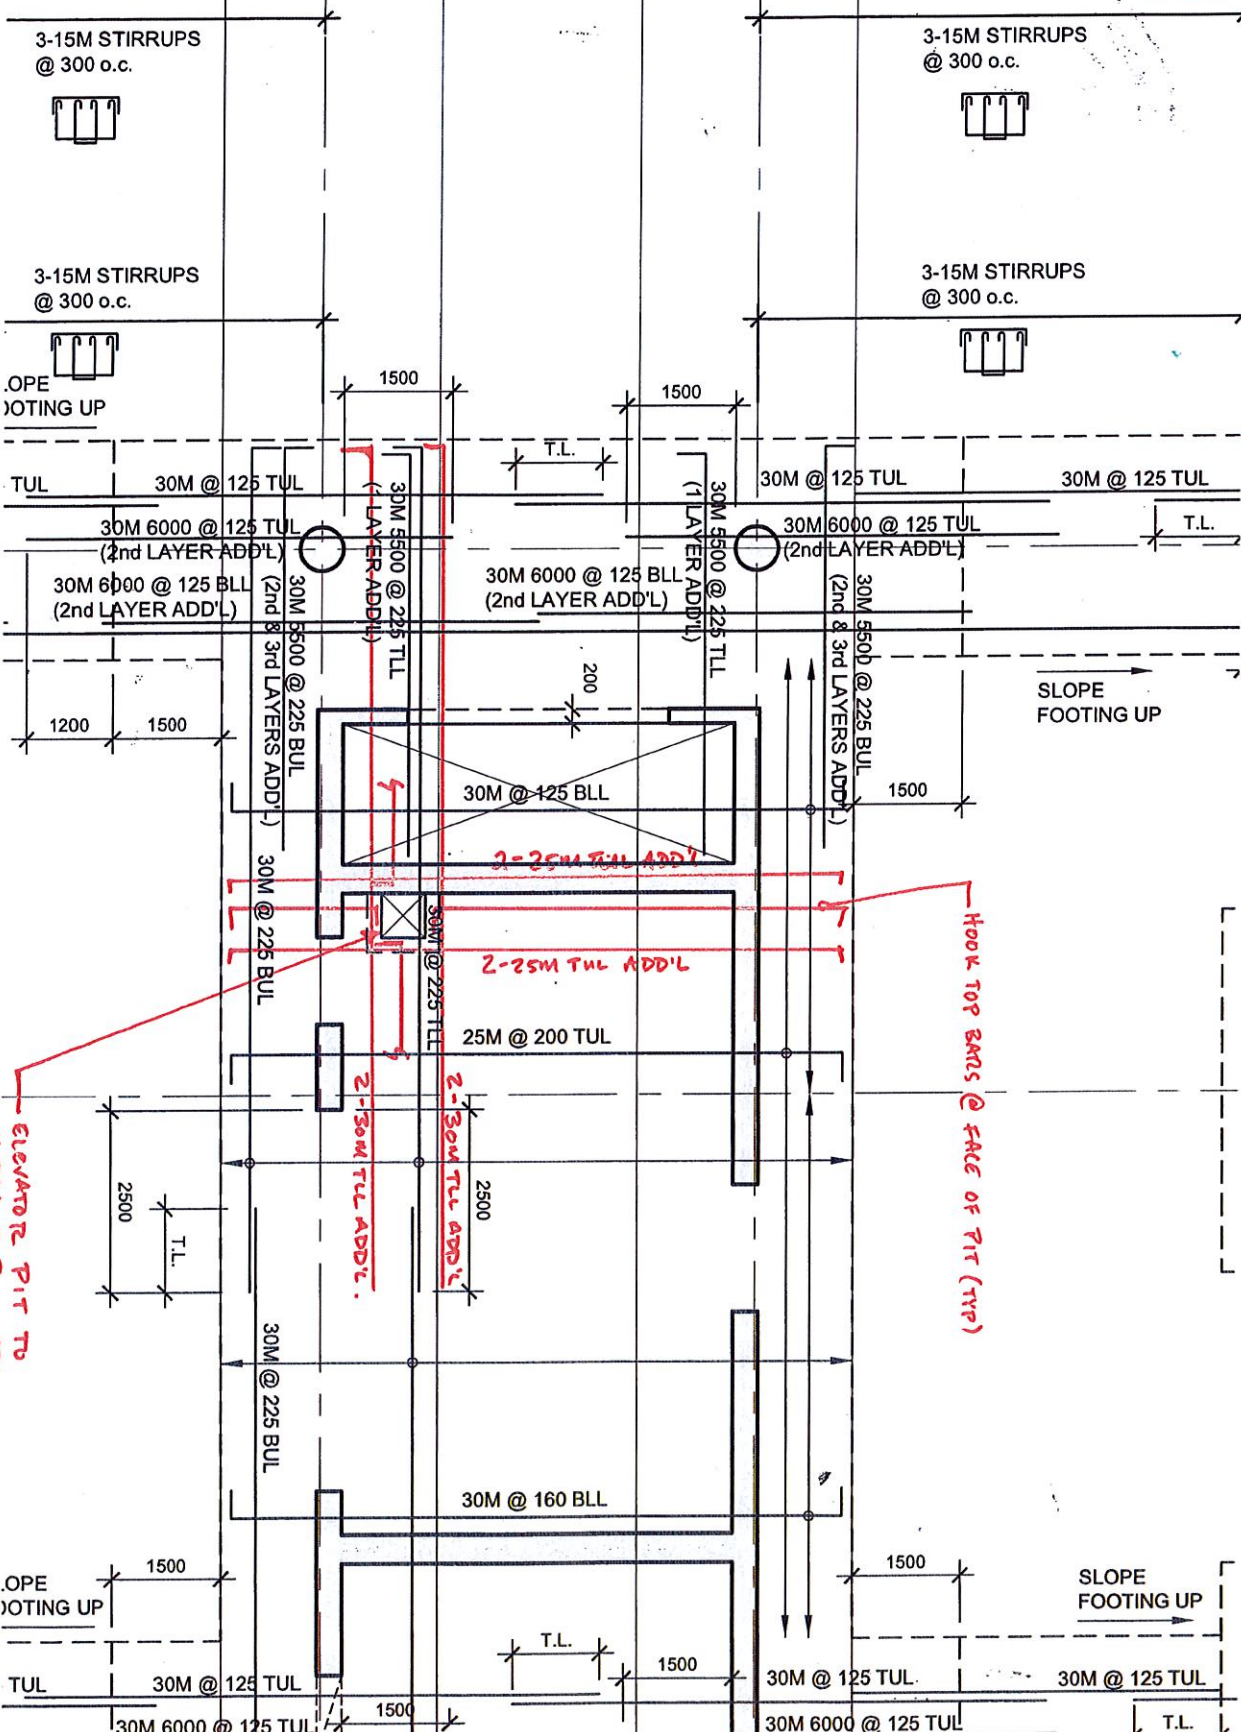


ELEVATOR PIT TO NOTCH TOP OF FIT BY 1 DOWN

HOOK TOP BARS @ FACE OF PIT (TYP)

2-25M TUL ADD'L

2-25M TUL ADD'L

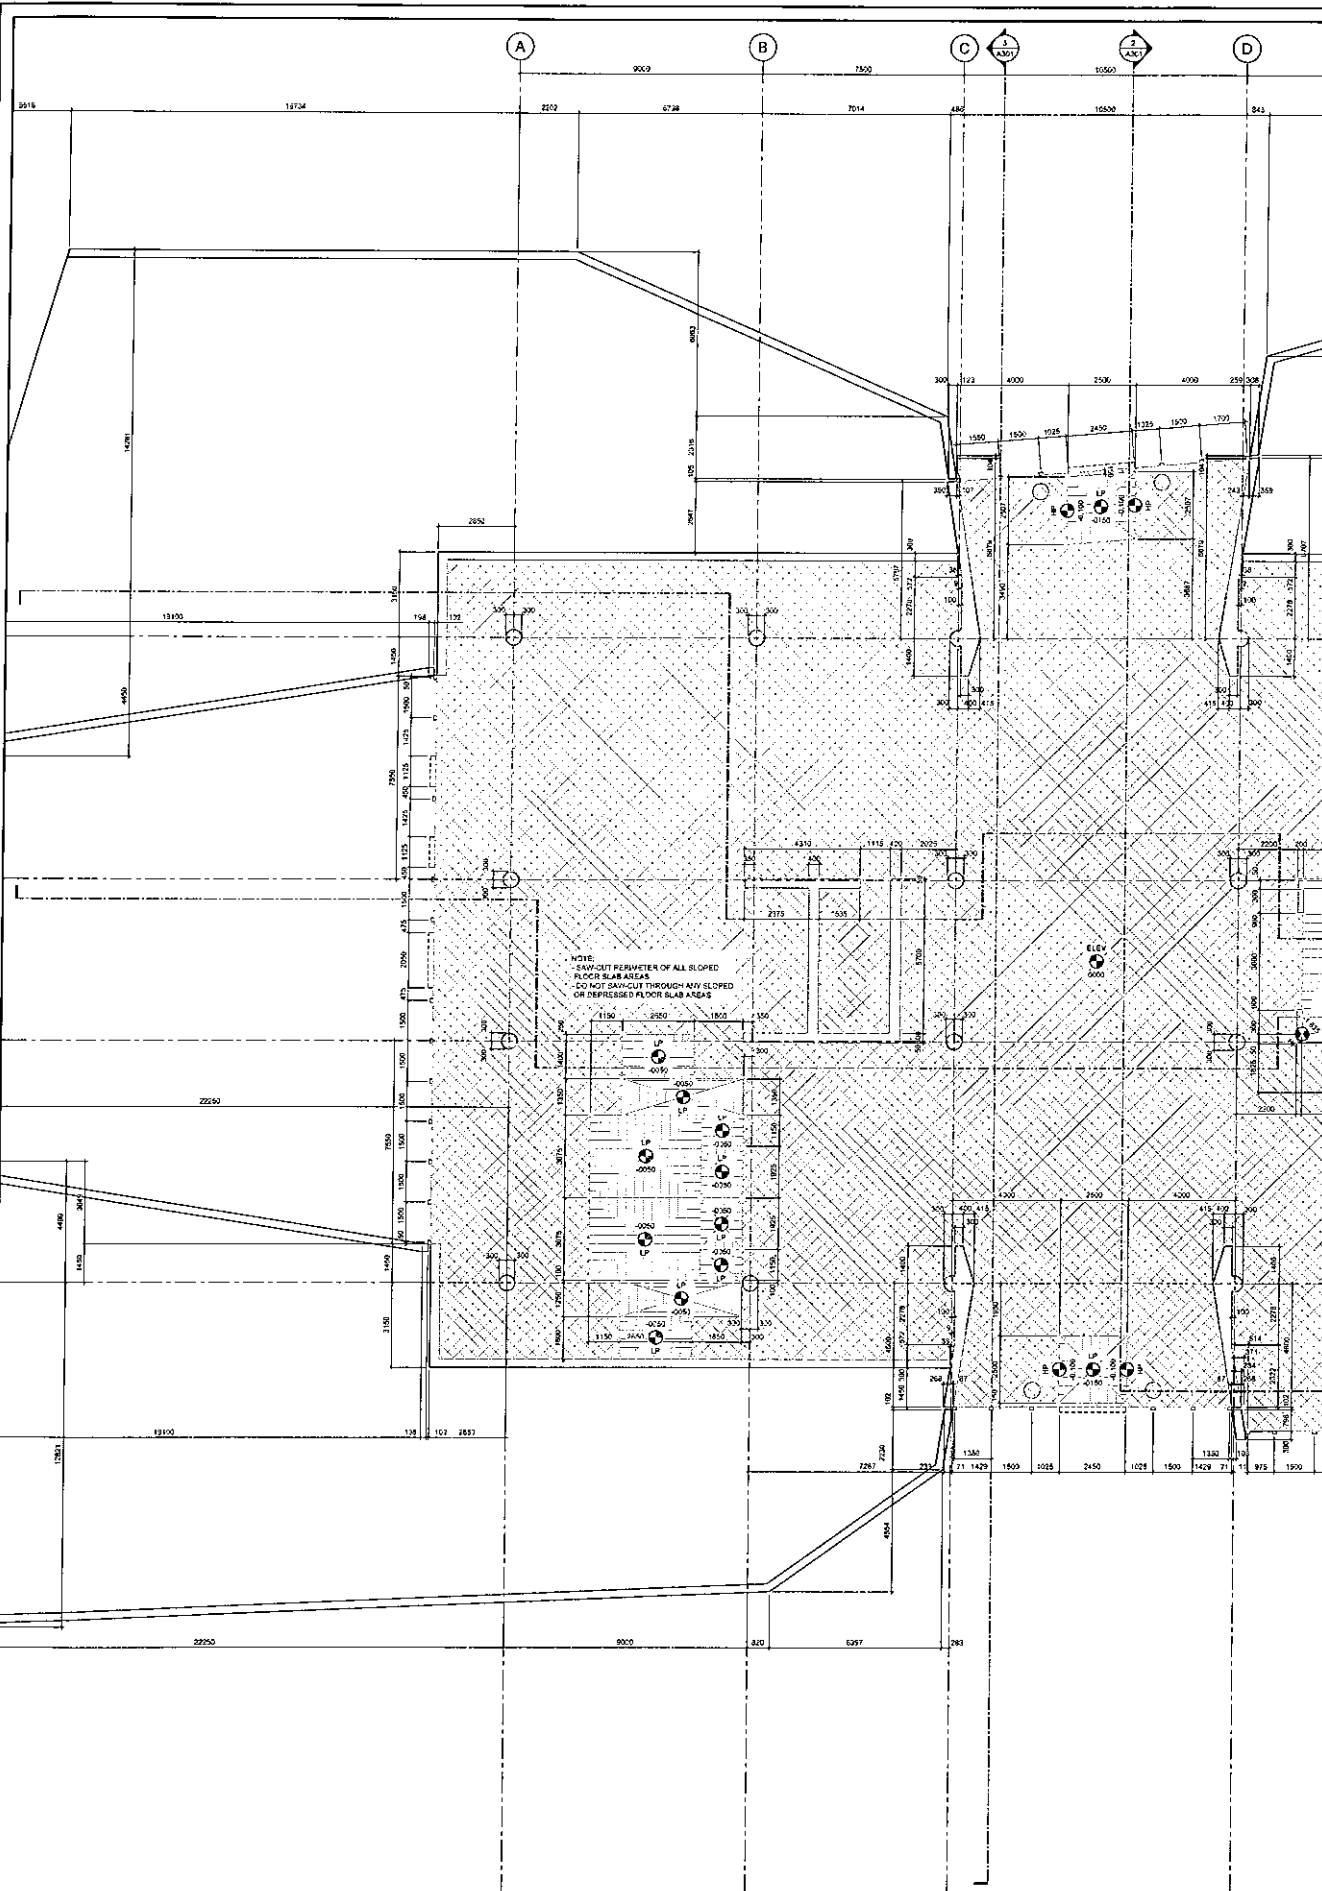

1 GROUND FLOOR SLAB EDGE PLAN
 A111 SCALE #1/32

ELEVATOR SUMP PIT DEPTH

