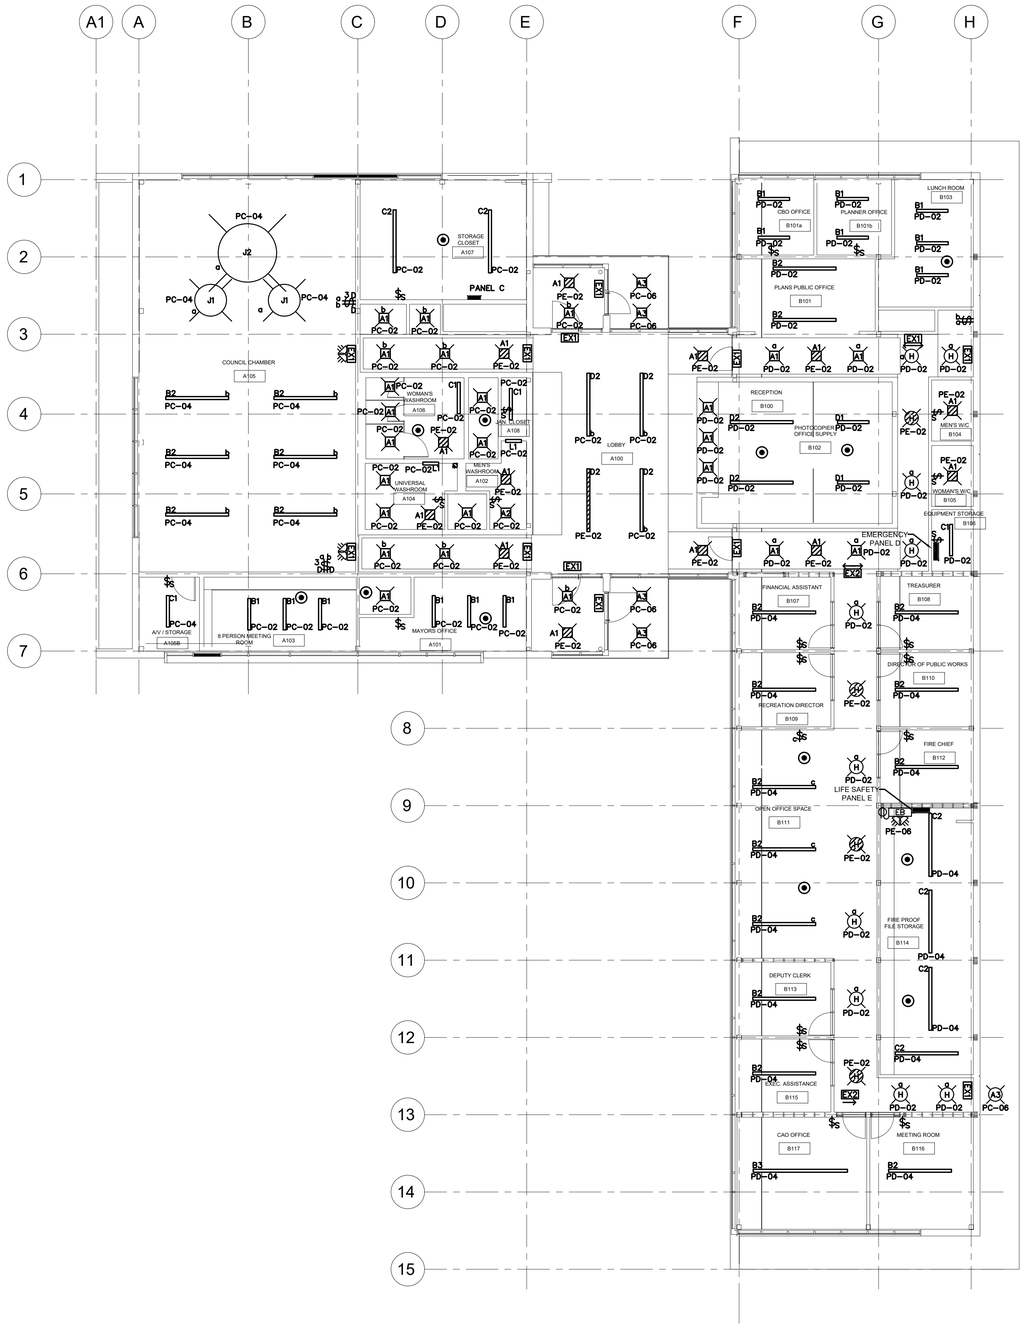

NEW NOTES

1. PROVIDE NEW LIGHTING AND CONTROLS AS INDICATED. CONNECT TO NEW LIGHTING PANEL.
2. ALL CONDUIT AND WIRING SHALL BE CONCEALED. ROUTE THROUGH EXPOSED STRUCTURE, ALONG BEAMS AND PERLINS WITHIN BULKHEADS OR DROP CEILING. EMT SHALL BE USED IN EXPOSED CEILING AREAS. REFER TO ARCHITECTURAL CEILING PLANS AND DETAILS.

IT IS THE RESPONSIBILITY OF THE APPROPRIATE CONTRACTOR TO CHECK AND VERIFY ALL DIMENSIONS ON SITE AND TO REPORT ALL ERRORS AND/OR OMISSIONS TO THE ARCHITECT.

ALL CONTRACTORS MUST COMPLY WITH ALL PERTINENT CODES AND BY-LAWS.

THIS DRAWING MAY NOT BE USED FOR CONSTRUCTION UNTIL SIGNED BY THE ARCHITECT.

DO NOT SCALE DRAWINGS
COPYRIGHT RESERVED

ENGINEERING FORWARD
Vanderwesten & Rutherford Associates Inc.
Mechanical & Electrical Engineers
London . Windsor . Ottawa
www.vreng.ca | 613-563-2100

VR 16-178

#	ISSUED FOR:	DD.MM.YY
6	ISSUED FOR TENDER	12.10.2017
5	ISSUED FOR PRE-TENDER REVIEW	25.08.2017
4	ISSUED FOR 95% REVIEW	18.08.2017
3	ISSUED FOR 90% REVIEW	09.08.2017
2	ISSUED FOR REVIEW	07.07.2017
1	ISSUED FOR 33% REVIEW	23.12.2016

REVISIONS:

ARCHITECT SEAL:

NORTH ARROW:

CLIENT:

ARCHITECT:

PROJECT TITLE:

MCNAB BRAESIDE

ARNPRIOR ONTARIO

SHEET TILE:

TOWN HALL - NEW LIGHTING PLAN

DRAWN:	CHECKED:
JOP	SB
SCALE: 1 : 100	SHEET No: E102
PROJECT No: 16-178	