

FLOOR TYPE LEGEND	
TYPE:	CONSTRUCTION:
F1	<p>SLAB ON GRADE:</p> <p>FLOOR TYPE F1:</p> <p>125MM CONCRETE SLAB VAPOUR BARRIER MEMBRANE TURNED UP AT SLAB EDGES RIGID INSULATION INSTALLED HORIZONTALLY BELOW THE CONCRETE SLAB FROM BUILDING TO MIN 1200mm INWARD 75MM GRANULAR FILL (REFER TO STRUCTURAL)</p>

ROOF TYPE LEGEND	
TYPE:	CONSTRUCTION:
R1	<p>ROOF TYPE R1:</p> <p>STANDING SEAM METAL ROOF ICE AND WATER SHIELD MEMBRANE 13MM PROTECTION BOARD 50MM RIGID INSULATION 100MM SHEATHING 19MM VAPOUR BARRIER MEMBRANE EXPOSED WOOD FRAME STRUCTURE GYP. BD. LAMINATED TO UNDERSIDE OF DECKING INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p>
R2	<p>ROOF TYPE R2:</p> <p>ROOFING MEMBRANE PROTECTION BOARD TAPERED RIGID INSULATION 50MM RIGID INSULATION 100MM SHEATHING 38MM VAPOUR BARRIER MEMBRANE METAL DECK STRUCTURAL JOIST (REFER TO STRUCTURE) 19MM STRAPPING GYP. BD. CEILING 13MM INT. FIN. - PAINT FINISH TO BE SELECTED BY ARCHITECT</p>

CEILING TYPE LEGEND	
TYPE:	CONSTRUCTION:
C1	<p>CEILING TYPE C1:</p> <p>92MM METAL SUSPENSION FRAMING SPACED AT 600 O/C 22MM FURRING CHANNEL RUNNING PERPENDICULAR TO METAL SUSPENSION FRAMING @ 600 O/C 16MM T&G WOOD PANELING</p>
C2	<p>CEILING TYPE C2:</p> <p>92MM METAL SUSPENSION FRAMING SPACED AT 600 O/C 22MM FURRING CHANNEL RUNNING PERPENDICULAR TO METAL SUSPENSION FRAMING @ 600 O/C GYP. BD. INT. FIN. INT. FIN. - PAINT FINISH TO BE SELECTED BY ARCHITECT</p>
C3	<p>50MM LIGHT WEIGHT CONCRETE TOPPING C/W CHEMICAL WATERPROOFING APPLICATION 150MM PRECAST CONCRETE CORE SLAB INT. FIN. INT. FIN. - PAINT FINISH TO BE SELECTED BY ARCHITECT</p>

WALL TYPE LEGEND	
TYPE:	CONSTRUCTION:
1	<p>EXTERIOR WALL:</p> <p>WALL TYPE 1:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>VAPOUR BARRIER MEMBRANE</p> <p>140MM WOOD STUD, CAVITY FILLED WITH MINERAL WOOL BATT INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>50MM RIGID INSULATION.</p> <p>AIR BARRIER MEMBRANE.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C</p> <p>13MM BD. FORM CONC. VENEER.</p>
2A	<p>EXTERIOR WALL:</p> <p>WALL TYPE 2A:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>VAPOUR BARRIER MEMBRANE</p> <p>140MM WOOD STUD, CAVITY FILLED WITH MINERAL WOOL BATT INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>50MM RIGID INSULATION.</p> <p>AIR BARRIER MEMBRANE.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C</p> <p>16MM METAL SIDING.</p>
2B	<p>EXTERIOR WALL:</p> <p>WALL TYPE 2B:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>VAPOUR BARRIER MEMBRANE</p> <p>140MM WOOD STUD, CAVITY FILLED WITH MINERAL WOOL BATT INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>50MM RIGID INSULATION.</p> <p>AIR BARRIER MEMBRANE.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C.</p> <p>16MM WOOD SIDING.</p>
2C	<p>EXTERIOR WALL:</p> <p>WALL TYPE 2C:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>VAPOUR BARRIER MEMBRANE</p> <p>140MM WOOD STUD, CAVITY FILLED WITH MINERAL WOOL BATT INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>50MM RIGID INSULATION.</p> <p>AIR BARRIER MEMBRANE.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C.</p> <p>22MM ACM PANEL.</p>
2D	<p>EXTERIOR WALL:</p> <p>WALL TYPE 2D:</p> <p>16MM WOOD SIDING.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C</p> <p>AIR BARRIER MEMBRANE.</p> <p>50MM RIGID INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>140MM WOOD STUD, CAVITY FILLED WITH MINERAL WOOL BATT INSULATION.</p> <p>16MM FIBERGLASS MAT GYPSUM SHEATHING.</p> <p>50MM RIGID INSULATION.</p> <p>AIR BARRIER MEMBRANE.</p> <p>25MM AIR SPACE + WD. STRAPPING. 400 O/C.</p> <p>16MM METAL SIDING.</p>
7	<p>FOUNDATION WALL:</p> <p>WALL TYPE 7:</p> <p>75mm RIGID INSULATION</p> <p>VARIABLE CONCRETE FOUNDATION WALL. REFER TO STRUCTURAL DRAWINGS.</p> <p>WATER PROOFING MEMBRANE</p>

GENERAL NOTES:

- FOR FIRE RATED WALLS REFER TO : ULC W301 (GA FILE No. WP3605) OR GA FILE No. WP3660 REFER TO DRAWINGS AO.2 FOR FIRE SEPARATING LOCATIONS
- USE MOISTURE RESISTANT GYPSUM BOARD IN ALL "WET" AREAS
- USE ABUSE RESISTANT GYPSUM BOARD IN CORRIDOR AND GENERAL USE.
- USE TYPE X GYPSUM BOARD GOT ALL FIRE RATED WALLS AND CEILINGS
- ALL INTERIOR GYPSUM BOARD EXTENDS TO U/S OF STRUCTURE UNLESS NOTES OTHERWISE


STUD SPACING TO BE @ 400 O/C UNLESS NOTED OTHERWISE. REFER TO STRUCTURAL DRAWINGS FOR ADDITIONAL STUD SPACING REQUIREMENTS.

WALL TYPE LEGEND	
TYPE:	CONSTRUCTION:
3A	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3A:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>140MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>WALL TYPE 3AS:</p> <p>ADD 13MM PLYWOOD SHEATHING TO BOTH SIDES OF STUD CAVITY</p>
3B	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3B:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>89MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>WALL TYPE 3BS:</p> <p>ADD 13MM PLYWOOD SHEATHING TO BOTH SIDES OF STUD CAVITY</p>
3C	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3C:</p> <p>89MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p>
3D	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3D:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>140MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>22MM FURRING CHANNEL</p> <p>16MM WOOD PANELING</p> <p>WALL TYPE 3DS:</p> <p>ADD 13MM PLYWOOD SHEATHING TO BOTH SIDES OF STUD CAVITY</p>
3E	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3E:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>89MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>22MM FURRING CHANNEL</p> <p>16MM WOOD PANELING</p> <p>WALL TYPE 3ES:</p> <p>ADD 13MM PLYWOOD SHEATHING TO BOTH SIDES OF STUD CAVITY</p>
3F	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 3F:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>140MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM PLYWOOD SHEATHING.</p> <p>41MM FURRING CHANNEL</p> <p>16MM GYPSUM</p> <p>RECESSED WOOD WALL</p> <p>16MM GYP. BD.</p> <p>140MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM PLYWOOD SHEATHING.</p> <p>16MM WOOD V GROVE SIDING</p>
4A	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 4A:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>280MM WOOD STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION. (LOCATED CORRIDOR/ROOM SIDE)</p> <p>GYP. BD.</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p>
5A	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 5A:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>13MM BOARD FORMED CONCRETE VENEER.</p> <p>16MM GYP. BD.</p> <p>127MM METAL STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>13MM BOARD FORMED CONCRETE VENEER. (COORDINATE W/ RM. FIN. SCH.S).</p>
5B	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 5B:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>13MM BOARD FORMED CONCRETE VENEER.</p> <p>16MM GYP. BD.</p> <p>57MM METAL STUD, CAVITY FILLED WITH SOUND ATTENUATION BATT INSULATION.</p> <p>16MM GYP. BD.</p> <p>13MM BOARD FORMED CONCRETE VENEER. (COORDINATE W/ RM. FIN. SCH.S).</p>
6A	<p>INTERIOR PARTITION:</p> <p>WALL TYPE 6A:</p> <p>140 SEMI SOLID CONCRETE BLOCK.</p> <p>WALL TYPE 6B:</p> <p>INT. FIN. (COORDINATE W/ RM. FIN. SCH.S).</p> <p>16MM GYP. BD.</p> <p>22MM FURRING CHANNEL</p> <p>140 SEMI SOLID CONCRETE BLOCK.</p>

Revision Schedule		
No.	Date	Particular
1	2017.10.11	ISSUE FOR BUILDING PERMIT & TENDER
2	2017.08.22	ISSUE FOR CLIENT REVIEW
3	2017.10.06	ISSUE FOR TENDER
4	2017.10.12	ISSUE FOR TENDER
5	2017.10.23	ISSUE FOR ADDENDUM #1
6	2017.10.23	ISSUE FOR ADDENDUM #2

All dimensions and measurements must be checked and verified by the General Contractor.

Reproduction of drawings and related documents in whole or in part is forbidden without written permission of The Ventin Group.

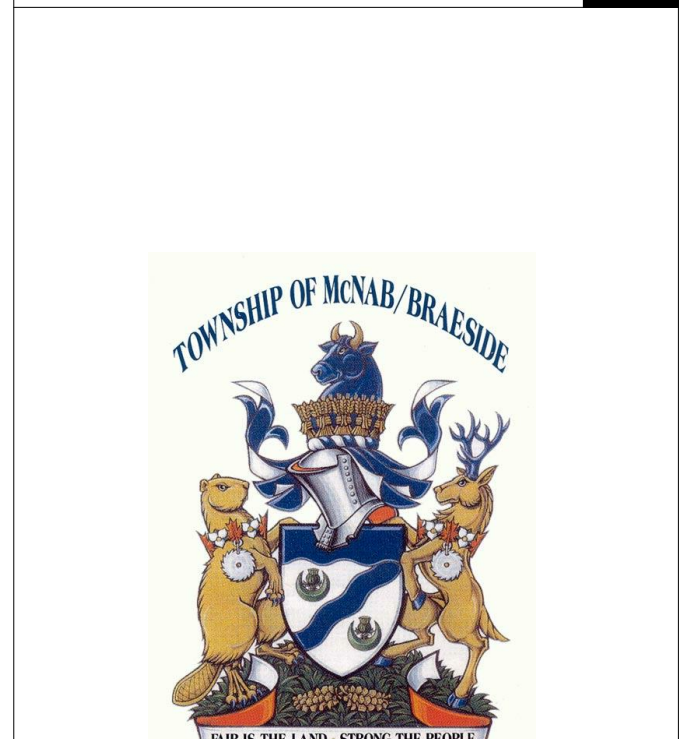

Client:
Township of McNab Braeside

Project:
21688
McNab / Braeside Municipal Building
2473 RUSSETT DRIVE, ARNPRIOR, ONTARIO K7S 3G8

+ V G ARCHITECTS
THE VENTIN GROUP LTD

CONSTRUCTION ASSEMBLIES

A0.2A