

REFLECTED CEILING LEGEND

GENERAL NOTES

- COORD. W/ MECH. & ELEC. DWG.'S FOR RESPECTIVE CEILING MTD. OR RECESSED ITEMS
- FINAL LOCATION OF ALL MECH. & ELEC. FIXTURES TO BE CONFIRMED PRIOR TO INSTALL. COORD. ALL MECH. & ELEC. ITEMS W/ ARCH. DWGS. & REPORT ANY DISCREPANCIES PRIOR TO ANY WORK
- UNLESS DIMENSIONED OTHERWISE, LIGHT FIXTURES TO BE CENTERED IN ROOM AND EQUALLY DISTRIBUTED
- STEEL BEAMS & POSTS WHERE EXP'D TO BE PAINTED C/W INTUMESCENT COATING WHERE REQ'D TO BE FIRE RATED
- ALL INT. CEILING BULKHEAD SYSTEMS TO BE CONSTRUCTED W/ METAL FRAMING TYP. NOT WD.
- ALL GYP. BD. CEILINGS ARE TO RECEIVE 13mm RESILIENT CHANNELING @ 400mm o/c MAX. & ANY ASSOCIATED BLOCKING TO ACHIEVE A UNIFORM / FLAT CEILING SURFACE
- SHOP DWG.'S TO BE IN DIMENSION UNITS AS ILLUSTRATED ON THIS DWG. OR THEY WILL BE REJECTED (IMPERIAL & METRIC BOTH SHOWN IS ACCEPTABLE); ALSO AIR GRILLES ARE TO REFERENCE THE RM. # THEY ARE INSTALLED (& ANY OTHER ITEMS TYP.)
- UNLESS DIMENSIONED OTHERWISE, CEILING TILES TO BE STARTED AS SHOWN FROM THE CENTER POINT OF ROOMS TYP
- NOT ALL EXP'D MECH. EQUIP. / DUCTING IS SHOWN, ONLY DIFFUSER OR OTHER IMPORTANT ITEM INFO. COORD. W/ MECH. DWG.'S FOR REMAINING TYP.


HATCH IDENTIFICATION MARKER LEGEND

- ALL GYP. BD. FACES TO BE PTD. CAULK ALL PER.'S. PROVIDE SHOP DWG.'S FOR DRYWALL CONTROL JOINT LOCATIONS FOR REVIEW BY ARCHITECT.
- ALL TEXTURED GYPSUM BD. FACES TO BE PTD. CAULK ALL PER.'S. PROVIDE SHOP DWG.'S FOR DRYWALL CONTROL JOINT LOCATIONS FOR REVIEW BY ARCHITECT.
- ALL EX. T.L.G. WD. CEILINGS TO BE PTD. REMOVE & REPAIR/REPLACE ALL DAMAGED FLANKS
- ALL SPRAY FOAM INSUL. TO BE CONCEALED W/ FIREPROOFING SPRAY
- PAINTED CONCRETE CEILING
- WOOD PANEL CEILING
- WOOD SOFFIT
- SOFFIT VENTING
- ATTIC HATCH W/ CEILING FINISH TO SURROUNDING MATERIAL. PROVIDE ELEC. SWITCH FOR SINGLE POLE LIGHT FIXTURE FOR THE CORRESPONDING ATTIC COMPARTMENT SPACE. 150mm RIGID INSUL. / 19mm PLYWD. / INT. FIN. 16mm GYP. BD. TYP. HATCH CONST. W/ CONT. WEATHER SEAL 550mmx900mm MIN.
- FAN COIL MECH. UNIT ACCESS HATCH 150mm RIGID INSUL. / 19mm PLYWD. / INT. FIN. 16mm GYP. BD. TYP. HATCH CONST. W/ CONT. WEATHER SEAL
- ACCESS HATCH (CEILING ACCESS IF REQUIRED) RECESSED MATERIAL TO MATCH & BE FLUSH & ADJ. CEILING. ACCESS DOOR SIZE TO BE: 460x460mm MIN. (SIZE TO BE CONFIRMED ON SITE. TO BE LARGE ENOUGH TO ACCESS REQ'D ITEM MIN.) MODEL DW-5015 OR FIRE RATED FM-5015 BY ACUDOR PRODUCTS INC. OR APPROVED EQUAL.

Revision Schedule		
No.	Date	Particular
1	2017.10.11	ISSUE FOR BUILDING PERMIT & TENDER
2	2017.08.22	ISSUE FOR CLIENT REVIEW
3	2017.10.06	ISSUE FOR TENDER
4	2017.10.12	ISSUE FOR ADDENDUM #1
5	2017.10.23	ISSUE FOR ADDENDUM #1
6	2017.10.23	ISSUE FOR ADDENDUM #3

Client:
Township of McNab Braeside

Project:
21688
McNab / Braeside Municipal Building
2473 RUSSETT DRIVE, ARNPRIOR, ONTARIO K7S 3G8

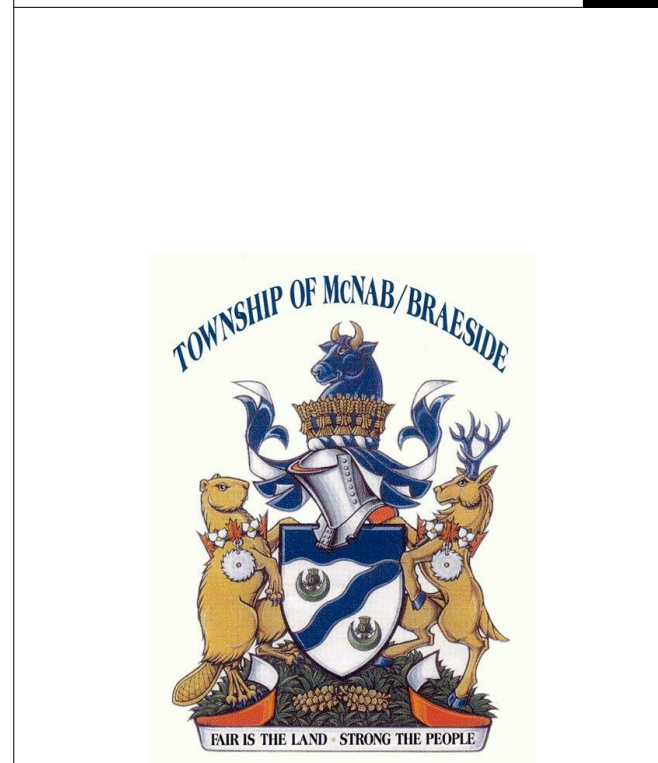

Client:
Township of McNab Braeside

Project:
21688
McNab / Braeside Municipal Building
2473 RUSSETT DRIVE, ARNPRIOR, ONTARIO K7S 3G8

VG ARCHITECTS
THE VENTIN GROUP LTD

A6.1

All dimensions and measurements must be checked and verified by the General Contractor. Reproduction of drawings and related documents in whole or in part is forbidden without written permission of The Ventin Group.

LEVEL 1 REFLECTED CEILING PLAN
10/26/2017 7:15:53 PM