

ALUMN. WINDOW AND FRAME / EXTERIOR DOORS			
DESCRIPTION EXTERIOR ALUMN SCREEN DOOR			
NO.	ELEVATION	DOOR	
D1		TYPE	TYPE
		SIZE	1930 X 2375
		MATL	ALUMN / GLASS
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	
		MATL	ALUMN SCREEN
		FINISH	N/A
		HEAD	N/A
		JAMB	N/A
REMARKS			

CR LAWRENCE TRI FOLD PATIO DOOR			
DESCRIPTION EXTERIOR FOLDING TRI PANEL			
NO.	ELEVATION	DOOR	
D5		TYPE	TYPE
		SIZE	3-1046 X 2743
		MATL	ALUMN
		FINISH	PTD
		GLASS	
		FRAME	
		TYPE	ALUM
		MATL	HM
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

INTERIOR DOORS			
DESCRIPTION INTERIOR PASSAGE DOOR			
NO.	ELEVATION	DOOR	
D6		TYPE	TYPE
		SIZE	915 (36") X 2134
		MATL	WD
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	HWD
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

DOOR & FRAME / SCREEN SCH. NOTES

IT IS THE RESPONSIBILITY OF THE DOOR, FRAME & HARDWARE MANUFACTURER TRADES TO CO-ORDINATE & EXECUTE THEIR WORK TOGETHER.

DIMENSIONS INDICATED ARE R.O. - VERIFY ALL OPENING DIMENSIONS ON SITE PRIOR TO FABRICATION & ORDERING.

COORDINATE WITH TYPICAL DOOR & WINDOW DETAILS PROVIDED.

1. COORDINATE WITH FLOOR PLANS ON LIFE SAFETY DRAWING(S) FOR FIRE SEPARATIONS REQUIRED FIRE RATED DOORS.
2HR. FIRE SEPARATION TO HAVE 1 1/2HR. FIRE RATED DOORS/FRAMES.
1HR. FIRE SEPARATIONS TO HAVE 3/4 HR. FIRE RATING DOORS/FRAMES.
1/2HR. FIRE SEPARATIONS TO HAVE 20MIN. FIRE RATED DOORS/FRAMES

2. ALL FIRE RATED DOORS & SCREENS WITH GLAZING "GL" TO HAVE "FIRELITE" GLAZING AS REQUIRED INCLUDING ALL EXPOSURE SITUATIONS. ALL NON RATED GLAZING TO BE TEMPERED TYP. ALL EXTERIOR FLOOR GLAZING TO BE LAMINATED SAFETY GLASS. ALL EXTERIOR DOORS & SCREENS TO HAVE INSULATED DOUBLE GLAZING. INTERIOR SINGLE GLAZING.

3. ALL FRAMES FOR CONCRETE BLOCK WALLS & GYPSUM BOARD WALLS / PARTITIONS SHALL BE WRAP AROUND TYPE FOR WALL THICKNESS UP TO 190mm (TO BE SMUG / TIGHT FIT ON WALL SYSTEM THAT THEY ARE INSTALLED ON / IN) OVER 190mm WALLS TO RECEIVE 172mm FRAMES. (COORD. WITH FLOOR PLANS FOR WALL THICKNESS & LOCATIONS) (COORDINATE WITH A8 DETAILS)

4. FRAMES SHALL BE WRAP AROUND TYPE FOR WALL THICKNESS UP TO 190mm.
124mm GYP. BD. WALLS TO RECEIVE 148mm FRAME
140mm GYP. BD. WALLS TO RECEIVE 168mm FRAME
153mm GYP. BD. WALLS TO RECEIVE 172mm FRAME
166mm GYP. BD. WALLS TO RECEIVE 172mm FRMAE
169mm GYP. BD. WALLS TO RECEIVE ...
184mm GYP. BD. WALLS TO RECEIVE 222mm FRAME
OVER 190mm GYP. BD. WALLS TO RECEIVE 172mm FRAMES. COORDINATE WITH FLOOR PLANS FOR WALL THICKNESS & LOCATIONS OF BUTT FRAMES & TO DETAILS ON THIS SHEET.

GENERAL NOTES:

COORDINATE WITH FLOOR PLANS & ELEVATIONS FOR LOCATIONS, REQUIRED FRAME WIDTH, 170" DOOR SWINGS & QUANTITY OF REQUIRED DOORS, FRAMES & SCREENS.

DESCRIPTION EXTERIOR GLASS DOOR WITH SIDELITE			
NO.	ELEVATION	DOOR	
D2		TYPE	TYPE
		SIZE	965 X 2135
		MATL	HM
		FINISH	PTD
		GLASS	
		FRAME	
		TYPE	
		MATL	HM
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

DESCRIPTION JANITOR CLOSET DOOR 3/4H RATING			
NO.	ELEVATION	DOOR	
D7		TYPE	TYPE
		SIZE	762 (30") X 2135
		MATL	WD
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	HWD
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS 3/4H RATING			

DESCRIPTION INTERIOR DOUBLE DOOR			
NO.	ELEVATION	DOOR	
D8		TYPE	TYPE
		SIZE	2-965 X 2135
		MATL	WD
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	HWD
		FINISH	PTD
		HEAD	50
		JAMB	65
REMARKS			

ALL FINISH HARDWARE INFORMATION SHOWN TO BE COORDINATED & VERIFIED WITH THE APPROVED HARDWARE SCHEDULE, INCLUDING BUT NOT LIMITED TO HOLD OPEN DEVICES, ELECTRIC STRIKES, SECURITY KEYPADS, AUTO DOOR OPENERS, CLOSERS, PANIC DEVICES, MAGNETIC HOLD-OPENS, OVERHEAD STOPS, PUSH PLATES, KICK PLATES & ANY OTHER DOOR HARDWARE REQUIREMENTS.

SOUND / ACOUSTIC RATINGS:
COORD. W/ WALL TYPES FOR SOUND RATINGS (STC) & FLR. PLANS FOR WALL TYPE LOCATIONS. ALL DOORS, DOOR FRAMES, SCREENS & GLAZING THAT REQUIRE SOUND RATINGS TO HAVE SOUND PROOFING, SEALS @ PER'S, RECESSED AUTOMATIC DROP DOWN SEALS AT SILLS, 12mm TEMPERED GLAZING.
WD. FRAMES SHIM VOID FILLED SOLID W/ SOUND BATT INSUL.
HM FRAMES ON CONC. BLOCK CONST. FILLED SOLID W/ MORTAR.
HM FRAMES ON METAL / WD. FRAME CONST. TO HAVE BATT INSUL. OF 50mm+25mm FRICTION FIT INTO FRAME BEFORE INSTALL TO ENSURE COMPRESSION OF BATT WHEN INSTALLED

COORD. W/ ELEC. DWG.'S FOR EXIT SIGN & ELEC. EQUIP. LOCATIONS.

ALL ALUM. DOORS TO HAVE HEAVY DUTY BALL BEARING HINGES - ALL, H.M. & WOOD DOORS TO HAVE 3 BALL BEARINGS HINGES. ALL EXTERIOR H.M. DOORS TO HAVE 4 HINGES.

ALL EXTERIOR H.M. DOORS TO BE INSULATED, 16 Ga. CONT. WELDED C/W STIFFENER PLATES C/W WEATHER STRIPPING, FRAMES TO BE THERMALLY BROKEN

IN ALL CORRIDOR DOORS & HIGH TRAFFIC AREAS, PROVIDE 16 GAUGE CONT. WELDED DOORS & 3 HEAVY DUTY BALL BEARING HINGES.

ALL WASHROOM DOORS TO BE UNDERCUT BY 25mm (1") UNLESS NOTED OTHERWISE BY MECH.

DESCRIPTION EXTERIOR GLASS DOOR WITH SIDELITE			
NO.	ELEVATION	DOOR	
D3		TYPE	TYPE
		SIZE	965 X 2135
		MATL	HM
		FINISH	PTD
		GLASS	
		FRAME	
		TYPE	
		MATL	HM
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

DESCRIPTION EXTERIOR PASSAGE DOOR			
NO.	ELEVATION	DOOR	
D4		TYPE	TYPE
		SIZE	965 X 2135
		MATL	HM
		FINISH	PTD
		GLASS	
		FRAME	
		TYPE	
		MATL	HM
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

DESCRIPTION INTERIOR BARRIER FREE CLEAR			
NO.	ELEVATION	DOOR	
D9		TYPE	TYPE
D9A		TYPE	TYPE
		SIZE	965 X 2135
		MATL	WD
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	HWD
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS D8A 3/4 HR FR @ MECH ROOM			

IMAGE TO BE PAINTED ONTO WASHROOM DOORS. MENS TO RECEIVE HALF WOMENS TO RECEIVE HALF UNIVERSAL TO RECEIVE BOTH IMAGES TOGETHER AS ILLUSTRATED

EXAMPLE HALF IMAGE FOR MENS

IMAGE PAINT COLOUR TO BE SELECTED BY ARCHITECT

SHOP DRAWINGS

IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO ENSURE, DOORS(S), SCREENS(S), FRAMES(S), & THEIR HARDWARE MANUF.'S TRADES COORD. & EXECUTE THEIR WORK TOGETHER & LABEL IDENTIFYING INFO. FOR ALL DOORS(S), SCREENS(S), FRAMES(S) SCH.'S TO MATCH THE IDENTIFICATION TAG LABELS HERE. NOT HAVING DIFF. LABELS & DIM. UNITS ON SHOP DWG.'S THAN TENDERED DOCUMENTS TYP. (REVISE & RESUBMIT SHOP DWG.'S WILL BE RETURNED IF THIS FORMAT IS NOT FOLLOWED W/ NO REVIEW UNDERTAKEN)

DESCRIPTION EXTERIOR PASSAGE DOOR			
NO.	ELEVATION	DOOR	
D4		TYPE	TYPE
		SIZE	965 X 2135
		MATL	HM
		FINISH	PTD
		GLASS	
		FRAME	
		TYPE	
		MATL	HM
		FINISH	PTD
		HEAD	50
		JAMB	50
REMARKS			

DESCRIPTION SERVING OPENING			
NO.	ELEVATION	DOOR	
D10		TYPE	TYPE
		SIZE	SEE SKETCH
		MATL	METAL
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	N/A
		FINISH	N/A
		HEAD	N/A
		JAMB	N/A
REMARKS			


DESCRIPTION SERVING WINDOW WITH ROLL DOWN SECURITY GUARD OVERHEAD GUARD HOUSING			
NO.	ELEVATION	DOOR	
D10		TYPE	TYPE
		SIZE	SEE SKETCH
		MATL	METAL
		FINISH	PTD
		GLASS	NOTE 2
		FRAME	
		TYPE	NOTE 3
		MATL	N/A
		FINISH	N/A
		HEAD	N/A
		JAMB	N/A
REMARKS			

SERVING WINDOW WITH ROLL DOWN SECURITY GUARD OVERHEAD GUARD HOUSING

Revision Schedule		
No.	Date	Particular
1	2017.10.11	ISSUE FOR BUILDING PERMIT & TENDER
2	2017.08.22	ISSUE FOR CLIENT REVIEW
3	2017.10.06	ISSUE FOR CLIENT REVIEW
4	2017.10.12	ISSUE FOR TENDER

All dimensions and measurements must be checked and verified by the General Contractor.

Reproduction of drawings and related documents in whole or in part is forbidden without written permission of The Ventin Group.

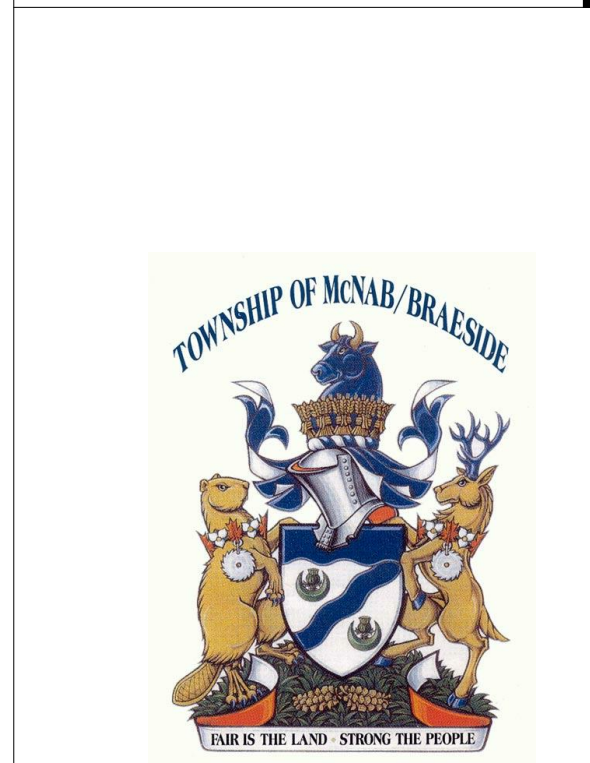

Client:
THE TOWNSHIP OF McNAB / BRAESIDE

Project:
21688
McNAB / BRAESIDE TOWN CENTRE

McNab / Braeside
ONTARIO

+ V G ARCHITECTS
THE VENTIN GROUP LTD

A8.1

V:\VYG Ottawa Project\Brae\1433 McNab Braeside\02_Working Drawings\07_Rev\1433 - McNab Braeside - Pemeel Building 07.26.17