


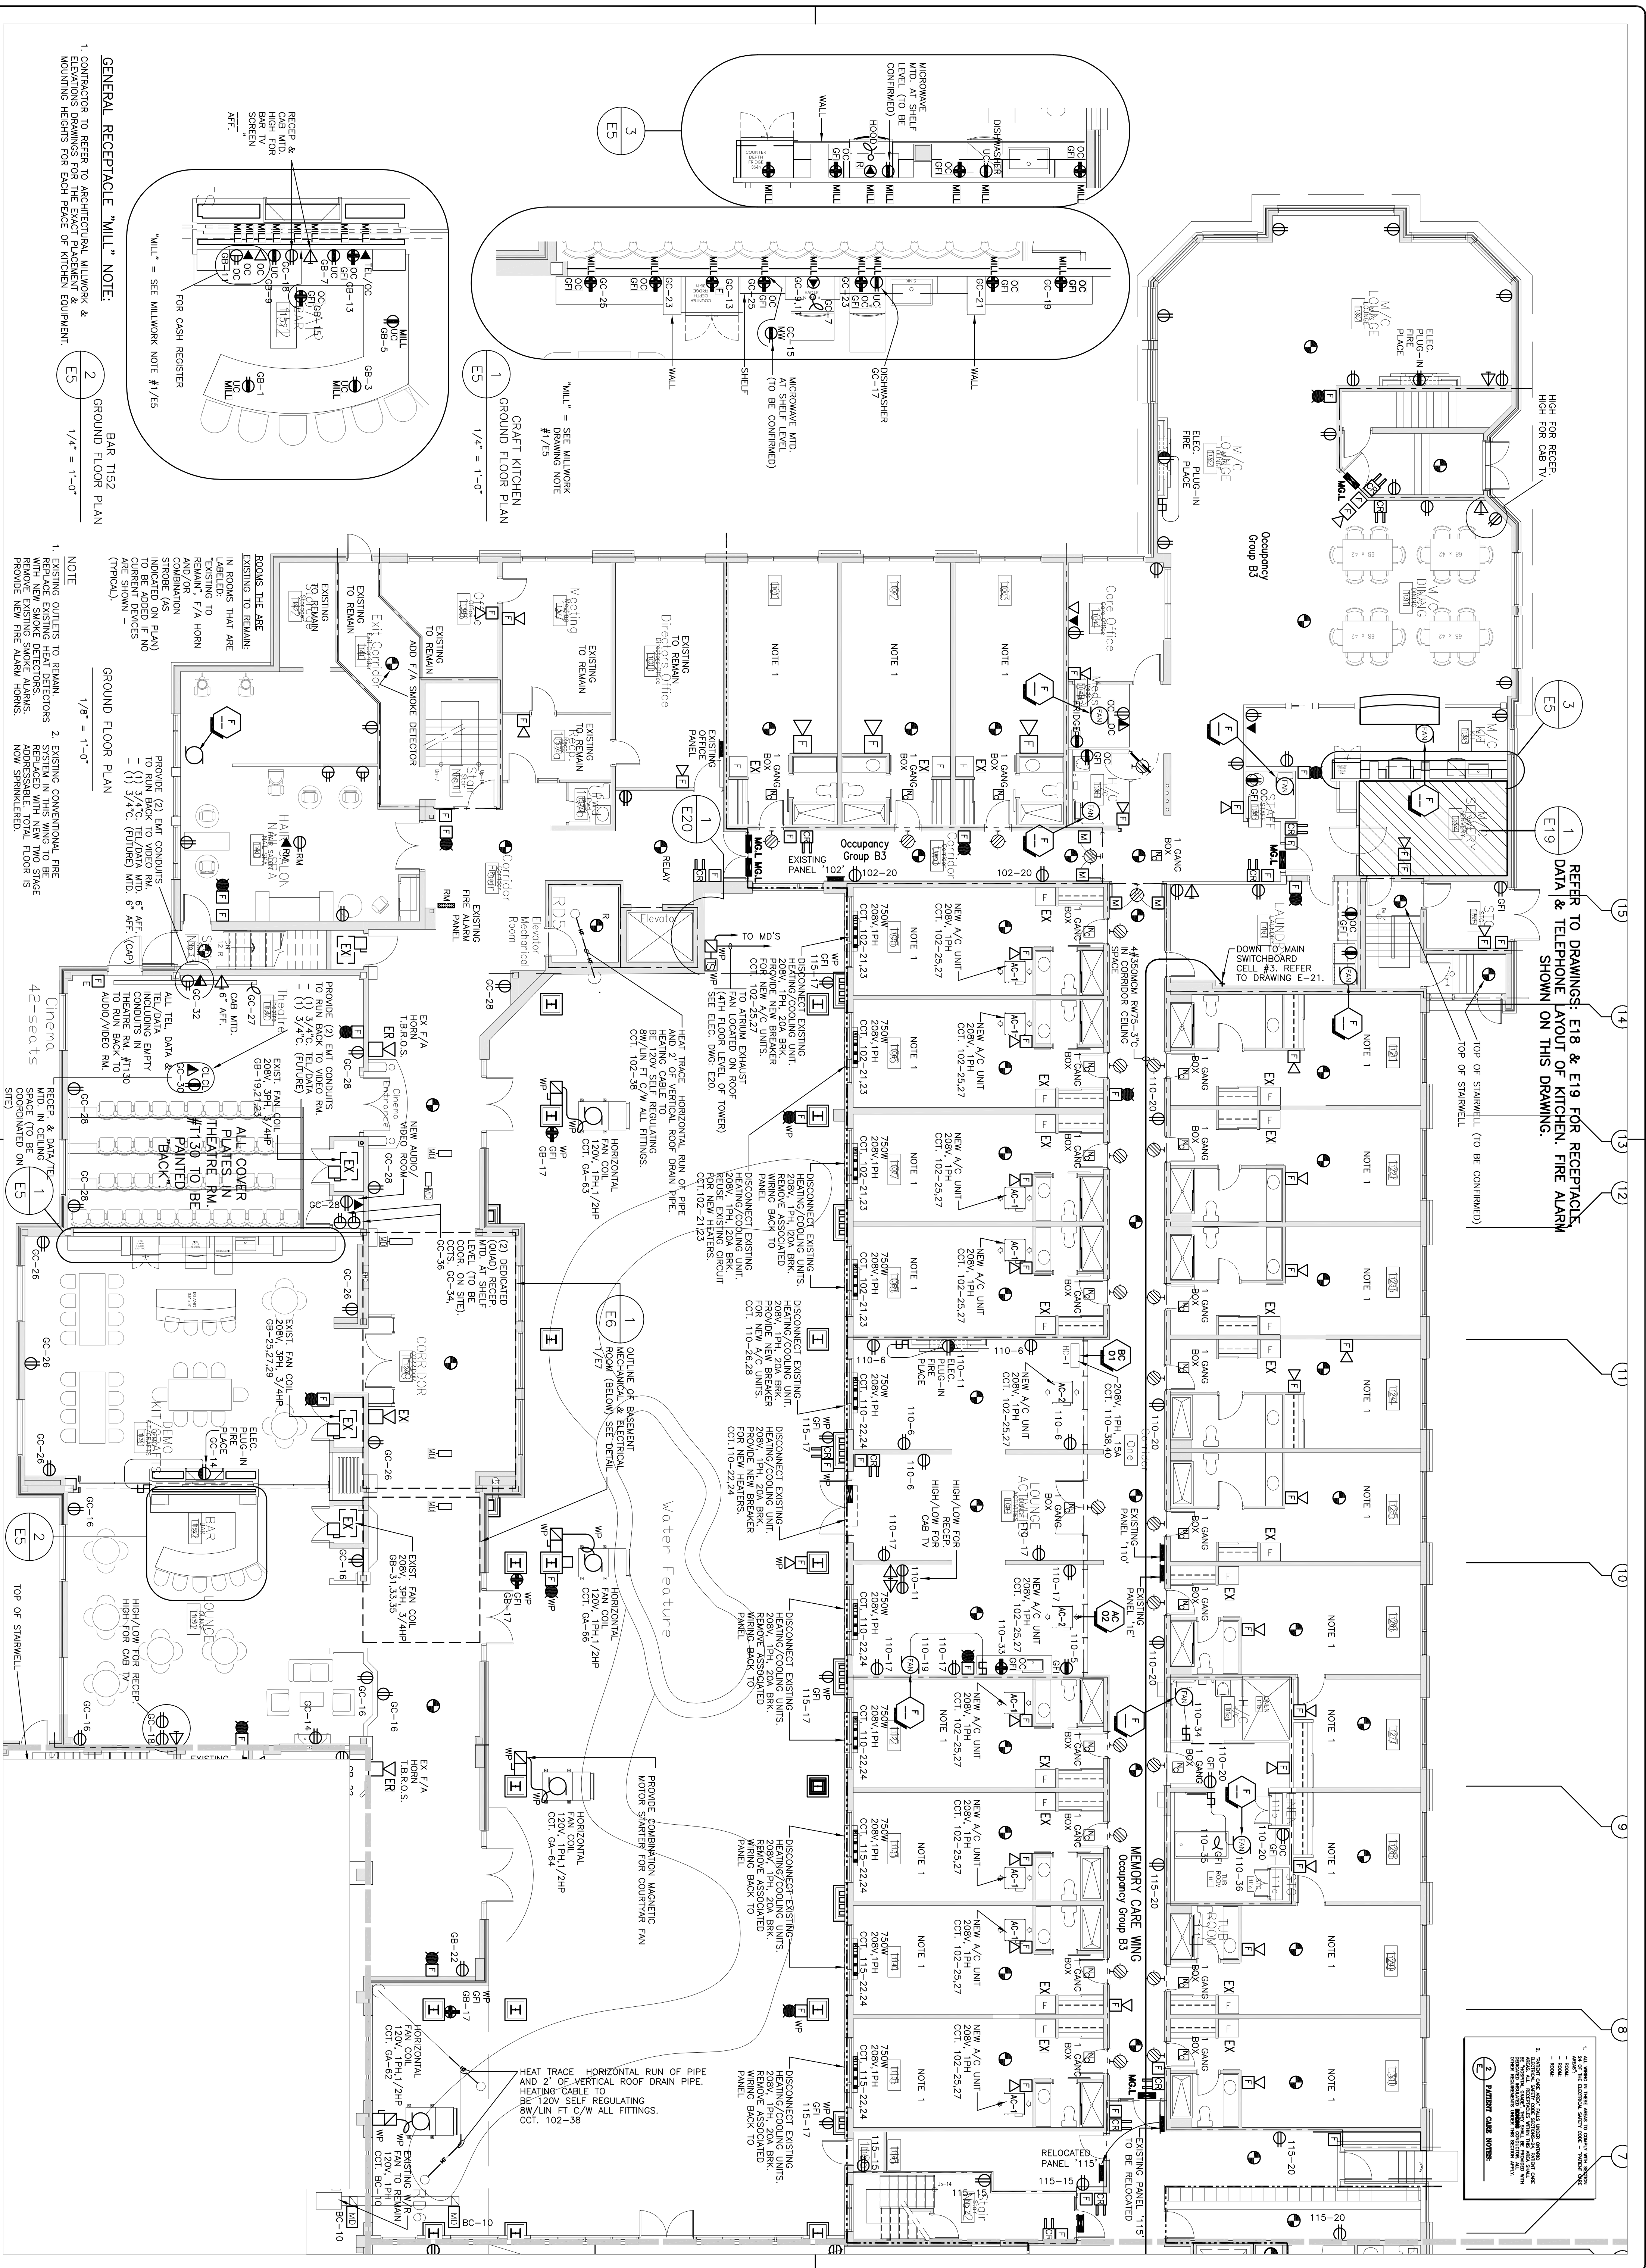

NOTE
EXISTING ADDRESSABLE FIRE ALARM DEVICES & SYSTEM TO REMAIN IN THE TOWER. PULL STATIONS ONLY ARE TO BE CHANGED TO TWO STAGE.

GENERAL NOTES:	ALL LIGHT SWITCHES TO BE MOUNTED 1100MM AFF. - ALL DIMMER SWITCHES TO BE MOUNTED 1100MM HEIGHT TAKEN FROM TOP OF FINISH FLOOR LEVEL. "AFF" TO CENTRE OF FINISH FLOOR LEVEL. OUTLET BOX: ALL F/A TILL STATIONS TO BE MOUNTED 1200MM AFF. - 1200MM HEIGHT TAKEN FROM TOP OF FINISH FLOOR LEVEL. "AFF" TO CENTRE OF FINISH FLOOR LEVEL. OUTLET BOX.
----------------	--

QUADRANT
ENGINEERING LIMITED, CONSULTING ENGINEERS
PRETORIA AVE., OTTAWA, ONTARIO, K1P 1H1
(613) 567-1487 FAX (613) 567-1488
E-Mail: mail@quadrantengineering.ca

06	JULY 20/15	ISSUED FOR PRICING	RE
05	JUN 22/15	PROGRESS ISSUE	RE
04	JUN 15/15	PROGRESS ISSUE	RE
03	JUN 03/15	ISSUED FOR REVIEW	RE
02	APR 16/15	RE-ISSUED FOR PERMIT	RE
01	DEC 23/14	ISSUED FOR PERMIT	RE
NO.	DATE	REVISION	RE

S.J.L.

S. J. LAWRENCE
ARCHITECT INCORPORATED

18 Donahoe St., Suite 205, Olney, ON, K2E 8H7
Tel: (613) 796-7770 Fax: (613) 796-2793
Email: sjl@sjlawrence.com

**SOUTHWAY INN
RETRO-FIT
RETIREMENT HOMES**

ELECTRICAL
PARTIAL GROUND
FLOOR PLAN
POWER

E05 } MTD