


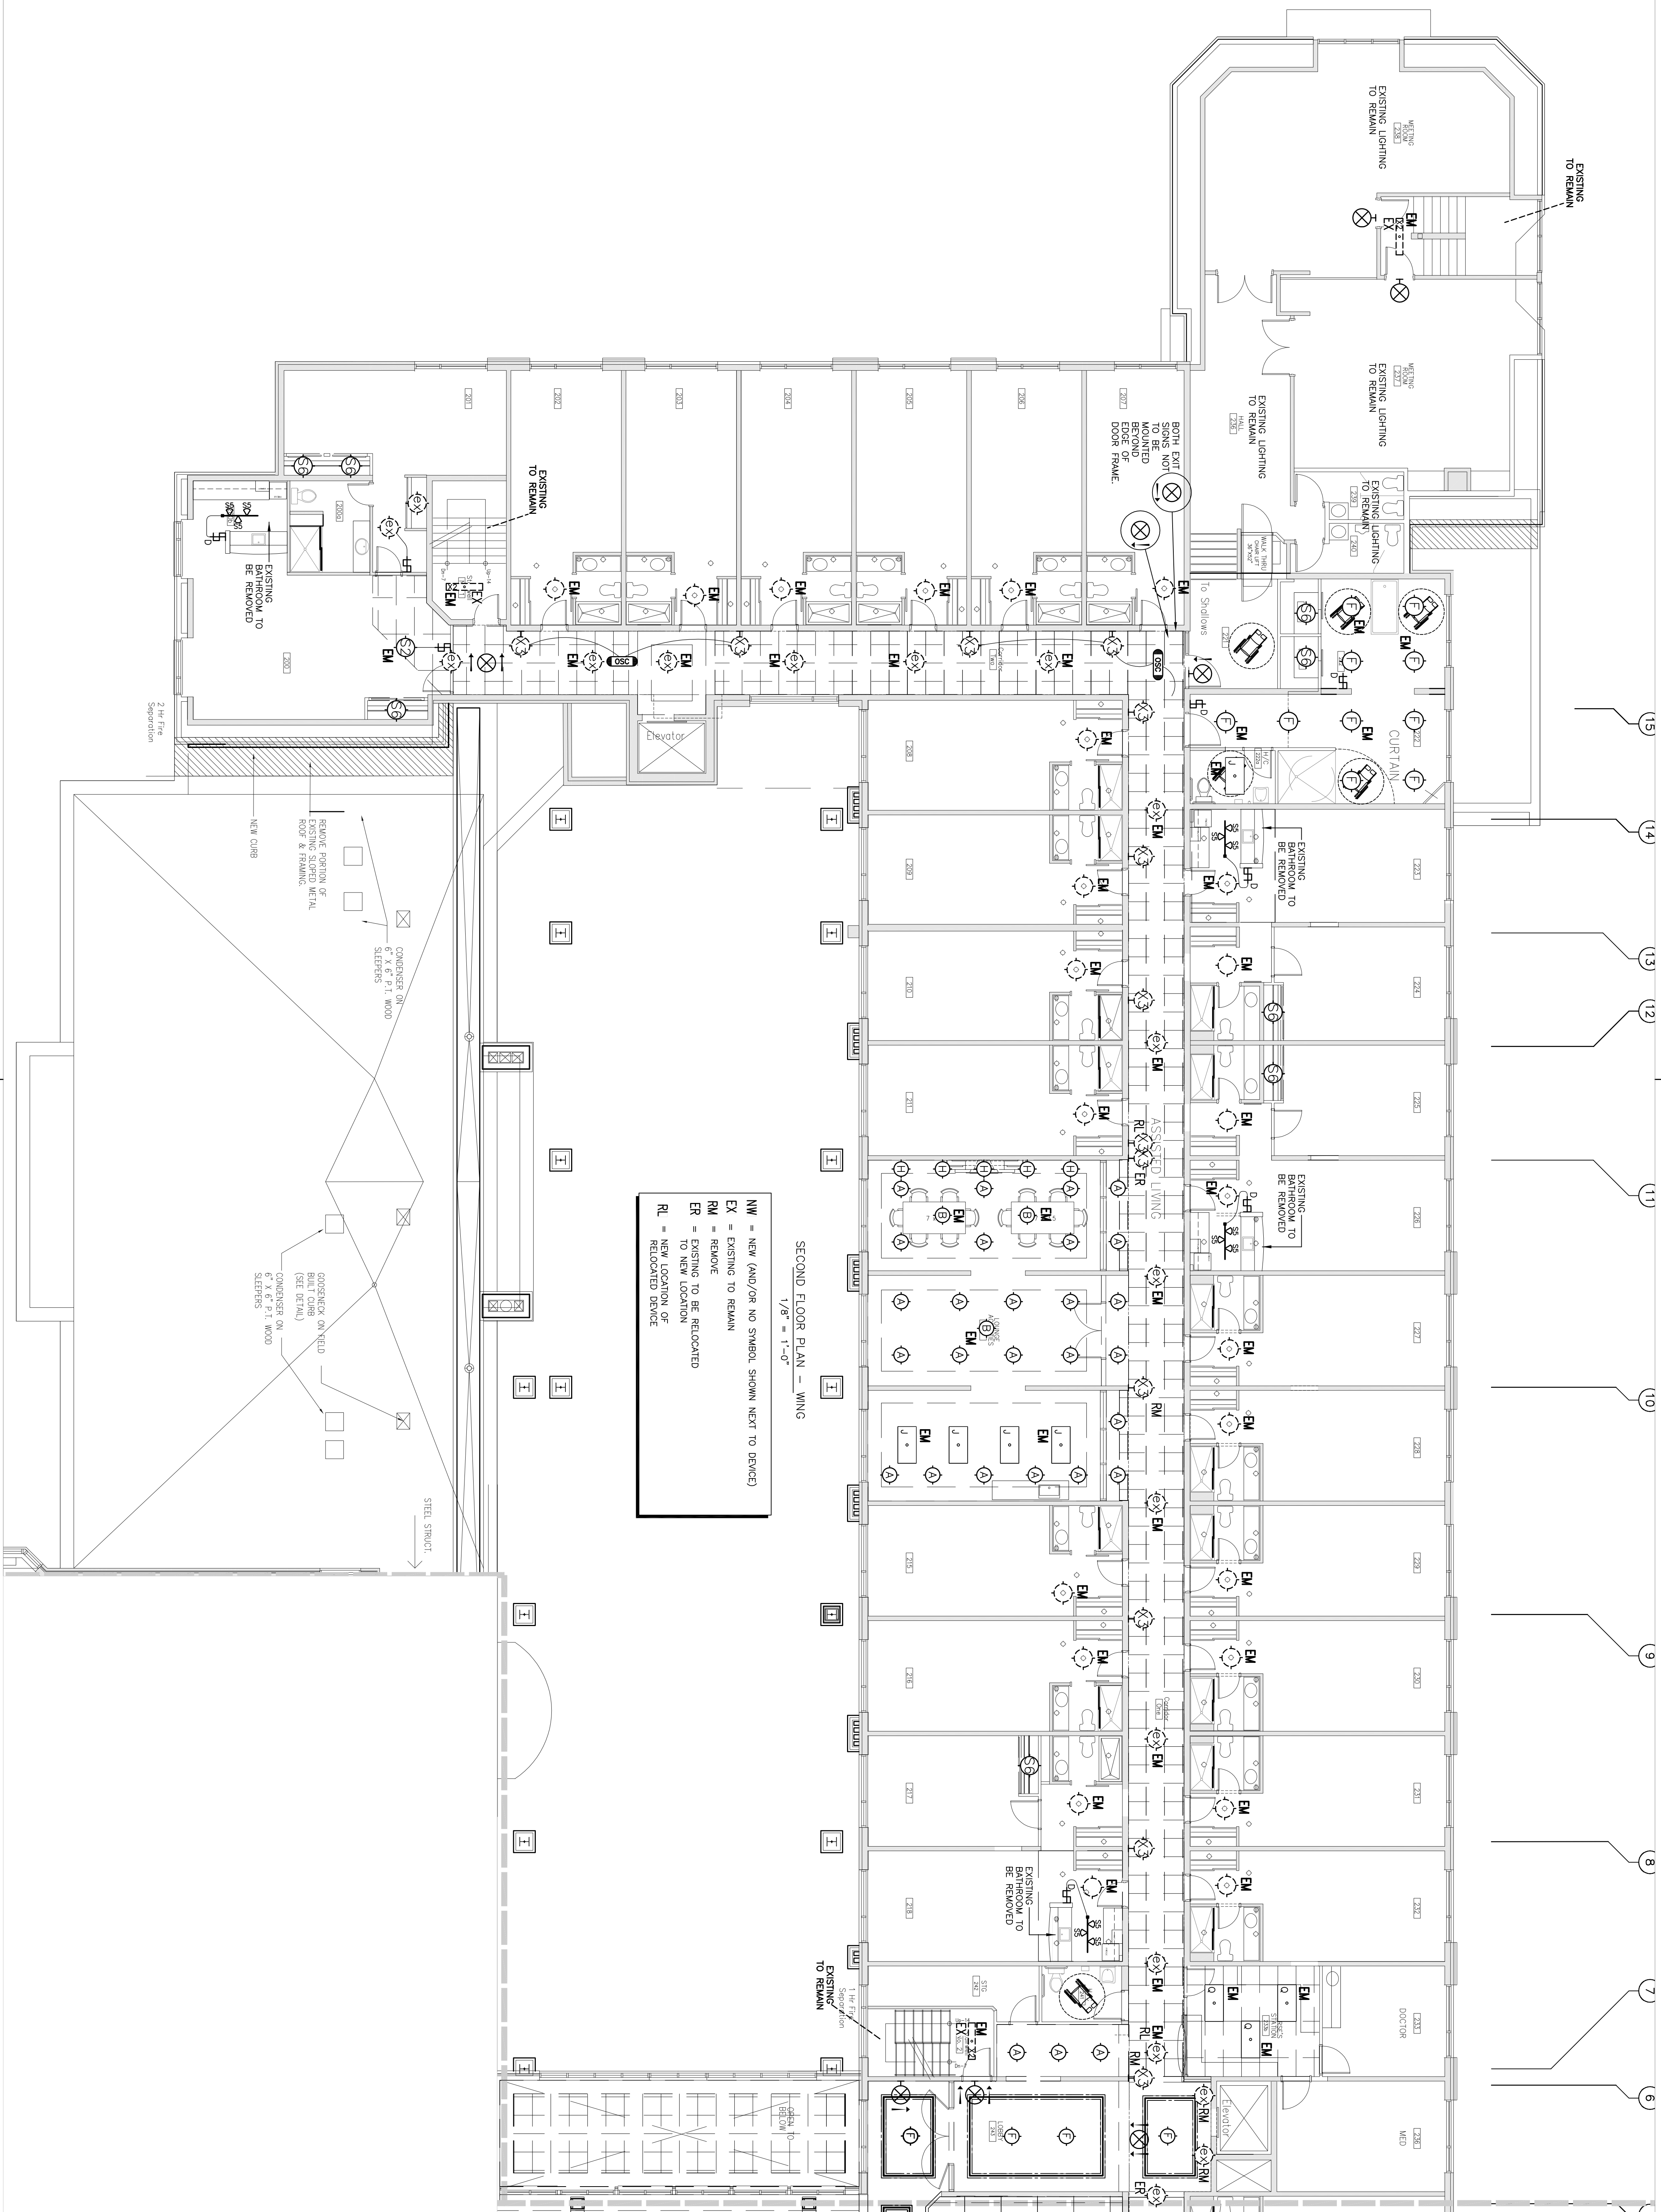

ALL LIGHT SWITCHES TO BE MOUNTED
1100mm AFF. -
1100mm HEIGHT TAKEN FROM TOP OF
FINISH FLOOR LEVEL. *AFF TO CENTER OF
OUTLET BOX.

ALL F/A TALL STATIONS TO BE MOUNTED
1200mm AFF. -
1200mm HEIGHT TAKEN FROM TOP OF
FINISH FLOOR LEVEL. *AFF TO CENTER OF
OUTLET BOX.

EXACT LOCATION OF EQUIPMENT
SUBMITTED TO COORDINATION WITH
MECHANICAL

ALL EMPT CONDUIT TO BE C/W PULL
ROPE.

GENERAL NOTES:

QUADRANT
ENGINEERING LIMITED, CONSULTING ENGINEERS
107 PRETORIA AVE., OTTAWA, ONTARIO, K1S 1W8
TEL (613) 567-1487 FAX (613) 567-1493
E-Mail: mail@quadrantengineering.co

[illegible]

S.J.L.

S. J. LAWRENCE
ARCHITECT INCORPORATED

18 Dunlap St., Suite 205, OHIO, OH, 43215
Tel: (614) 756-7771 Fax: (614) 756-7531
E-mail: sjl@sjlarch.com

ISSUING AGENCY EL & RL	DISPATCHED BY JM
DATE MAR '14	JM
SOURCE 1/8/1-0*	PLANT DATE MARCH 18, 2014

SOUTHWAY INN
RETRO-FIT
RETIREMENT HOME

ELECTRICAL
PARTIAL SECOND
FLOOR PLAN LIGHTING