


EXIST. PANEL '10M'
P.N.L. LOCATION GROUND FL. TOWER
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 66
RATING AMPS 225A
TRIM SURFACE
MAIN BKR N/R
BRANCH BKRS BOLT ON

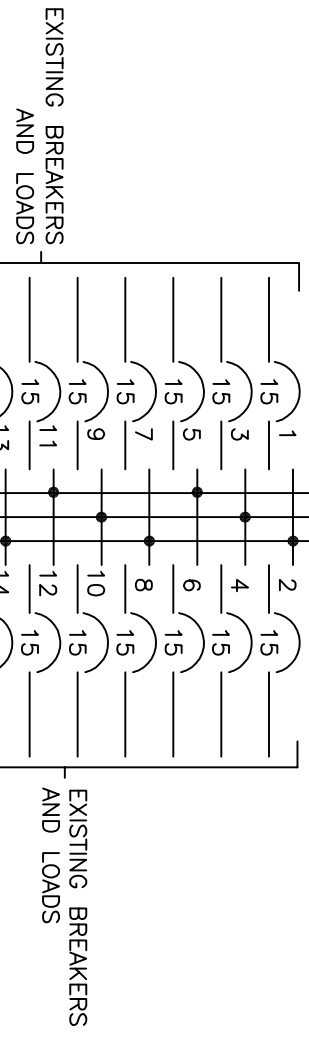

EXISTING BREAKERS AND LOADS
RECEP. FRONT DESK
EXIST. BREAKER & LOAD
SPACE

EXISTING BREAKERS AND LOADS
RECEP. FRONT DESK
EXIST. BREAKER & LOAD
SPACE



EXISTING BREAKERS AND LOADS
RECEP. FRONT DESK
EXIST. BREAKER & LOAD
SPACE

EXISTING BREAKERS AND LOADS
RECEP. FRONT DESK
EXIST. BREAKER & LOAD
SPACE

* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD

EXIST. PANEL GARAGE (R)

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 42
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON

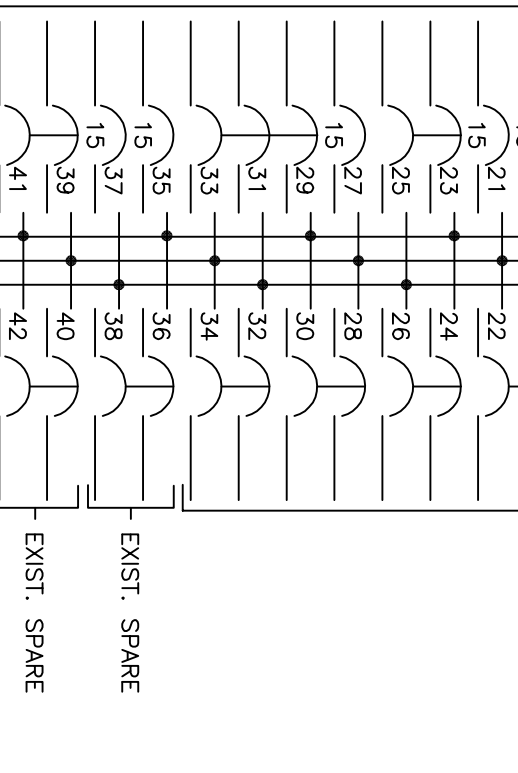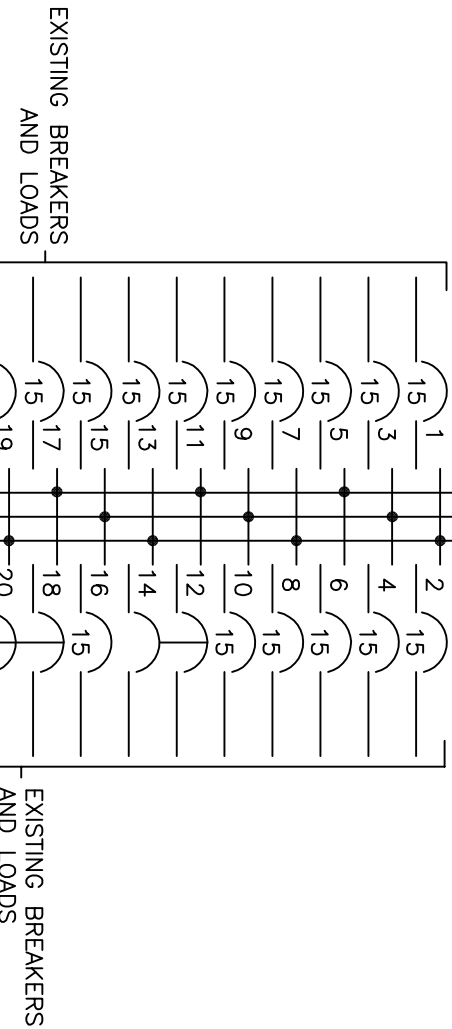


EXIST. PANEL OFFICE

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 42
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON


SPACE

EXISTING BREAKERS AND LOADS

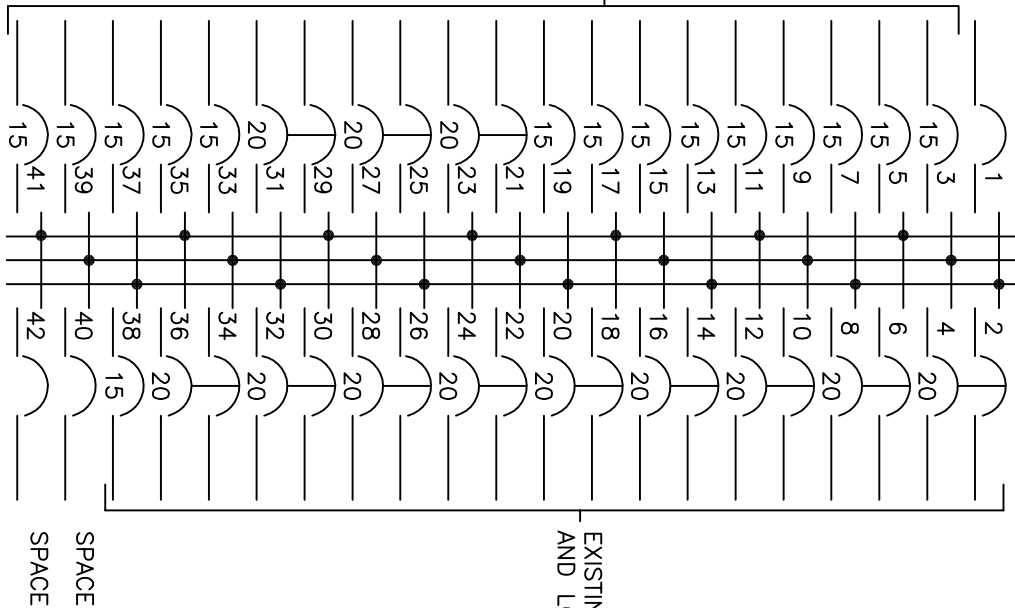


EXIST. PANEL 'L'

P.N.L. LOCATION GROUND FL. LAUNDRY RM
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 72
RATING AMPS 225A
TRIM SURFACE
MAIN BKR N/R
BRANCH BKRS BOLT ON

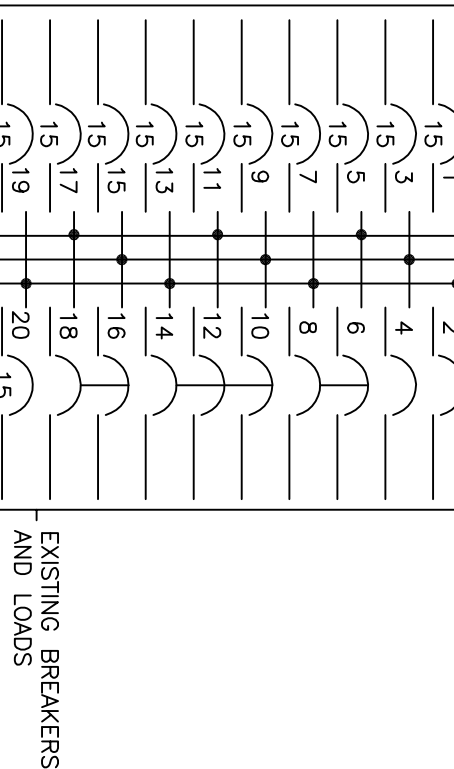

EXISTING BREAKERS AND LOADS

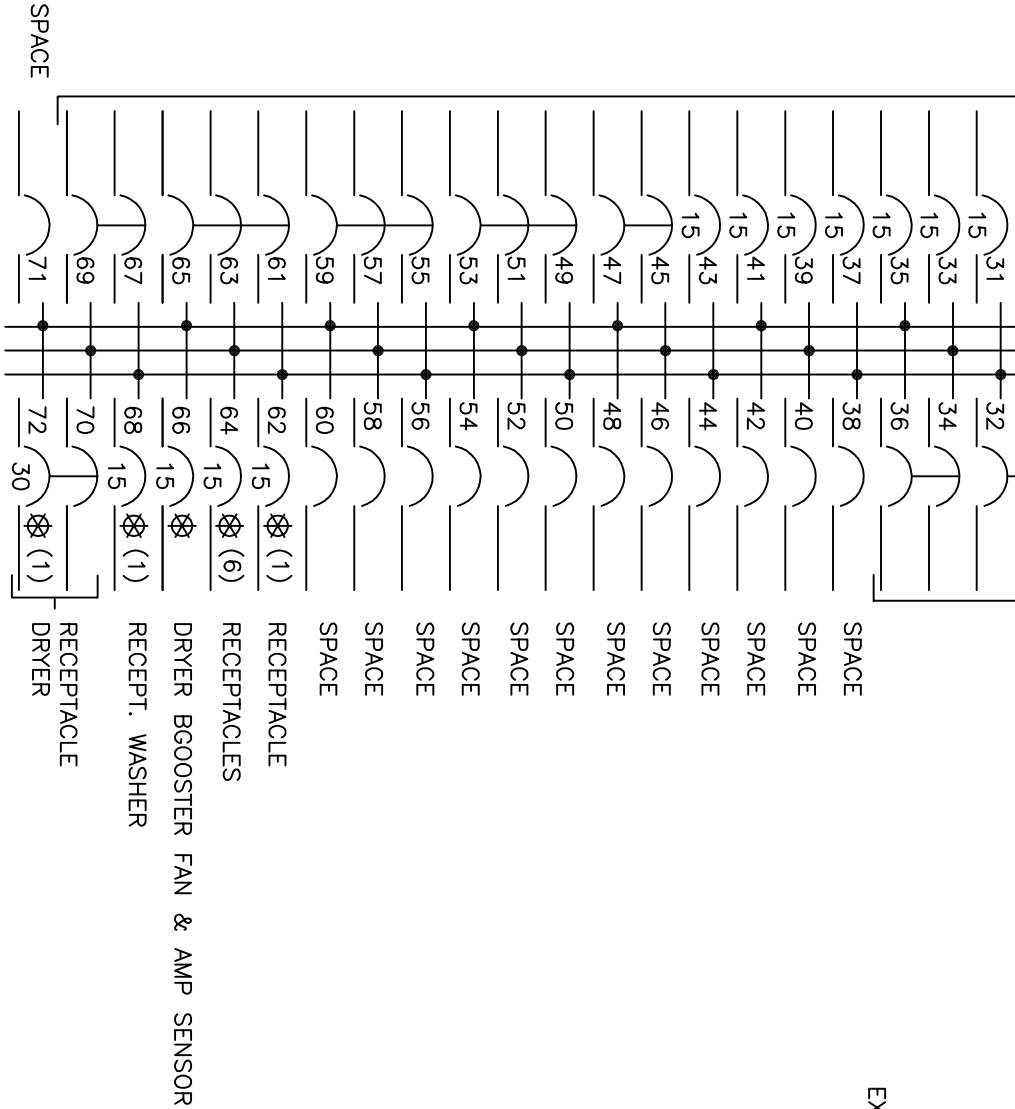


EXIST. PANEL '102'

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 42
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON

SPACE

EXISTING BREAKERS AND LOADS

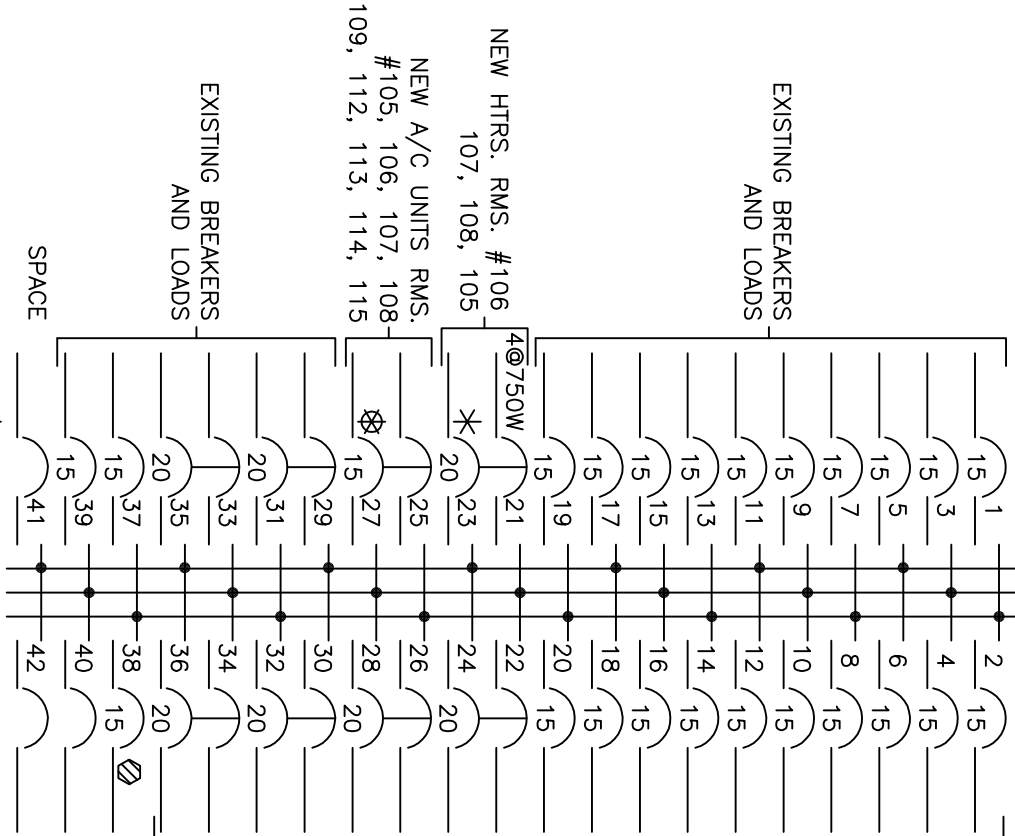


EXIST. PANEL '115'


P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 42
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON

EXISTING BREAKERS AND LOADS

EXISTING BREAKERS AND LOADS

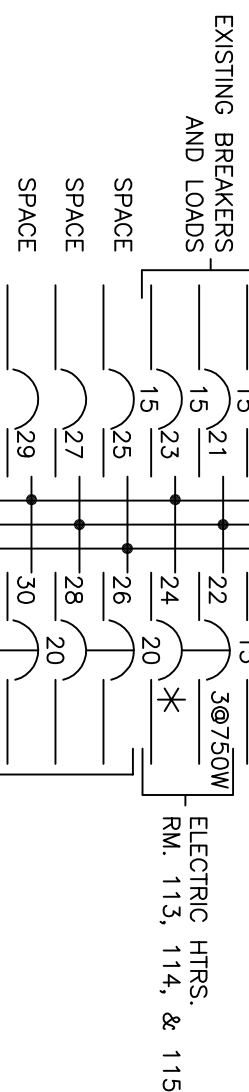


EXISTING BREAKERS AND LOADS

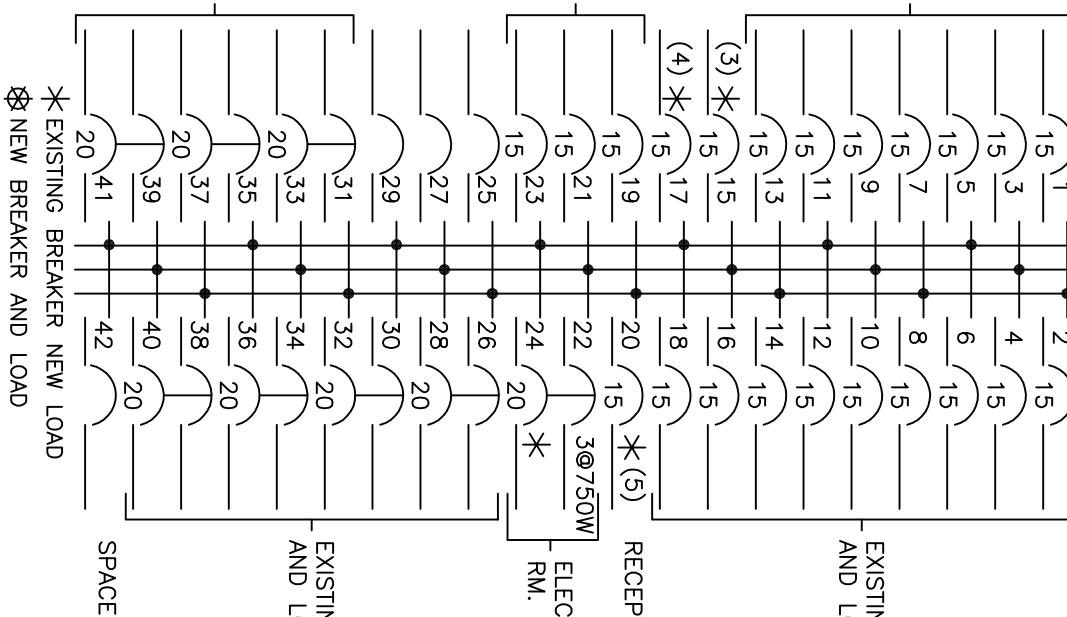

* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD

EXIST. PANEL 'A' SHOP AREA

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 24
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON

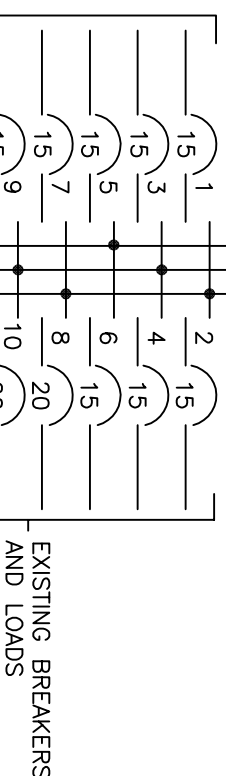

* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD


EXIST. PANEL '110'

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 42
RATING AMPS 225A
TRIM FLUSH
MAIN BKR N/R
BRANCH BKRS BOLT ON

SPACE

EXISTING BREAKERS AND LOADS


EXISTING BREAKERS AND LOADS

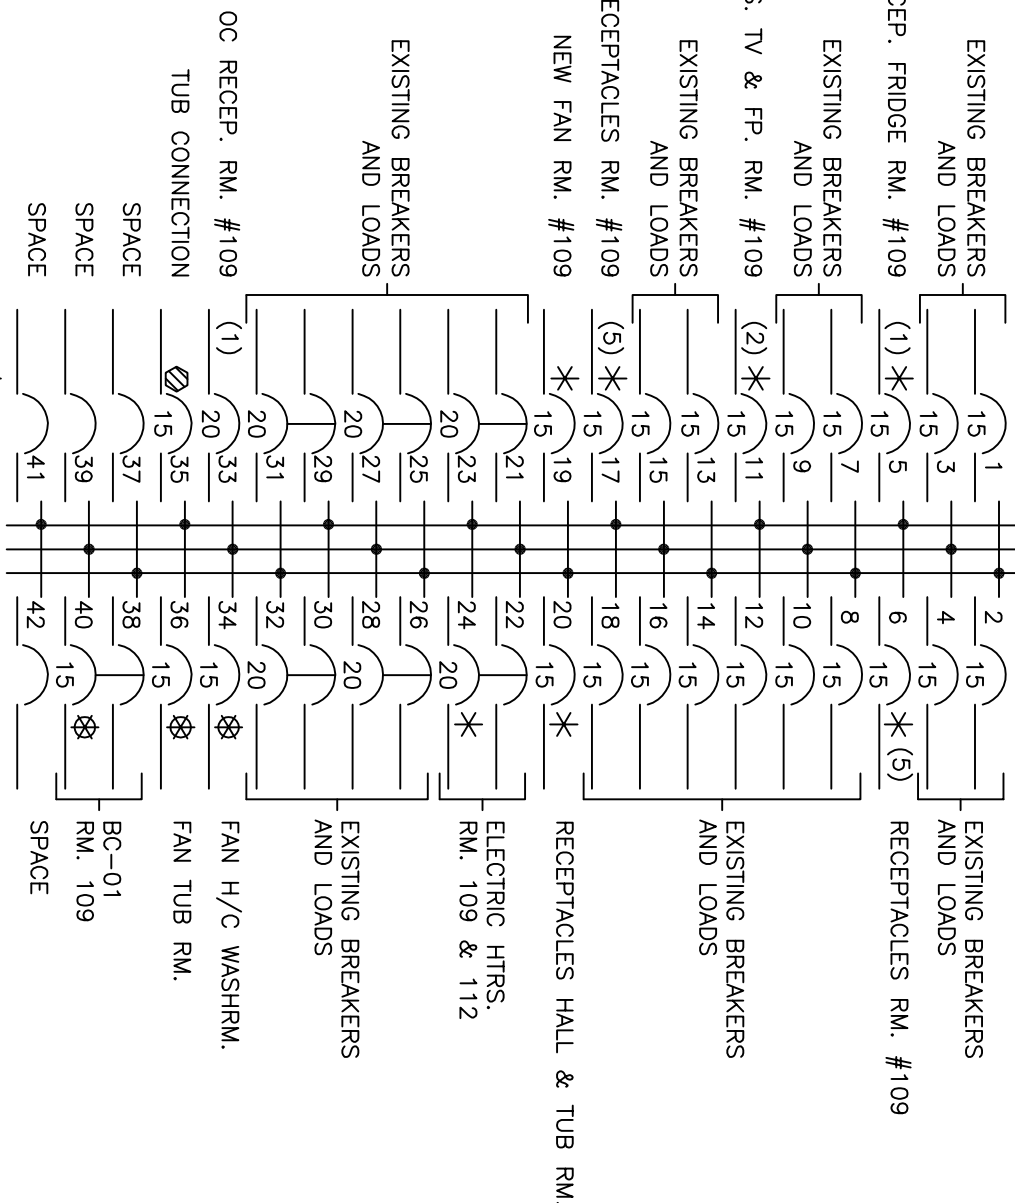

* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD
* 30mA GFCI BREAKER


EXIST. PANEL '1E'

P.N.L. LOCATION GROUND FL. WING
VOLTAGE 120/208V
PHASE 3ø, 4W
POLES 66
RATING AMPS 225A
TRIM SURFACE
MAIN BKR N/R
BRANCH BKRS BOLT ON

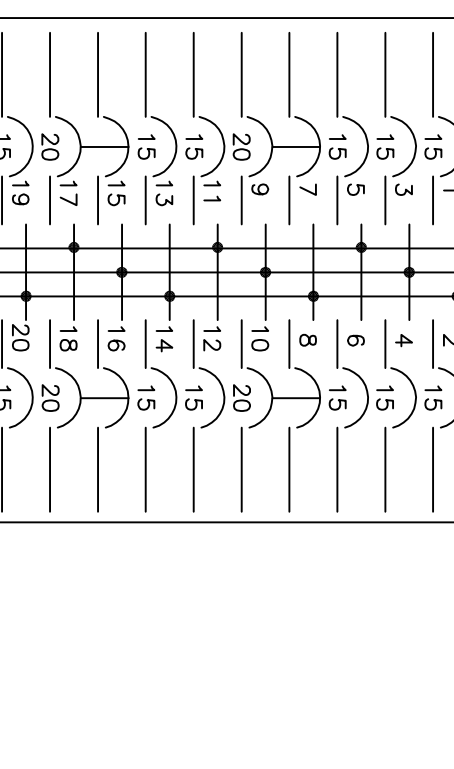

EXISTING BREAKERS AND LOADS

EXISTING BREAKERS AND LOADS

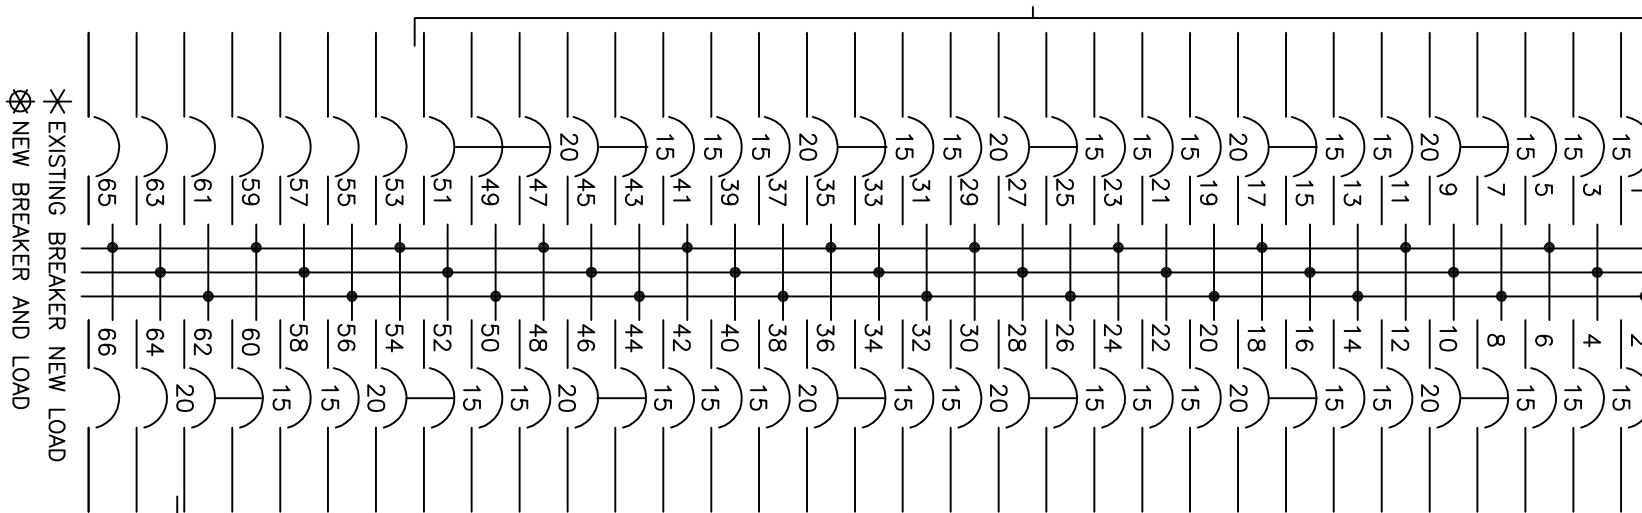

* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD

TIME SWITCH
OFF ON

PHOTOCELL

EXISTING BREAKERS AND LOADS



* EXISTING BREAKER NEW LOAD
* NEW BREAKER AND LOAD

LIGHTING CONTACTOR

100

ALL LIGHT SWITCHES TO BE MOUNTED 1100mm A.F.T. - TAKEN FROM TOP OF FINISH FLOOR LEVEL, 747" TO CENTER OF OUTLET BOX.
ALL I/P & O/G STATIONS TO BE MOUNTED 1200mm A.F.T. - TAKEN FROM TOP OF FINISH FLOOR LEVEL, 747" TO CENTER OF OUTLET BOX.

EXACT LOCATION OF EQUIPMENT WITH MECHANICAL COORDINATION WITH ARCHITECT.
ALL ENTRY CONDUIT TO BE C/W FULL RING.

GENERAL NOTES:

QUADRANT
REGISTERED ELECTRICAL ENGINEERING
11000 AVE. 100, SUITE 100, DOWNTOWN, ONTARIO, CANADA M5H 1A6
TEL: (416) 591-1461 FAX: (416) 591-1463
E-MAIL: info@quadrantelectrical.ca

NO.	DATE	REVISION
01	JULY 20/15	ISSUED FOR PERMITS
02	JUN 22/15	PROGRESS ISSUE
03	JUN 15/15	PROGRESS ISSUE
04	JUN 02/15	ISSUED FOR REVIEW
05	APR 16/15	RE-ISSUED FOR PERMIT
06	DEC 23/14	ISSUED FOR PERMIT

S.J. LAWRENCE
ARCHITECT INCORPORATED
18 BROADVIEW AVE. SUITE 200, DOWNTOWN, ONTARIO, CANADA M5H 1A6
TEL: (416) 591-1461 FAX: (416) 591-1463
E-MAIL: info@sjlawrence.ca

NO.	DATE	REVISION
01	JULY 20/15	ISSUED FOR PERMITS
02	JUN 22/15	PROGRESS ISSUE
03	JUN 15/15	PROGRESS ISSUE
04	JUN 02/15	ISSUED FOR REVIEW
05	APR 16/15	RE-ISSUED FOR PERMIT
06	DEC 23/14	ISSUED FOR PERMIT

SOUTHWAY INN
RETRO-FIT
RETIREMENT HOME

JOB NO.: 001-14-021

PANEL DETAILS
SHEET 3

E25