



<b>TAL-CO SUPPLEMENTAL INSTRUCTION #74</b>			
<b>HOLD OPEN DOORS &amp; REVISED DOOR SWING ON 4TH LOBBY</b>			
Project Name:	<b>RW TOMLINSON - NEW HEAD OFFICE</b>		
Project Location:	<b>100 CitiGate Drive, Ottawa, Ontario</b>		
ARCH. SI #:	<b>ASK 213</b>	Issued By:	<b>Farah Bano</b>
STRUC. SI #:	<b>N/A</b>	Date Issued:	<b>December 14, 2017</b>
MECH. SI #:	<b>N/A</b>	Revision #:	<b>N/A</b>
ELEC. SI #:	<b>CCN E20</b>	Revision Date:	<b>N/A</b>

Supplemental Instructions are issued by the Construction Manager to record a clarification or revision to the previously issued Contract Documentation as reflected by the attached information prepared by the identified Professionals.

The Construction Manager shall review the Supplemental Instruction and the attached information and issue to the affected Trade Contractors identifying the following course of action by the Trade Contractor.

Notify TAL-CO within 5 days of receipt, if the attached documents will require a change to Contract Price or Schedule.

**TITLE: HOLD OPEN DOORS & REVISED DOOR SWING ON 4TH LOBBY**

**Reference:**

Architectural Construction Update 28-Jul-2017

**Attachments:**

CCN E20  
ASK 213

**Description of the work:**

- Provide Door Hold Open Devices at doors D112, D401A & D401B as per CCN E20.
- Revised Door swing at elevator lobby 401 - Affects existing door and frame.

**Reason:**

- CCN E20 - To coordinate electrical with architectural door details.
- ASK 213 - To improve function, and to avoid interference with fire hose cabinet.

## **Contemplated Change Notice**

CCN E-20

Project: Tomlinson Regional Headquarters Building  
Location: 100 Nortel Drive, Ottawa  
Contractor: Tal-Co Building Innovations / Continental – Price Electric  
Date: Dec 12, 2017

---

Provide quotation/credit for proposed work described in this CCN. No work can commence prior to approval of this quotation.

---


### **Scope of work.**

**Provide required electrical for change in door swing (architectural ASK-213.**


1. Provide door hold open devices for doors D112, D401A and D401B. Door hold open devices to be tied in F/A and release on alarm.

ASK 213 attached for reference.

End of CCN

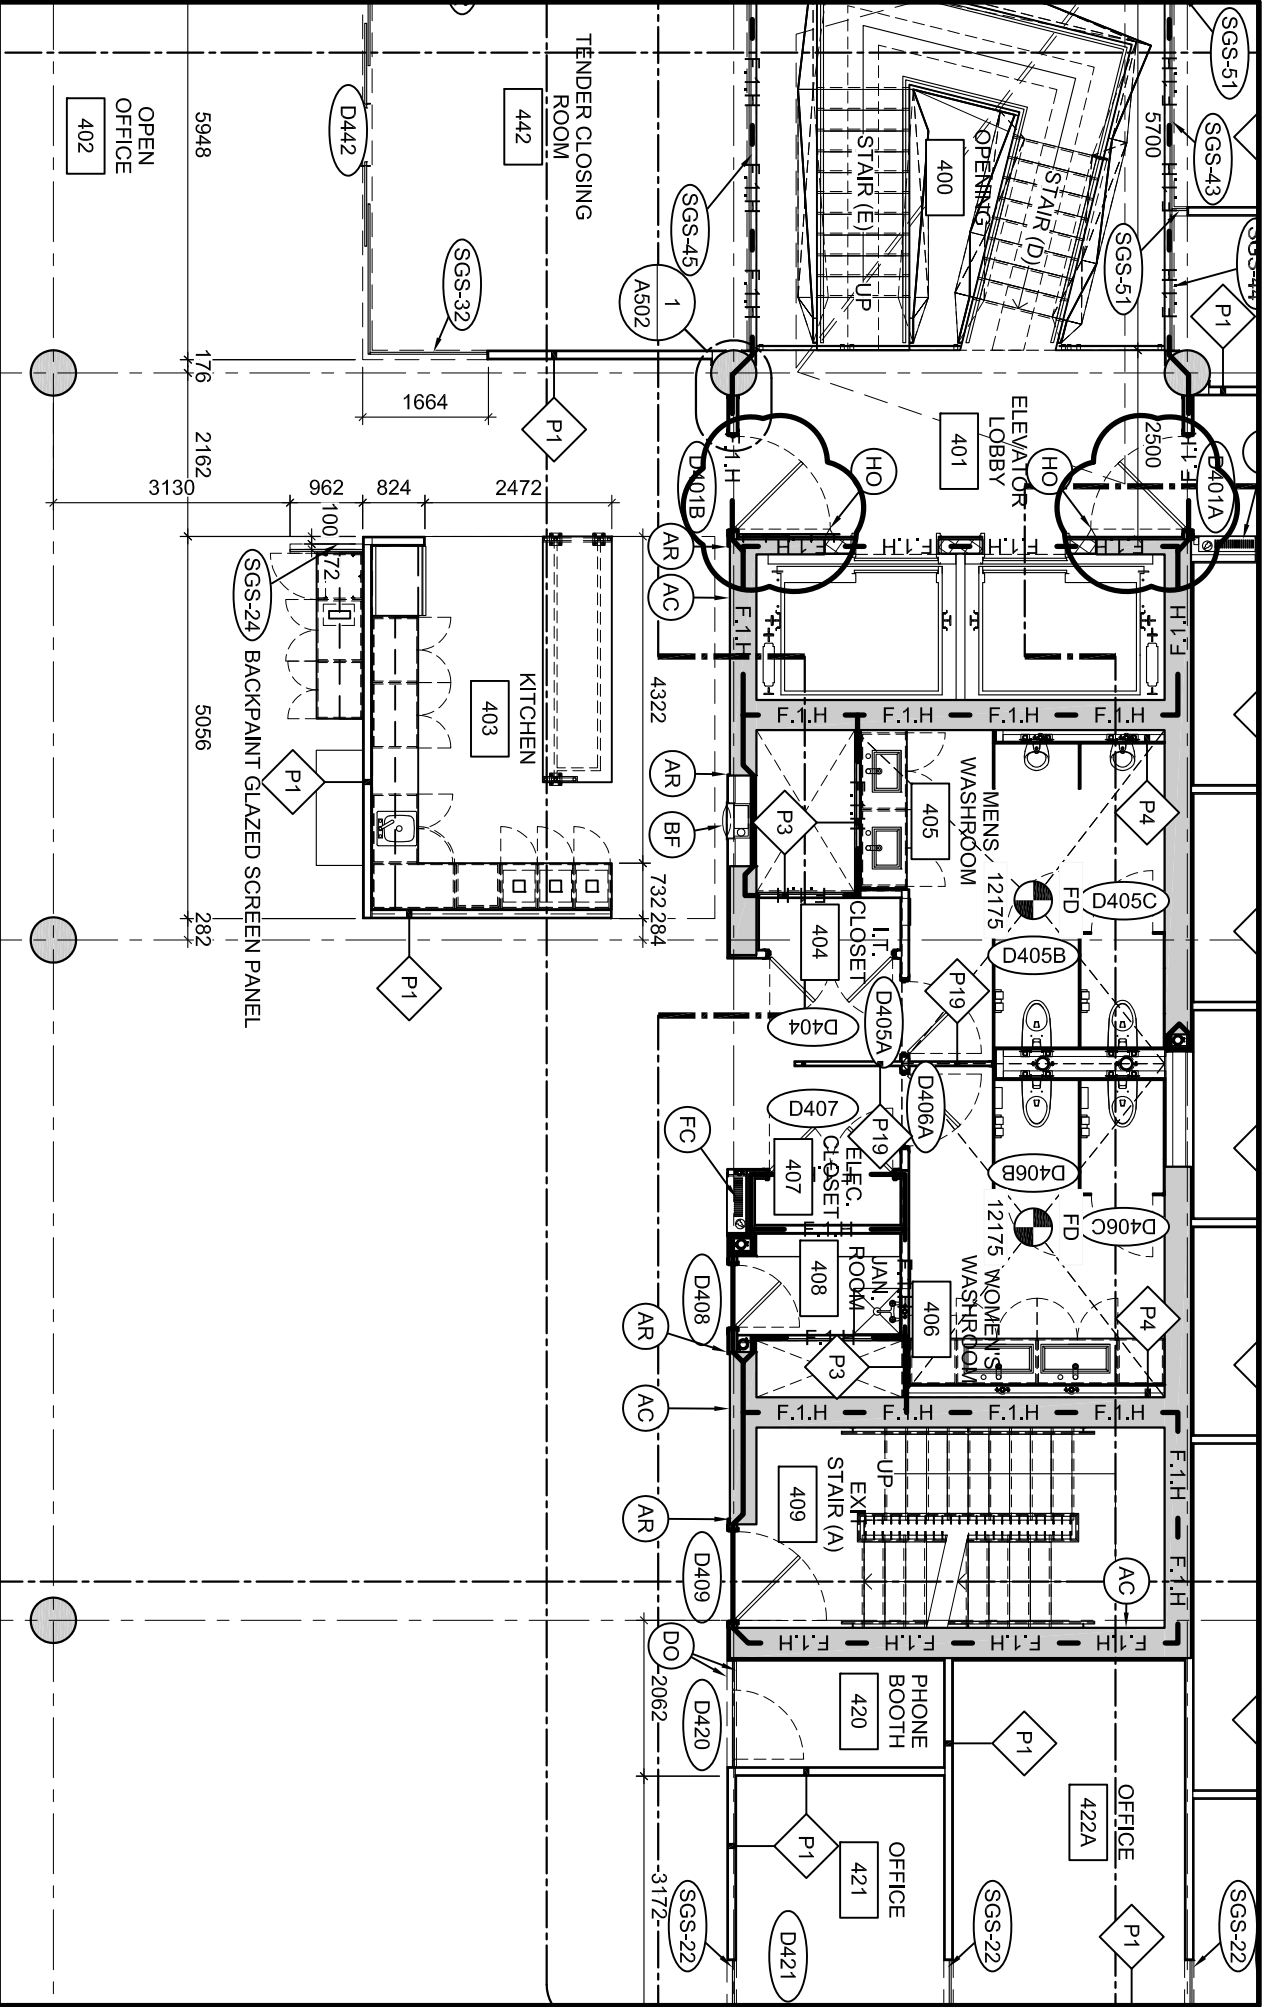

THE ANNEX/480 EGLINTON ST. OTTAWA, ON K1R6G5  
 613.567.7888 PHONE / 613.567.7528 FAX  
 csaarchitect.com



PROJECT:  
**TOMLINSON NEW BUILDING**

DRAWING TITLE:  
**REFERENCE PARTIAL PLAN 1/A104**

DATE:	12/11/2017
SCALE:	1:100
DRAWN BY:	JK
JOB No.:	574-15
DRAWING No.:	<b>ASK-213</b>