



TAL-CO SUPPLEMENTAL INSTRUCTION #84-R1			
Gym Layout			
Project Name:	RW TOMLINSON - NEW HEAD OFFICE		
Project Location:	100 CitiGate Drive, Ottawa, Ontario		
ARCH. SI #:	N/A	Issued By:	Farah Bano
STRUC. SI #:	N/A	Date Issued:	February 23, 2018
MECH. SI #:	N/A	Revision #:	1
ELEC. SI #:	N/A	Revision Date:	February 27, 2018

Supplemental Instructions are issued by the Construction Manager to record a clarification or revision to the previously issued Contract Documentation as reflected by the attached information prepared by the identified Professionals.

The Construction Manager shall review the Supplemental Instruction and the attached information and issue to the affected Trade Contractors identifying the following course of action by the Trade Contractor.

Notify TAL-CO within 5 days of receipt, if the attached documents will require a change to Contract Price or Schedule.

TITLE: Gym Layout

Reference:

Architectural Construction Update 28-Jul-2017

Attachments:

Tomlinson CORE Gym Layout


Nooga - CCN 11 - Gym Equipment Data and Power Requirements

Description of the work:


For clarification and detail


Reason:

For clarification and detail

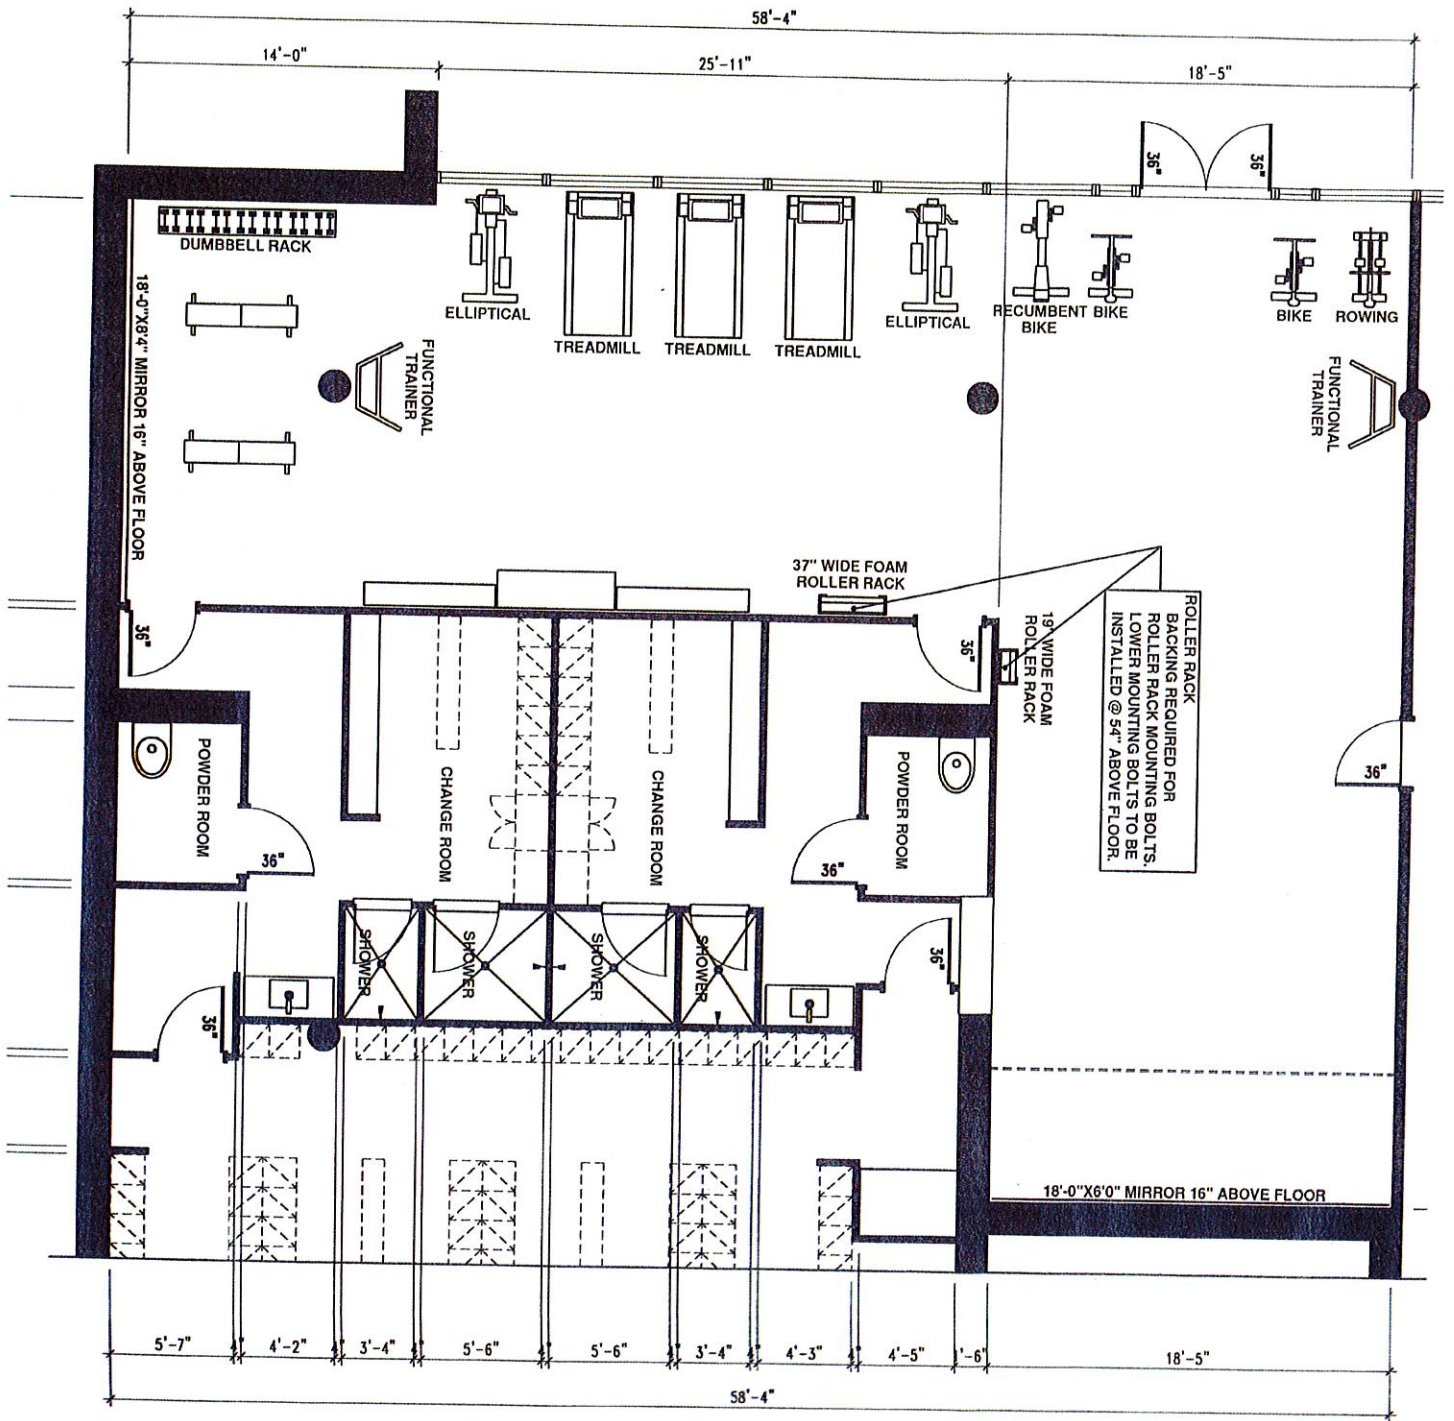


3 Treadmills
require 120v 20A
N5-20R

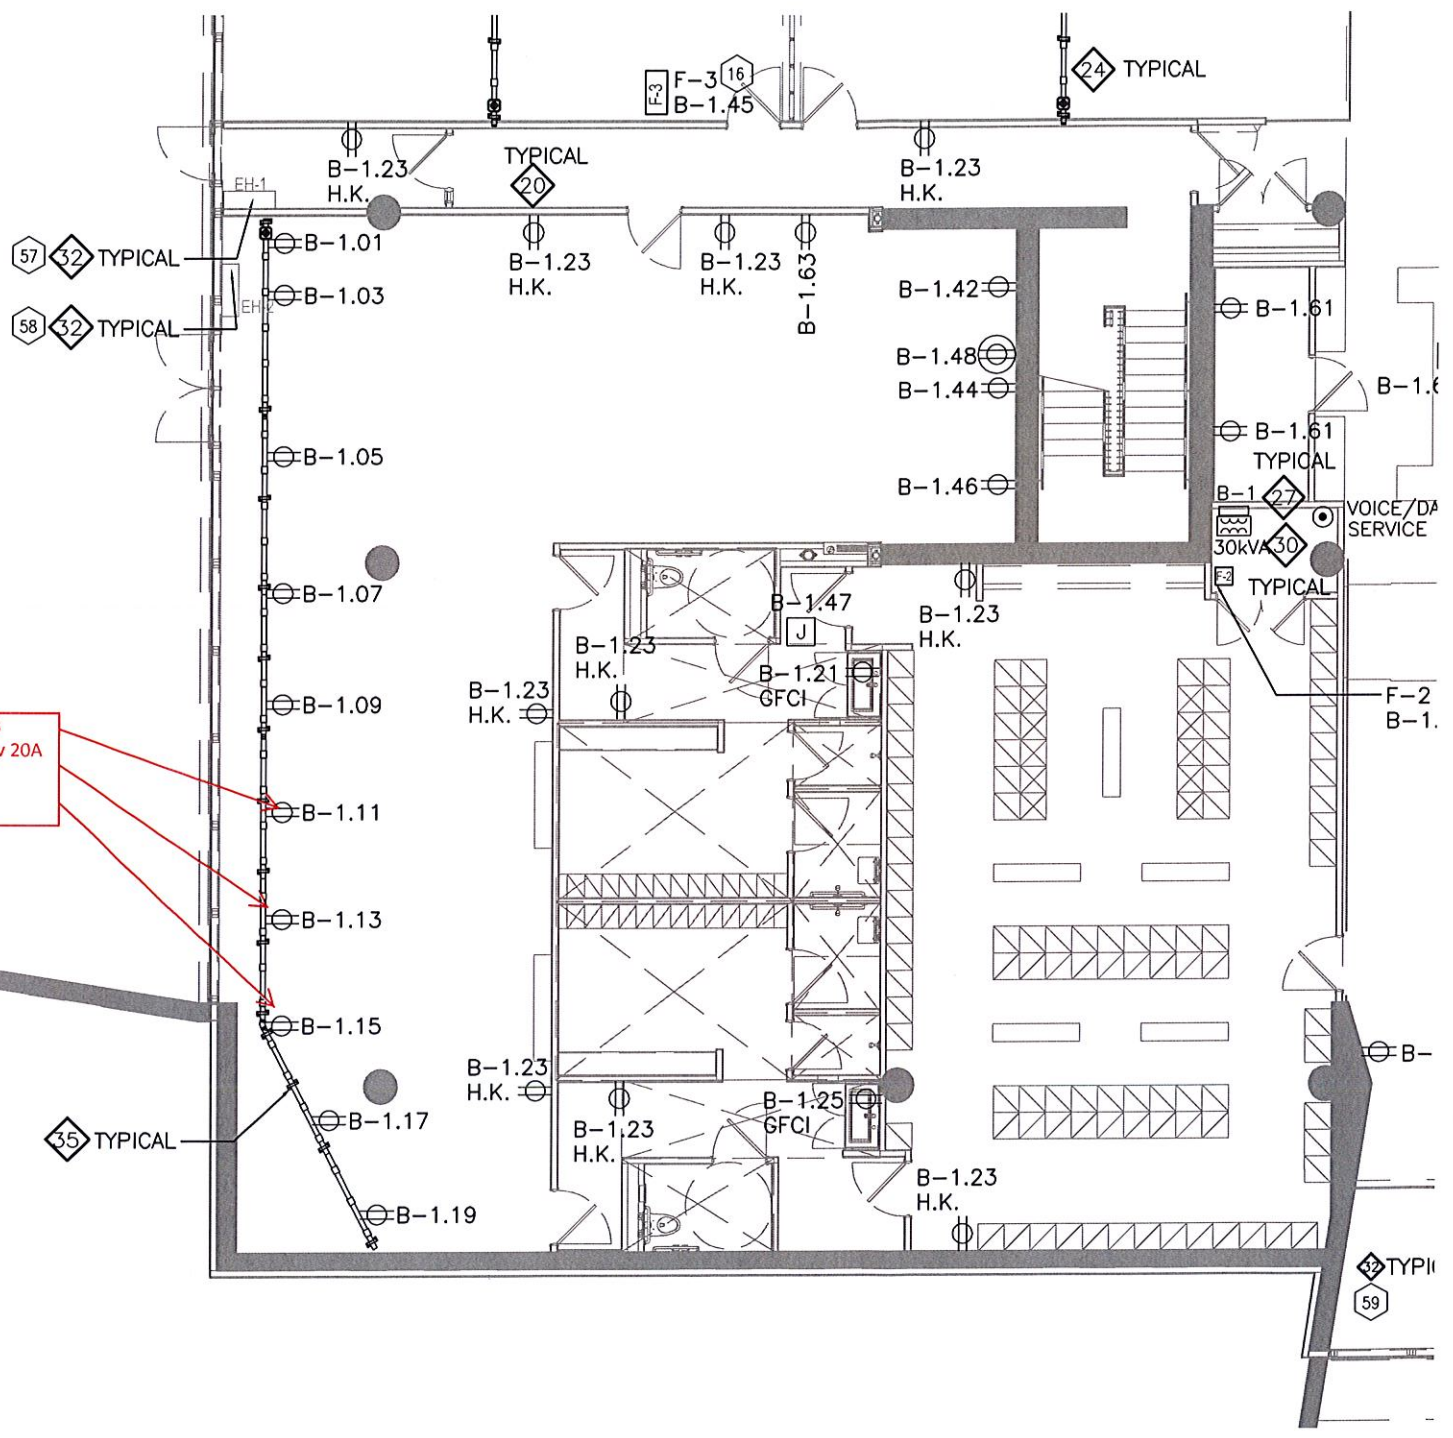

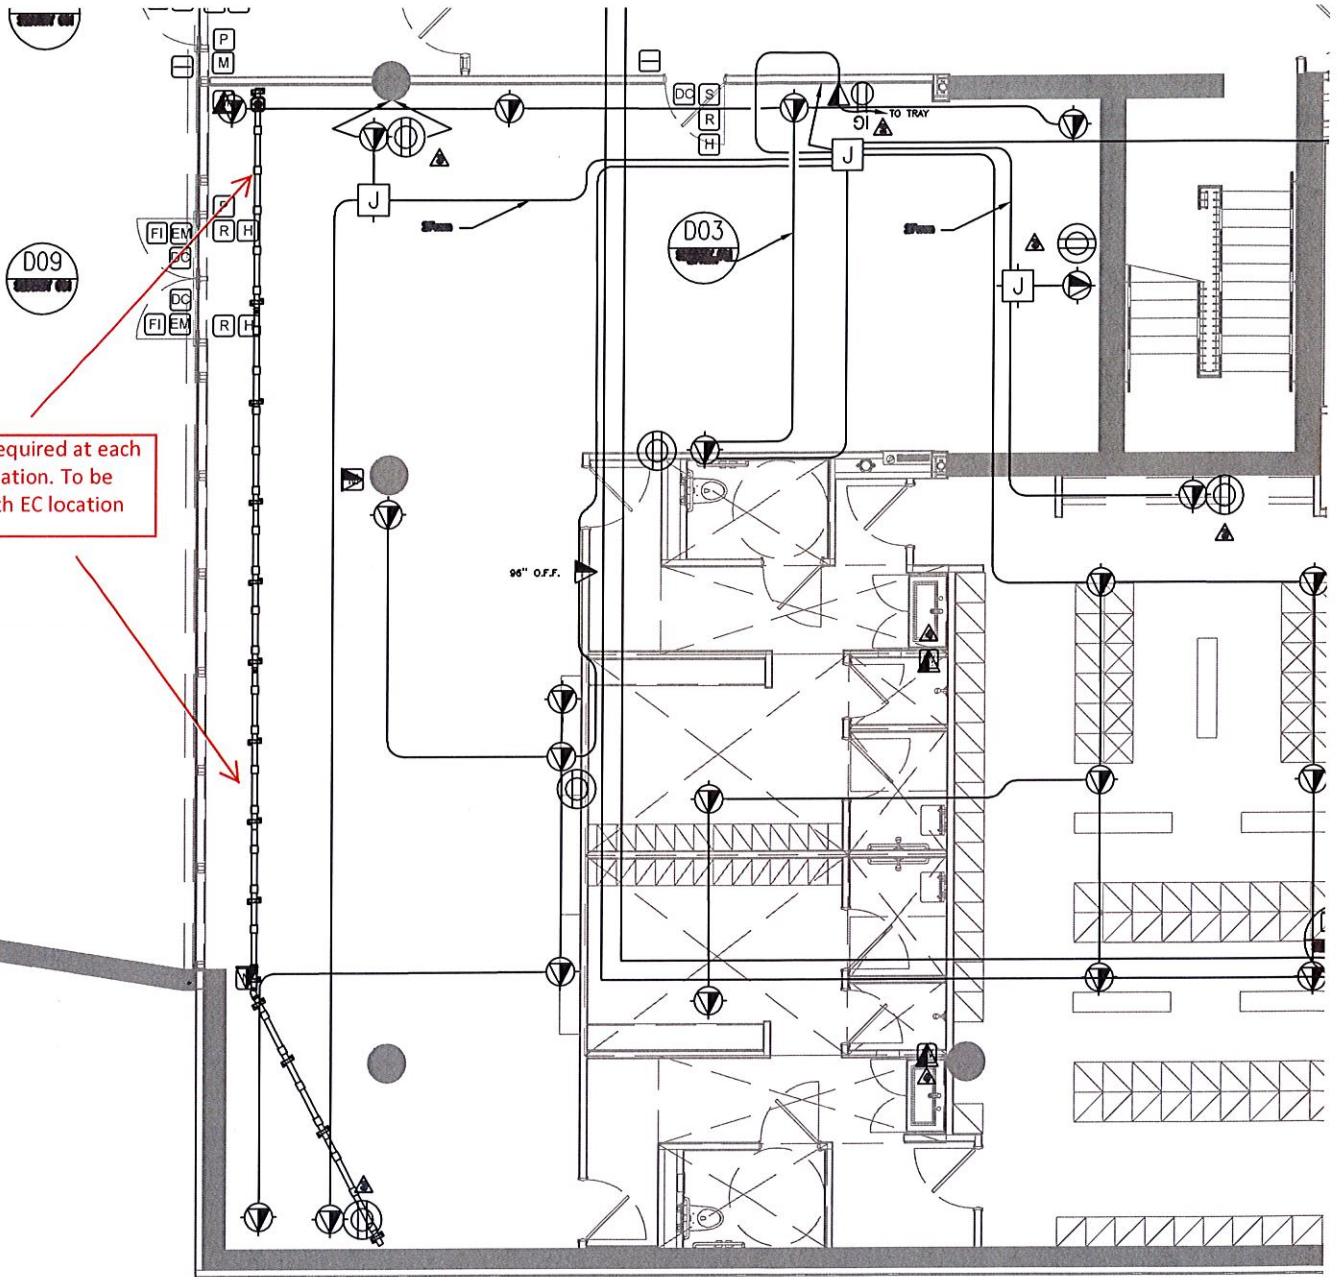

1 Data cable required at each equipment location. To be coordinate with EC location

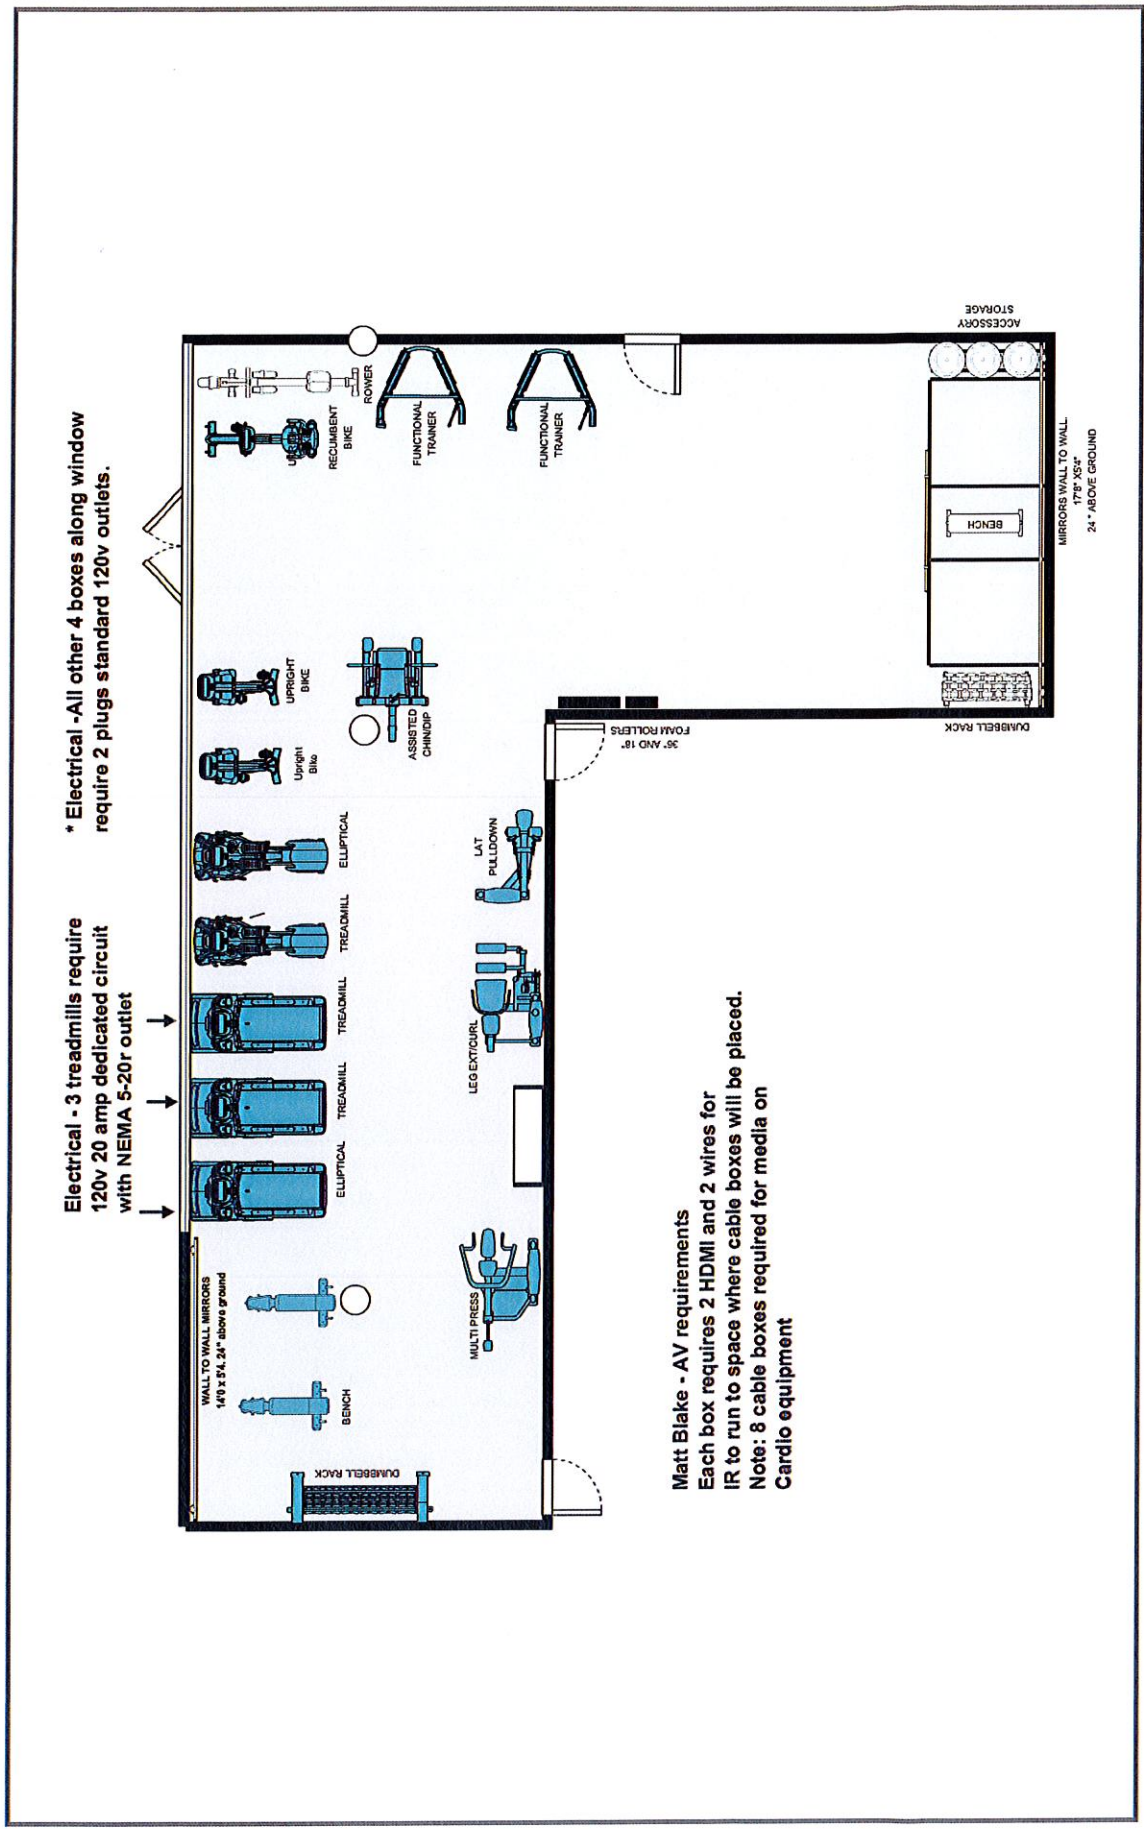

Matt Blake - AV requirements
 Each box requires 2 HDMI and 2 wires for IR to run to space where cable boxes will be placed.
 Note: 8 cable boxes required for media on Cardio equipment

powered by 2020 Icovia



Tomlinson 3- Electrical Media
 Created by Fitquest

This floor plan is a representation and should not be relied on exclusively. Measurements should be verified to ensure accuracy.

