

ROOF VENT DETAIL

ROOF DRAIN DETAIL

NEW CAST DOME STRAINER -

CLAMPING RING —

DECK CLAMP -

CAST DRAIN -

M.J. COUPLING -

24"x24" BEARING PAN ---

FLASHING 40"x40" ———

REINFORCING MEMBRANE

SLOPE RIGID INSULATION IF

INSULATE AROUND DRAIN -

INSURE INTEGRITY OF VAPOUR

BARRIER IS MAINTAINED

DRAIN WATER LEADER -

NEEDED, COORD. ON SITE -

SCALE: 1/2" = 1'-0"

- ROOF MEMBRANE

MINERAL WOOL INSUL.

6" VAPOUR BARRIER -

RETURN

O.1PARAPET

2% SLOPE

- 1/2" EXT. GRADE GYPSUM

TOWARDS DRAIN

12" STRIP OF 1/2" EXTERIOR -

GRADE PLYWOOD FOR

PARAPET SUPPORT

STEEL ANGLE, SEE ---


STRUCTURAL DOCUMENTS


STEEL BEAM, SEE -

STRUCTURAL DOCUMENTS

- 1/2" EXT. GRADE PLYWOOD

- 2"X4" WOOD STUDS @ 16" o.c.

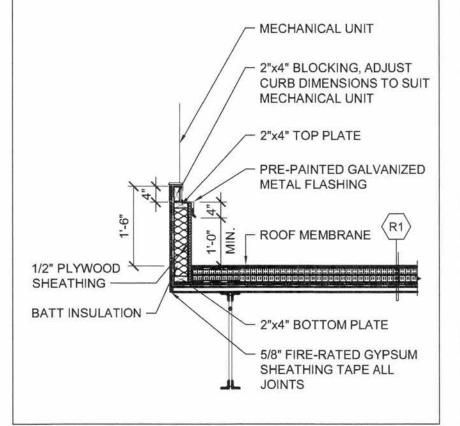

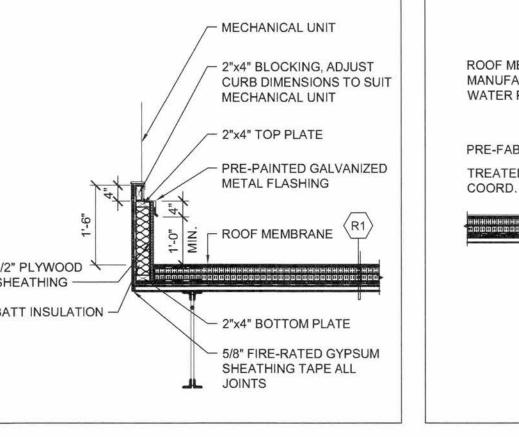

MECH. ROOF UNIT SUPPORT #1

ON BOTH SIDES

PROVIDE WOOD

- MOD-BITUMEN

SURFACED CAP

GRANULE

FLASHING

EXISTING

BEYOND


BARRIER

STRUCTURE


- SLAKE VAPOUR


SHEET

BLOCKING

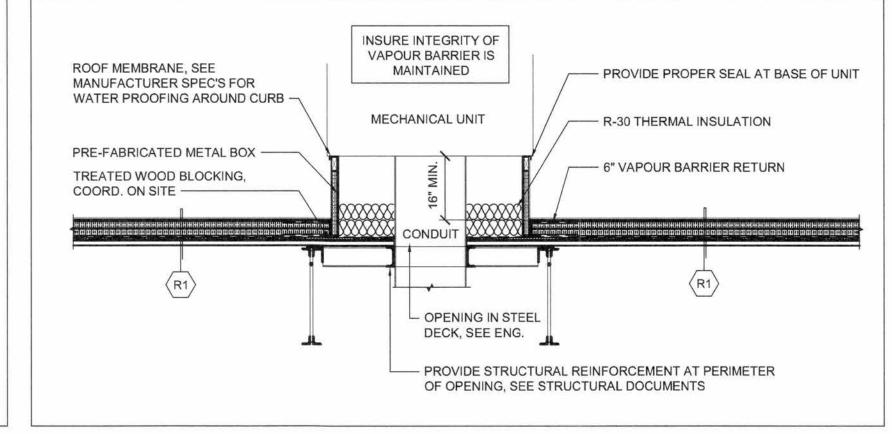

MECH. ROOF UNIT SUPPORT #2

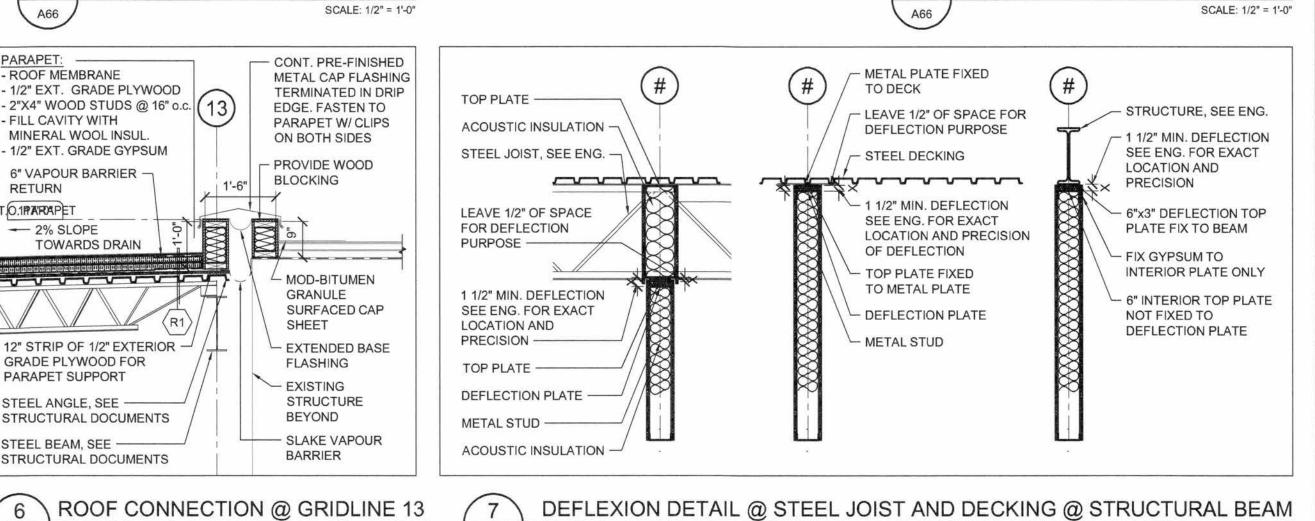

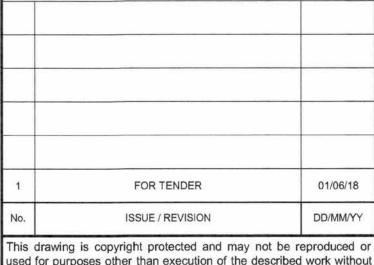

used for purposes other than execution of the described work without the express written consent of J.L. Richards & Associates Limited.

VERIFY SHEET SIZE AND SCALES. BAR TO THE RIGHT IS 1" IF THIS IS A FULL SIZE DRAWING.

écoles publiques de l'Est de l'Ontario



PAGEAU MOREL
www.pageaumorel.com
Gatineau





MAISON DE LA FRANCOPHONIE D'OTTAWA

2720 RICHMOND ROAD, OTTAWA

ENLARGED ROOF DETAILS

CHECKED: SD

RAWING #: A66 JLR #: 27672-001

