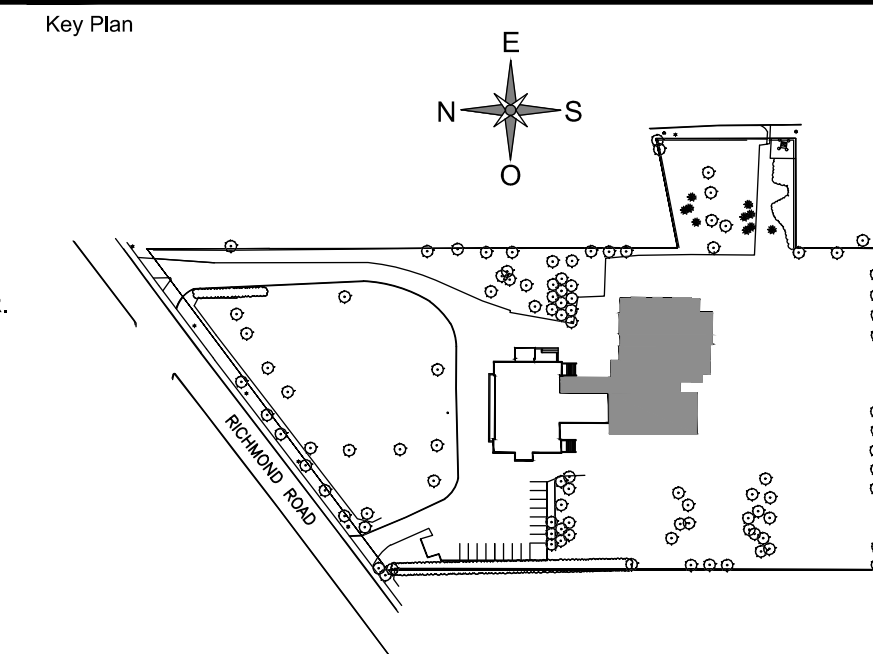


- 1- ALL SERVICES IN THE GYMNASIUM SHALL BE PROTECTED WITH A WIREGUARD. FIRE ALARM COMPONENT SHALL BE PROTECTED WITH A SOLID COVER FROM STI.
- 2- LIGHTING CONTROL:
 - IN ROOMS WITH DAYLIGHT SENSOR, FIXTURE SHALL DIM ACCORDING TO AVAILABLE DAYLIGHT.
 - IN CORRIDORS, WASHROOMS, TECHNICAL ROOMS, STORAGE AND STAIRS LIGHTING IS CONTROLLED THROUGH OCCUPANCY SENSOR. IN OTHER ROOMS, LIGHTING IS CONTROLLED THROUGH A SWITCH AND A OCCUPANCY SENSOR. (MANUAL ON/OFF)
- 3- ALL THE LIGHTING DEVICES UNDER THE HATCHED ZONE ARE SHOWN ON THE DRAWING E-101.

1 PROVIDE LOCKABLE PLASTIC COVER C

- 1 PROVIDE LOCKABLE PLASTIC COVER OVER THE LIGHT CONTROLS.
- 2 SEE GYMNASIUM LIGHTING DETAIL.
- 3 1 ON/OFF BUTTON WALL SWITCH (CONTROL ALL FIXTURES IN THE GYMNASIUM INCLUDING THE STAGE).
- 4 8 ON/OFF BUTTON WALL SWITCH. (1 BUTTON PER HORIZONTAL ROW TO POWER FULL ON AND TO POWER FULL OFF).
- 5 1 DIMMING SWITCH PER HORIZONTAL ROW AND FOR STAGE.
- 6 GYMNASIUM CONTROLLER.

[illegible]

**PAGEAU
MOREL**
www.pageaumorel.com
Gatineau

Architect



J.L. Richards
ENGINEERS · ARCHITECTS · PLANNERS
www.jlrichards.ca

Structure

Seal



Project

MAISON DE
DE LA FRANCOPHONIE D'OTTAWA
2720 RICHMOND ROAD, OTTAWA

Title
ELECTRICAL - MULTIDISCIPLINARY
GROUND FLOOR
NEW LAYOUT

Drawn by :	F.BR	Project n°:	7342-001-000
Design by :	J.RI.	Date :	2018-06-01
Verified by :	M.LE.	Scale :	1/8" = 1'-0"

Drawing n°

Revision

THIS DRAWING SHALL NOT BE USED FOR
CONSTRUCTION OR INSTALLATION
PURPOSES.

MODIFIED

E-102

0

brunel-f - 6/1/2018 12:18 - \\s-gatineau\dessin\7342 2720 Richmond\001\000\E-101&E-102\EM-M-GRD)_R00.dwg