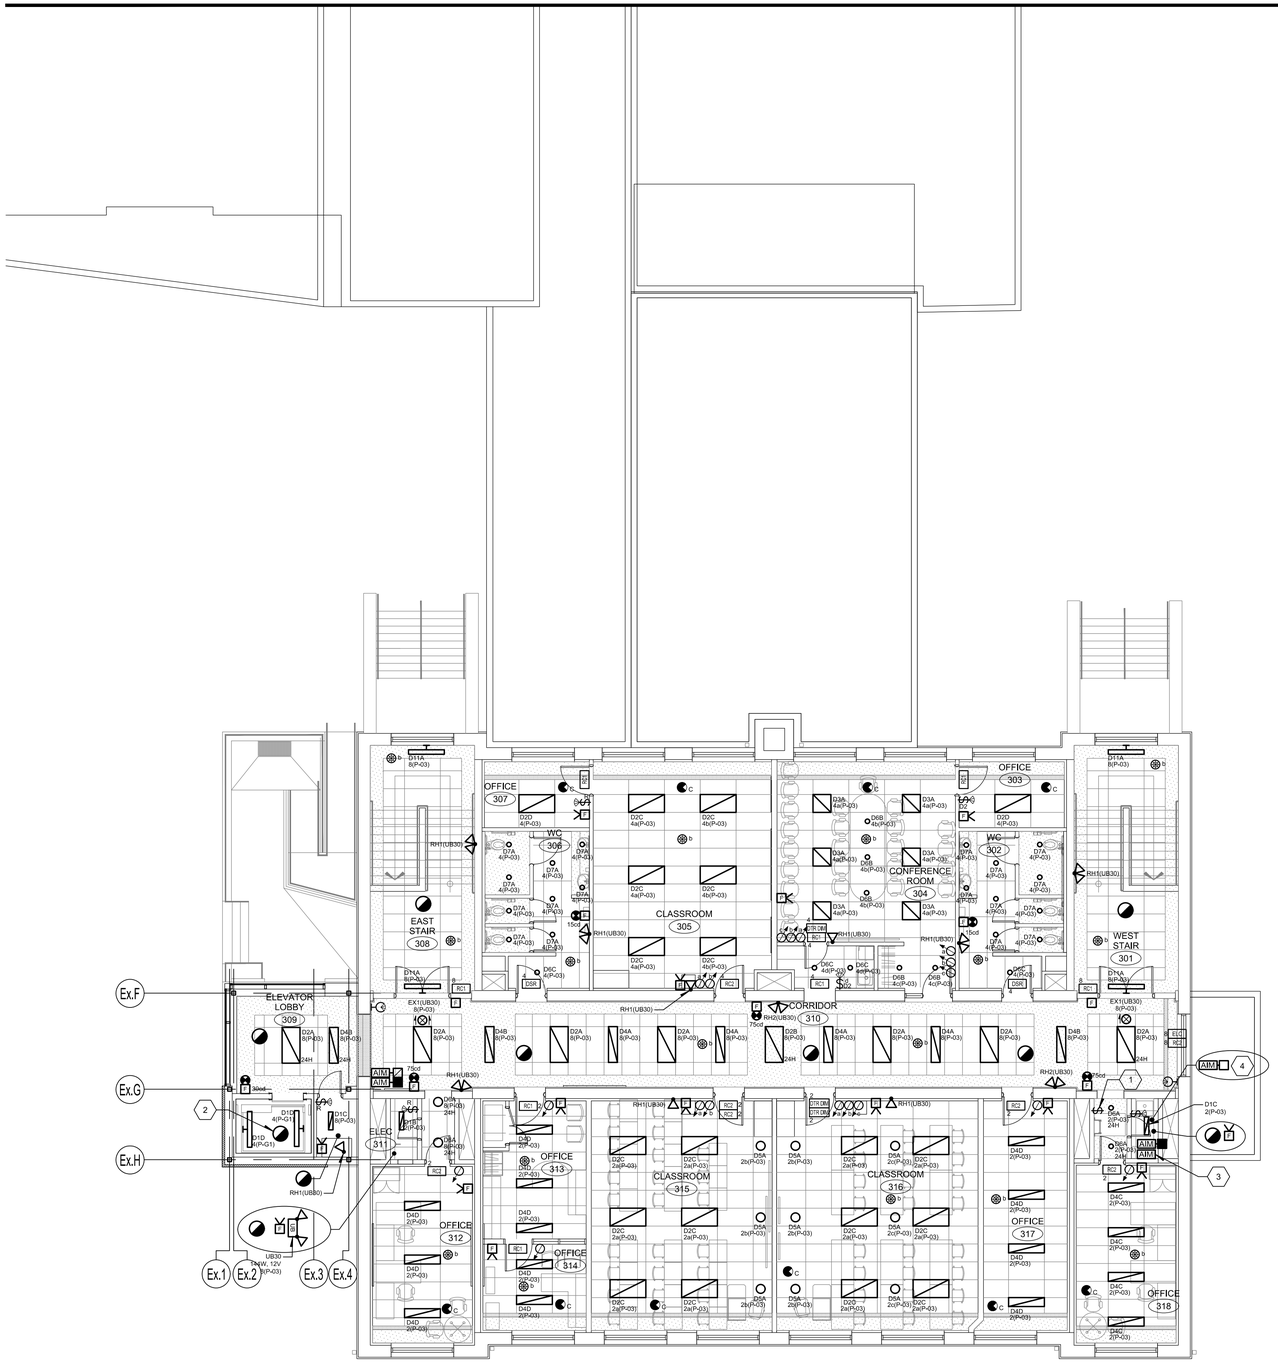


## GENERAL NOTE(S):

1- LIGHTING CONTROL:
- IN ROOMS WITH DAYLIGHT SENSOR, FIXTURE SHALL DIM ACCORDING TO AVAILABLE DAYLIGHT.
- IN CORRIDORS, WASHROOMS AND STAIRS LIGHTING IS CONTROLLED TROUGHT OCCUPANCY SENSOR.
IN TECHNICAL ROOMS, STORAGE AND OTHER ROOM LIGHTING IS CONTROLLED TROUGHT OCCUPANCY SENSOR, IN OTHER ROOMS LIGHTING IS CONTROLLED TROUGHT A SWITCH AND A OCCUPANCY SENSOR, (MANUAL ON/AUTO OFF)

## IDENTIFICATION(S):

1. SWITCH FOR ATTIC LIGHTING INSTALLED NEAR LADDER.
2. LOCATED IN THE TOP OF ELEVATOR SHAFT. INSTALL A REMOTE TEST CONNECTION IN THE LOBBY NEAR THE ROOF.
3. FOR DRY PIPE SYSTEM.
4. LOW TEMPERATURE MODULE POTTER "RTS".

Key Plan




## REVIEW

| Nº | Date | Description |
|---|---|---|
| 0 | 2018-06-01 | FOR TENDER |

PAGEAU MOREL
www.pageaumorel.com
Gatineau

Architect
J.L.Richards
ENGINEERS · ARCHITECTS · PLANNERS
www.jlrichards.ca

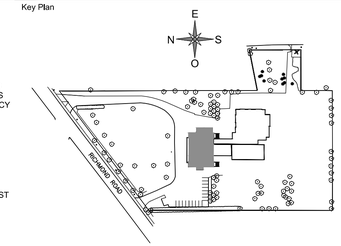Structure

Seal
LICENSED PROFESSIONAL ENGINEER
M.A.J. LECLERC
100155045
PROVINCE OF ONTARIO
2018-06-01

Project
MAISON DE
DE LA FRANCOPHONIE D`OTTAWA
2720 RICHMOND ROAD, OTTAWA

Title
ELECTRICAL - MULTIDISCIPLINARY
THIRD FLOOR
NEW LAYOUT

| | | | |
|---|---|---|---|
| Drawn by : | F.BR. | Project nº: | 7342-001-000 |
| Design by : | J.RI. | Date : | 2018-06-01 |
| Verified by : | M.L.E. | Scale : | 1/8" = 1'-0" |

Drawing nº E-104 | Revision 0

THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION OR INSTALLATION PURPOSES.

**MODIFIED**

bisscon - 6/1/2018 11:15 - \\ej-gatineau\Dessin\7342 2720 Richmond\001\0000E-104(EM&A-SRD)_R00.dwg