
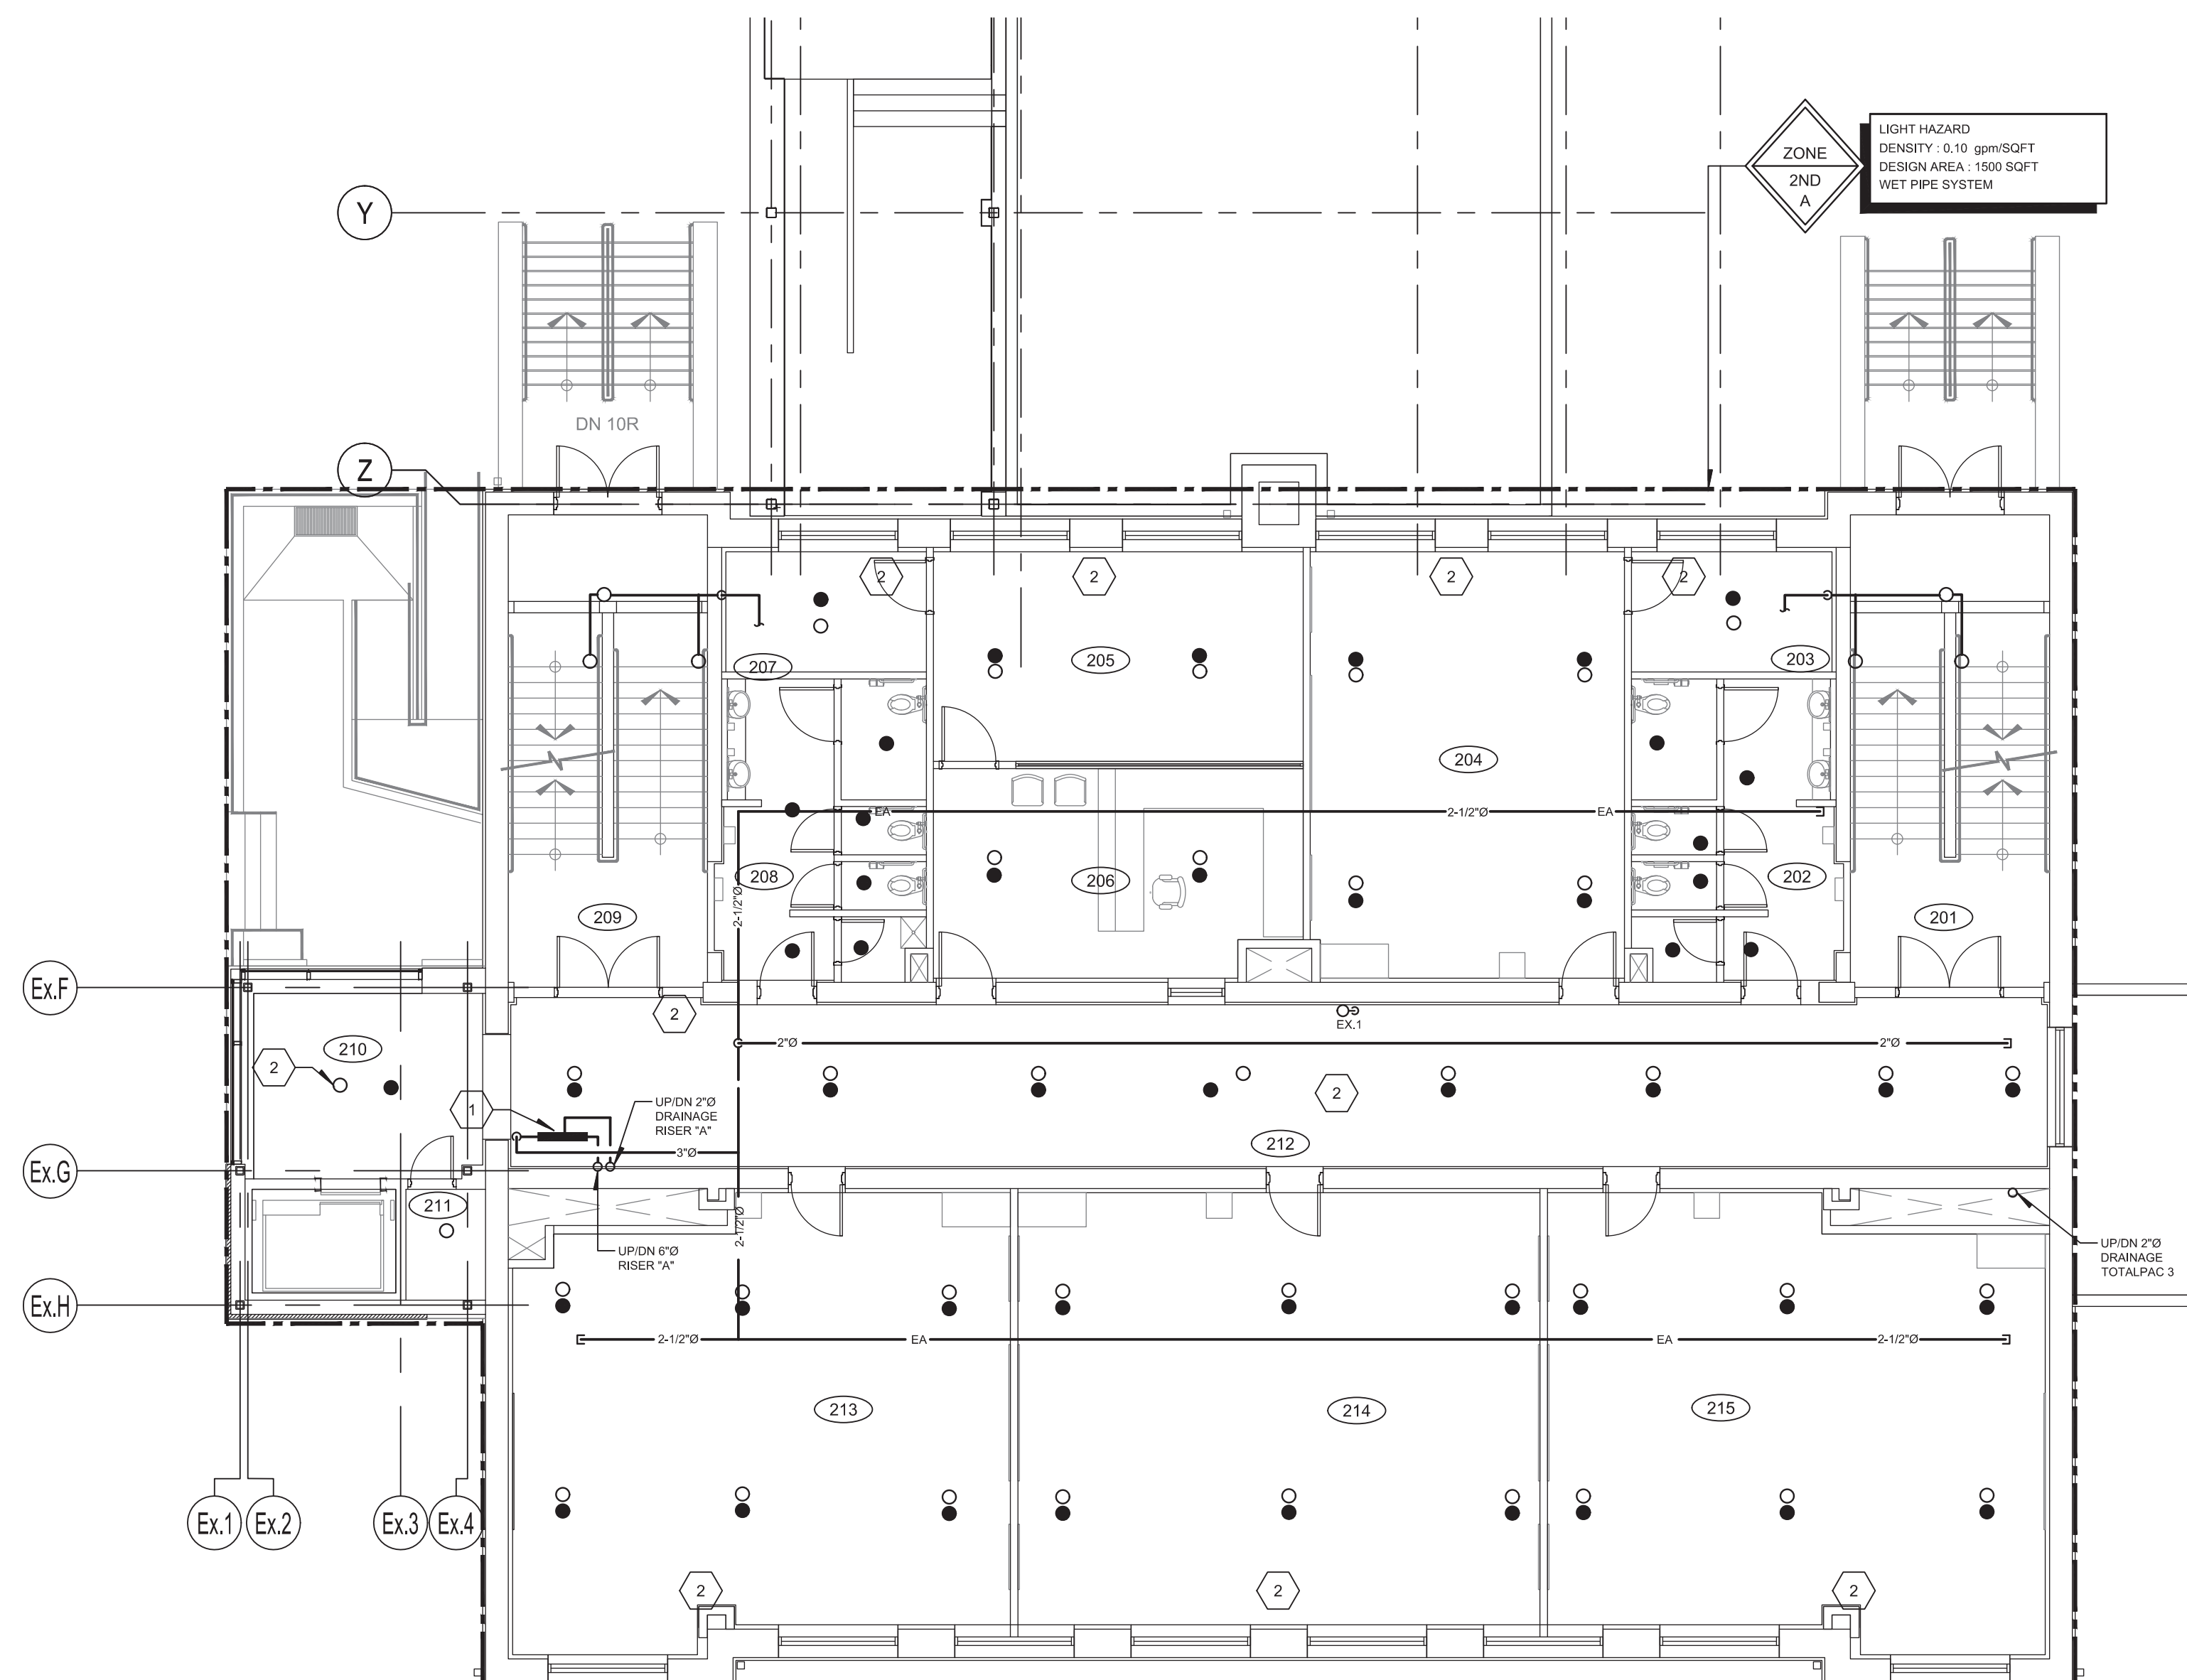


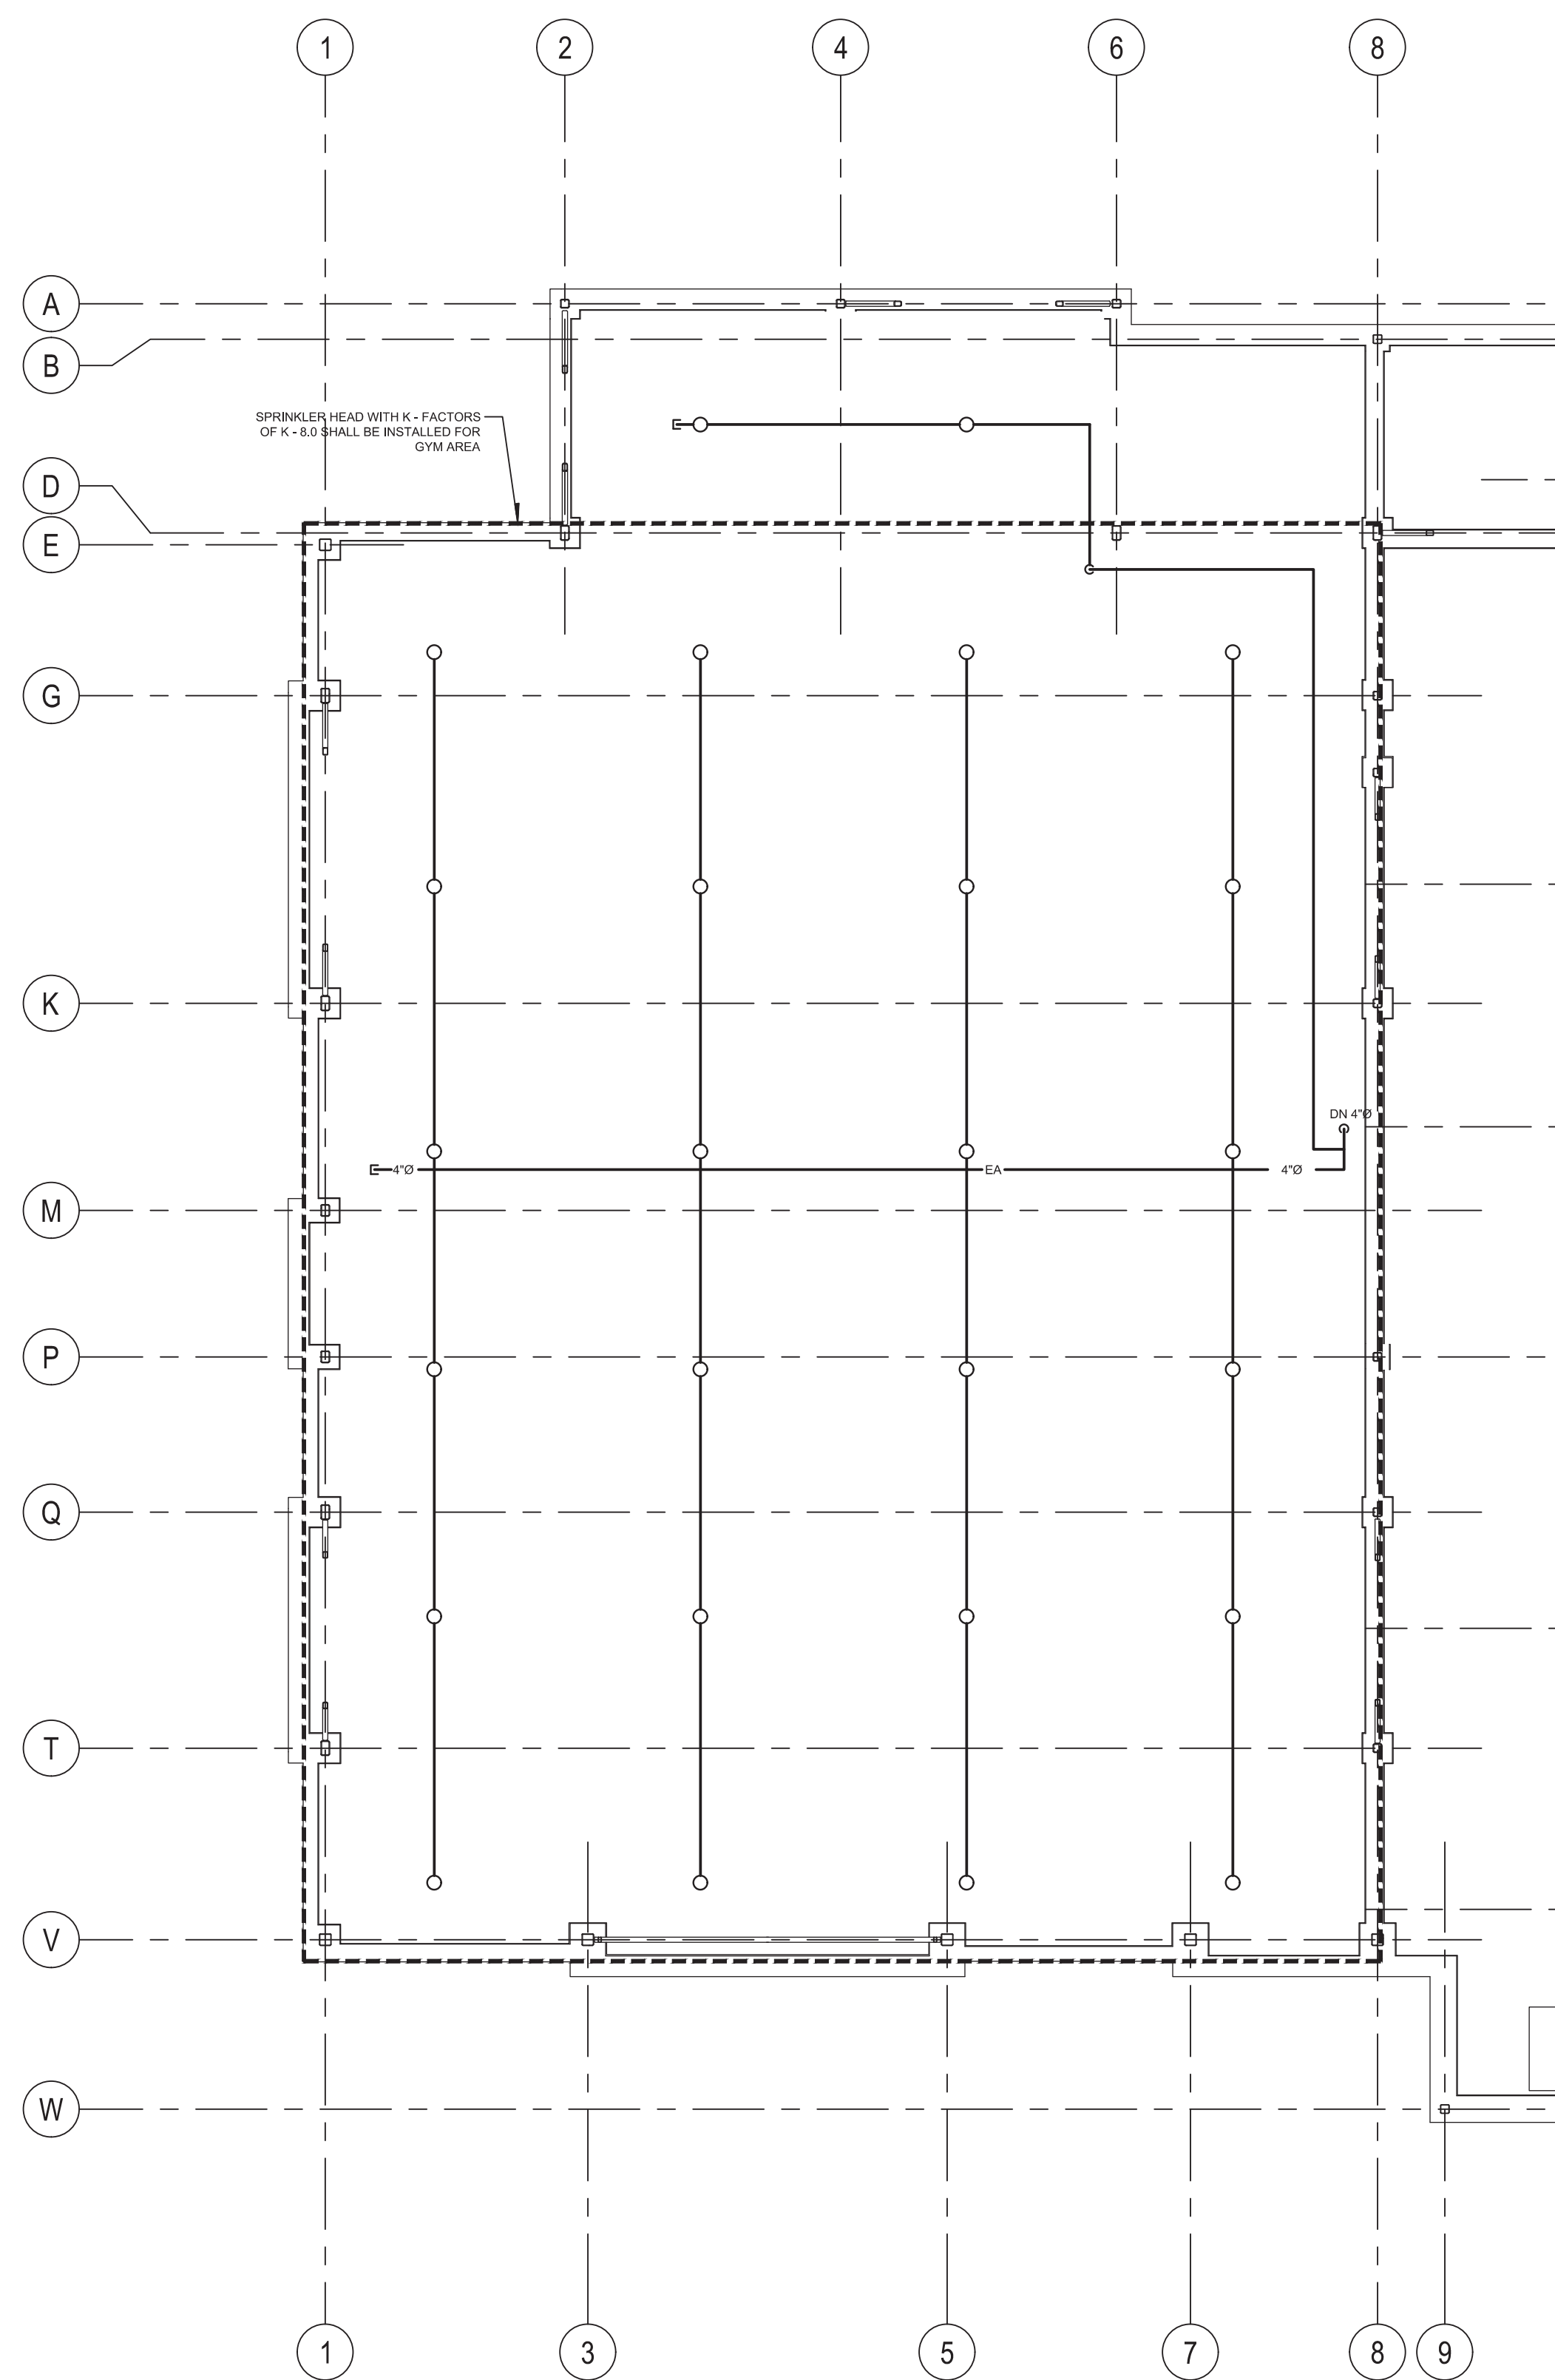


GENERAL NOTE(S) :

1. PERFORMANCE BASED SPECIFICATIONS.  
THIS DRAWING IS PRESENTED AS ADDITIONAL DESIGN CRITERIA.
2. UNLESS INDICATED OTHERWISE ALL THE SPRINKLERS SHALL BE STANDARD K  
FACTORY OF 5.6. REFER TO ELEMOTRANICAL SPECIFICATIONS SECTION  
21 10 00 FOR SPRINKLER HEAD REQUIREMENTS.
3. SPRINKLERS OF INTERMEDIATE - AND HIGH-TEMPERATURE RATINGS SHALL  
BE INSTALLED IN SPECIFIED LOCATIONS AS REQUIRED BY THE NFPA 13 - 8.3.2.  
THE TEMPERATURE ZONE SHALL BE DETERMINED ON SITE WHEN THE FINAL  
LOCATION OF THE UNIT HEATER IS CONFIRMED.
4. IN AREAS IMMEDIATELY ABOVE EQUIPMENT THAT PRODUCES LARGE AMOUNTS OF  
HEAT AND HIGH TEMPERATURES, SPRINKLERS OF HIGH TEMPERATURE ZONE  
EXCEED 100° (38° C), SPRINKLERS WITH TEMPERATURE RATINGS IN ACCORDANCE  
WITH THE MAXIMUM CEILING TEMPERATURES OF TABLE 6.2.5.1 OF NFPA 13 SHALL BE  
USED.
5. THE SPRINKLERS INSTALLED IN HORIZONTAL COMBUSTIBLE CONCEALED  
SPACES WHERE THE DEPTH OF THE SPACE IS LESS THAN 36 in. (900 mm)  
FROM DECK TO CEILING, SHALL BE LISTED FOR SUCH USE.
6. DO NOT TAKE SCALE MEASUREMENT ON DRAWINGS, THE CONTRACTOR IS  
RESPONSIBLE FOR PERFORMING DIMENSIONAL AUDITS APPEARING ON THE  
DRAWINGS AND THE SITE CONDITIONS IN ORDER TO VERIFY THE ACCURACY.

IDENTIFICATION(S):

- 1 FLOOR FLOW CONTROL & TEST STATION. SEE DETAIL FOR ACCESSORIES TO BE INSTALLED.
- 2 OPEN GRID ON PERIMETER OF T-BAR CEILING. PROVIDE UPRIGHT SPRINKLER HEADS ABOVE CEILING GRID AT SLAB LEVEL & PENDANT SPRINKLERS UNDER THE GRID FOR FLOOR COVERAGE.

### Key Plan

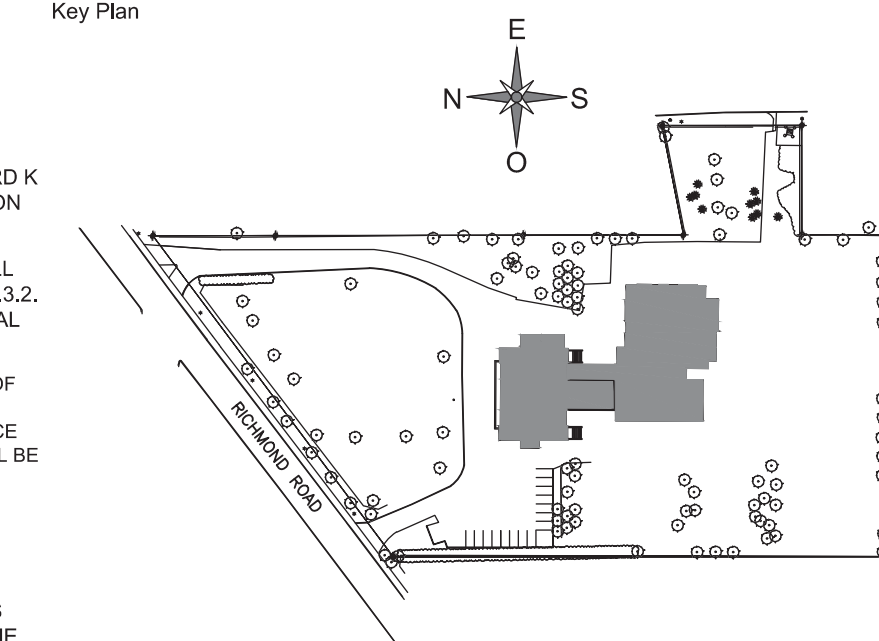

 REVIEW

| Nº | Date       | Description |
|----|------------|-------------|
| 0  | 2018-06-01 | FOR TENDER  |



Architect



## Structure

Seal



Project

MAISON DE  
DE LA FRANCOPHONIE D'OTTAWA  
2720 RICHMOND ROAD, OTTAWA

Title

MECHANICAL  
FIRE PROTECTION  
SECOND FLOOR NEW LAYOUT

Drawn by : B. TREMBLAY      Project n° : 7342-001-000

Design by : B. TREMBLAY      Date : 2018-06-01

Verified by : F. DIONNE                      Scale :              1/8" = 1'-0"

Drawing n°

Revision

M-103

0