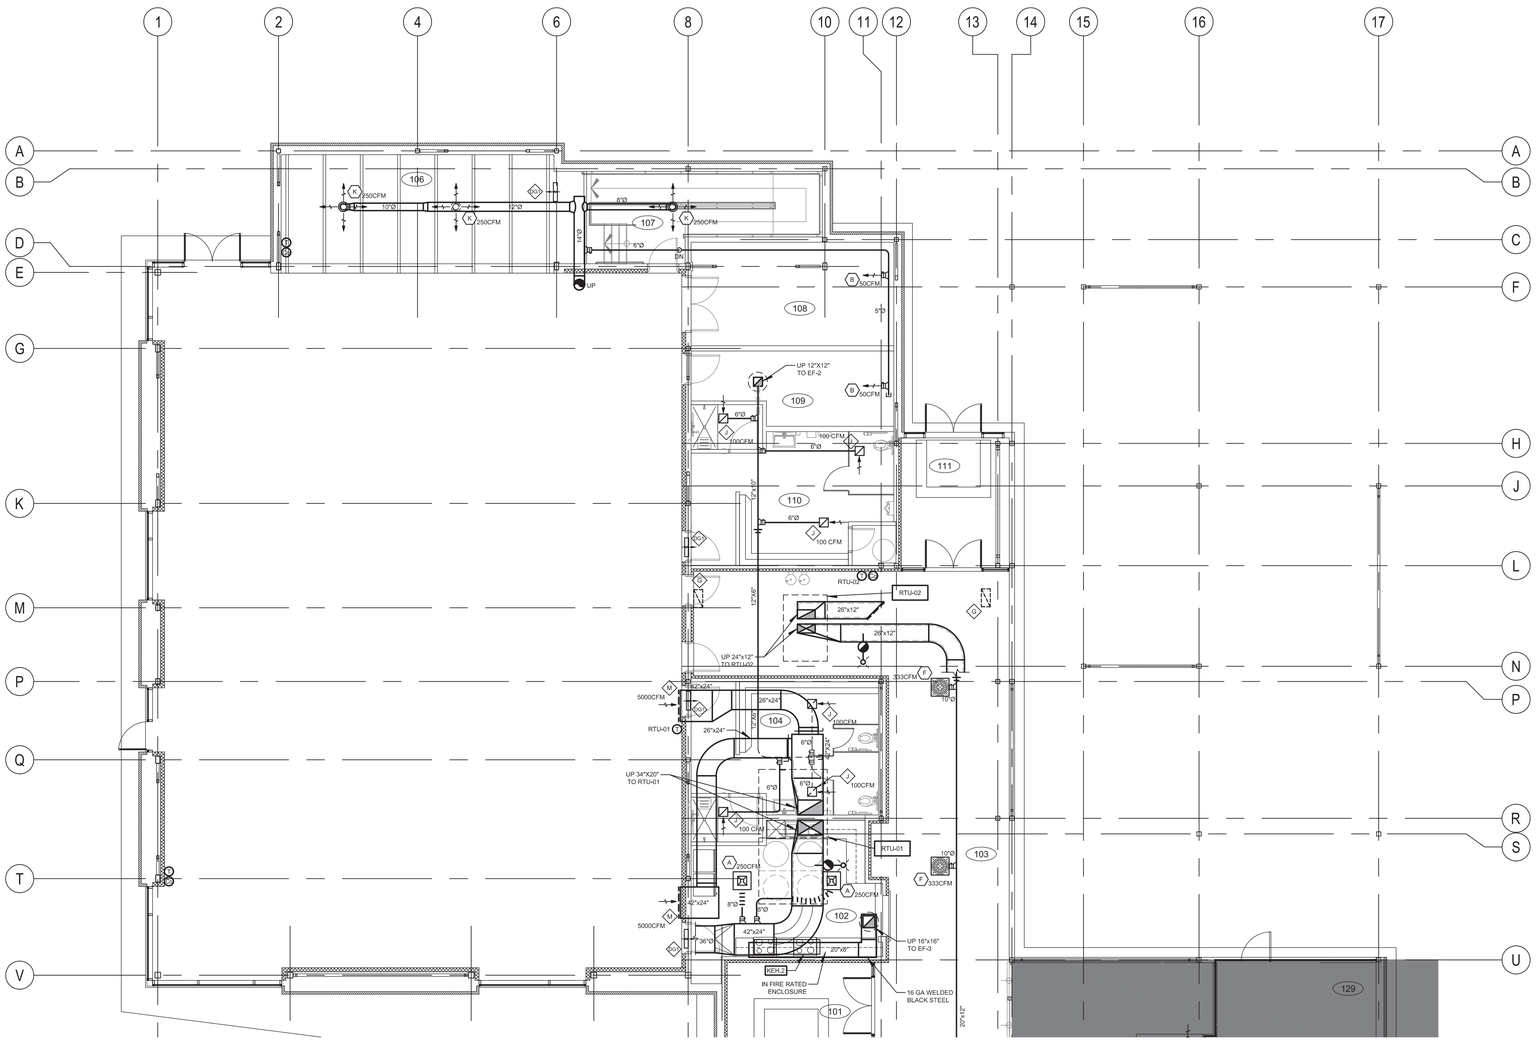


GROUND FLOOR - SOUTH

## GENERAL NOTE(S):

1- PROVIDE FOR AND INSTALL ACOUSTIC INSULATION IN ALL CONDUITS AFTER V.A.V. BOXES, ON SUPPLY AND RETURN AIR CONDUITS, TYPICAL FOR ALL FLOORS.

2- SEE SCHEDULES ON M-410 FOR EQUIPMENT DESCRIPTION. DETAILS ON M-411.

3- ALL FIRE DAMPERS ARE TYPE "B", UNLESS OTHERWISE NOTED.

## IDENTIFICATION(S):

1. OPENINGS REQUIRED IN EXISTING CONCRETE OR BLOCK WALL FOR PASSAGE OF NEW CONDUITS.
2. MAIN CONTROL PANEL FOR ALL CONDENSORS. SEE DIAGRAM ON M-501. FINAL POSITION TO BE COORDINATED ON SITE WITH OTHER TRADES.
3. MAIN CONTROL PANEL FOR MAKE UP AIR UNIT MUA-001-002. FINAL POSITION TO BE COORDINATED ON SITE WITH OTHER TRADES.
4. PROVIDE A SECTION OF THERMALLY INSULATED CONDUIT C/W INSULATED MOTORIZED DAMPER AND ACTUATOR. (SEE CONTROL DIAGRAM ON M-500)
5. PROVIDE AND INSTALL A FIRE DAMPER TYPE "A".
7. EQUIPMENT INSTALLED ON NEW 6" HIGH HOUSEKEEPING PAD. BY GENERAL CONTRACTOR.
8. DRAIN PAN FOR STEAM DISTRIBUTOR. NO ACOUSTIC INSULATION IN THIS SECTION.

Key Plan




## REVIEW

| N° | Date | Description |
|---|---|---|
| 0 | 2018-06-01 | FOR TENDER |

PAGEAU MOREL
www.pageaumorel.com
Gatineau

Architect

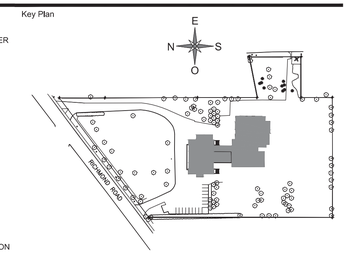J.L.Richards
ENGINEERS • ARCHITECTS • PLANNERS
www.jlrichards.ca

Structure

Seal

LICENSED PROFESSIONAL ENGINEER
J. DE GRACE
100136111
PROVINCE OF ONTARIO

2018-06-01

Project

MAISON DE
DE LA FRANCOPHONIE D`OTTAWA

2720 RICHMOND ROAD, OTTAWA

Title

MECHANICAL
VENTILATION
GROUND FLOOR NEW LAYOUT

| | | | |
|---|---|---|---|
| Drawn by : | B. TREMBLAY | Project n°: | 7342-001-000 |
| Design by : | B. TREMBLAY | Date : | 2018-06-01 |
| Verified by : | F. DIONNE | Scale : | 1/8" = 1'-0" |

Drawing n° M-402

Revision 0

dateschers - 5/31/2018 4:25 - O:\7342 2720 Richmond\001\000\M-401 & 402\M-M-GRD_(R0).dwg