



SUPPLEMENTAL INSTRUCTION

CONTRACTOR:
Tal-Co Building Innovations
4728 Bank Street, Suite A
Ottawa, ON, K1T 3W7
Attention: Farah Bano

PROJ.: Turnbull School
Music Room Addition
PROJ. No.: 1705
DATE: March 11, 2019
S.I. No. S.I. - 017

Supplemental Instructions are issued only for the purpose of recording any clarification or interpretation of the contract documents or giving direction on problems resulting from field conditions. These instructions are subject to the provisions of the contract documents and unless stated herein and specifically co-authorized by the Client, will not affect the contract. Should the Contractor require a change in the contract price or project schedule, he shall submit to the Architect within ten (10) days of the date hereof, an itemized proposal. If the proposal is accepted by the Client, this Supplemental Instruction will be superseded by a Change order.

Partners

Barry J. Hobin
OAA, FRAIC, Hon. Fellow AIA

William A. Davis
OAA, MRAIC, Associate AIA

Gordon Lorimer
OAA, FRAIC, Associate AIA

Wendy Brawley
OAA, MRAIC, Associate AIA

Douglas Brooks
Senior Arch. Tech.

Directors

Marc Thivierge
OAA, MRAIC

Reinhard Vogel
Senior Arch. Tech.

Associates

Bryan Bonell
OAA, MRAIC, Associate AIA

William Ritcey
MRAIC

Dan Henhoeffler
Senior Arch. Tech.

Hobin Architecture Incorporated

63 Pamilla Street
Ottawa, Ontario
Canada K1S 3K7

t 613-238-7200
f 613-235-2005

hobinarc.com

1.1 TITLE

Vent Pipe Location

1.2 REFERENCE

N/A

1.3 DESCRIPTION OF THE WORK

1. Refer to the attached Architectural Sketch SI-017.01 for location of the vent pipe. To be within bulkhead of the Music Room and ceilings of the Practice Rooms and Office. Vent out to be minimum 3.5 meters away from operable window and minimum 2.0 meters away from the RTU.

1.4 ATTACHMENTS


SI-017.01

1.5 REASON

Clarification

Distribution:

- | | | | | |
|--|--|-------------------------------------|----------------------------------|--------------------------------------|
| <input checked="" type="checkbox"/> Owner | <input type="checkbox"/> City Authority | <input type="checkbox"/> Electrical | <input type="checkbox"/> Struct. | <input type="checkbox"/> Landscaping |
| <input checked="" type="checkbox"/> Contractor | <input checked="" type="checkbox"/> File | <input type="checkbox"/> Mech. | <input type="checkbox"/> Civil | <input type="checkbox"/> Other |

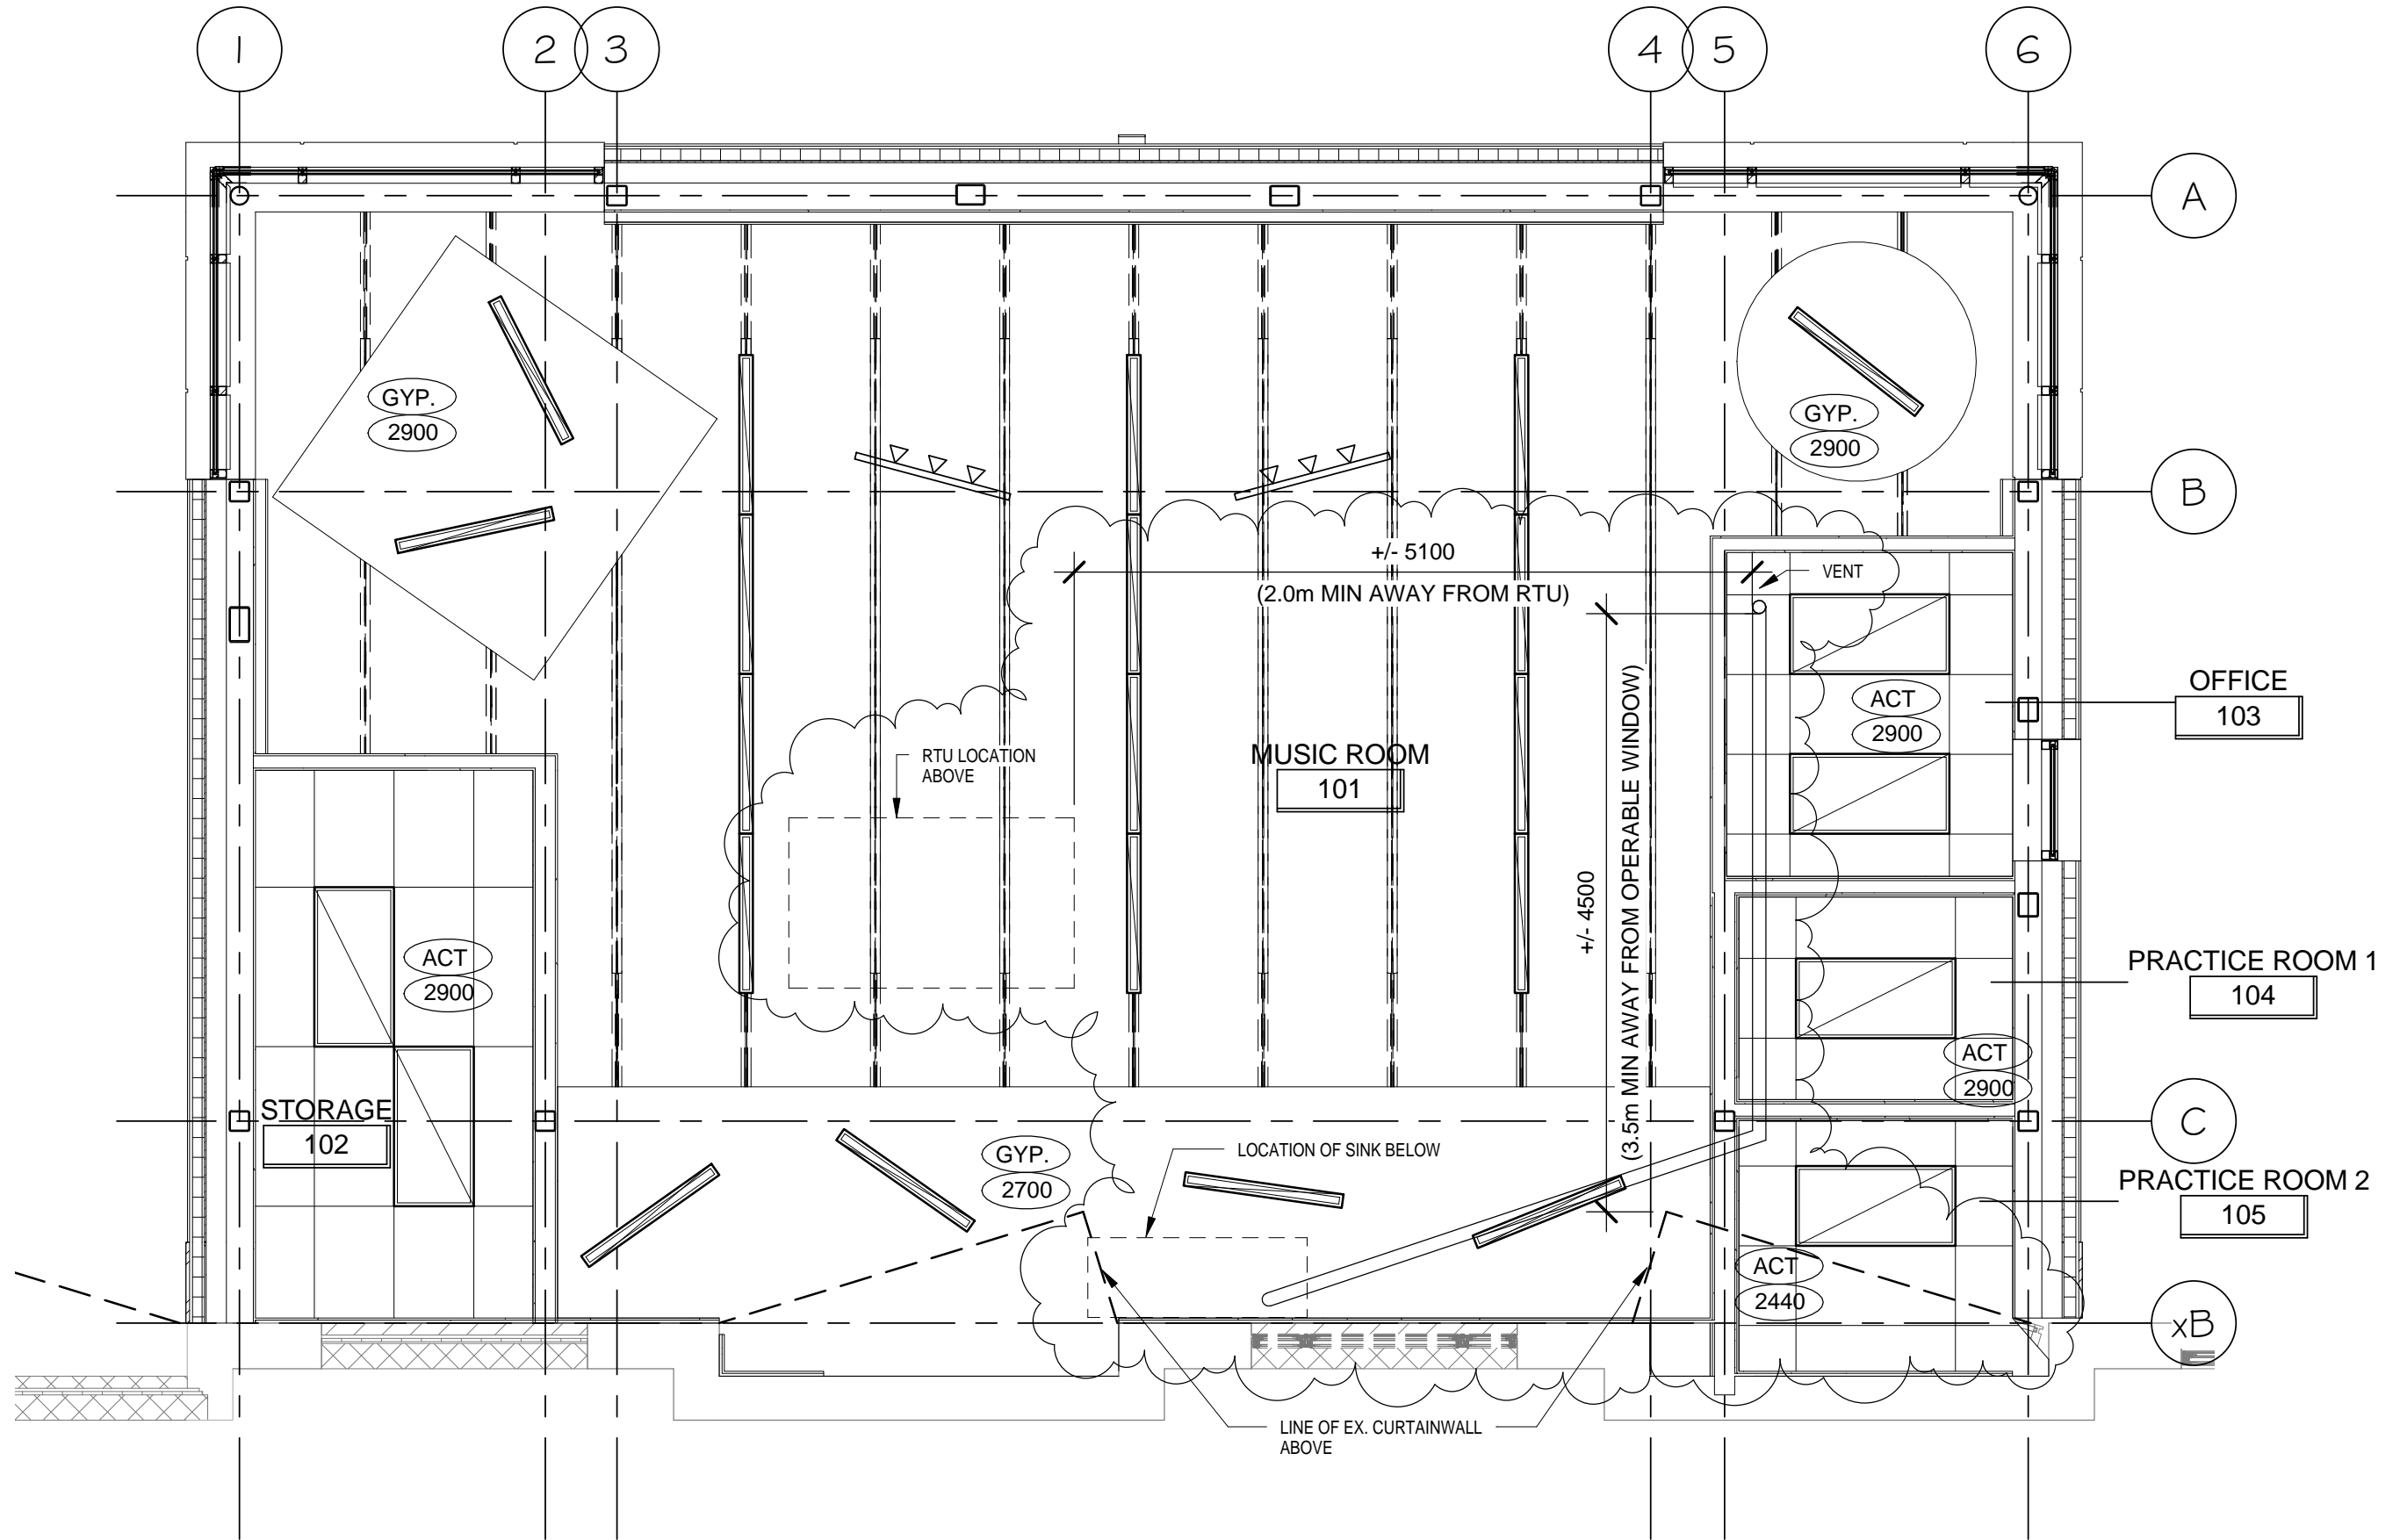

1 SI-017 VENT LOCATION
 SI-017.01 SCALE: 1 : 50

PROJECT/LOCATION: TURNBULL SCHOOL MUSIC ROOM ADDITION 1132 FISHER AVE. OTTAWA, ON	DATE: 03/11/19	SCALE: 1 : 50	PROJECT NO.: 1705	ASK No. SI-017.01
DRAWING NAME: VENT LOCATION				
Hobin Architecture Incorporated 63 Pamilla Street Ottawa, ON K1S 3K7 T: 613-238-7200 F: 613-235-2005 E: mail@hobinarc.com hobinarc.com				
