

SUBMITTAL

Job: Meridian Place Community Centre

Spec Section No:

Submittal No: 0

Revision No: 0

Sent Date: July 22, 2019


Spec Section Title: Extra PO 19-0459

Submittal Title: Stormproof louvers

Contractor:

Optimum Mechanical
Supplier: Walmar

Contractor's Stamp

Project Name Meridian Community Centre		
<input type="checkbox"/> APPROVED	<input type="checkbox"/> REJECTED	
<input type="checkbox"/> REVISE	<input checked="" type="checkbox"/> REVIEWED	
BY Ndewar	DATE 23-jul-19	
SUBMITTAL# 0	SPEC 0	

Architect:

Architect's Stamp

SHOP DRAWING REVIEW

REVIEWED
REVIEWED AS NOTED
REVISE AND RESUBMIT



"This review is for the sole purpose of ascertaining conformance with the general design concept for architectural features only, and does not in any way constitute review of the design of engineering elements which form part of the Contract Documents prepared by others. This review shall not mean that the Architect approves the detail design inherent in the shop drawings. This responsibility shall remain with the Contractor submitting same, and such review shall not relieve the Contractor of his responsibility for errors or omissions in the shop drawings or of his responsibility for meeting all requirements of the Contract Documents. The Contractor is responsible for dimensions to be confirmed and correlated at the job site, for information that pertains solely to fabrication processes, or to techniques of construction and installation and for co-ordination for the work of all trades."

By: Bryan Bonell Date: July 25, 2019

HOBIN ARCHITECTURE INCORPORATED


Engineer:

Engineer's Stamp




Tag: Meridian
 Qty: 12
 Sizes: TBD
 Color: TBD




2420 / 2425
 4" DEEP STORMPROOF LOUVER

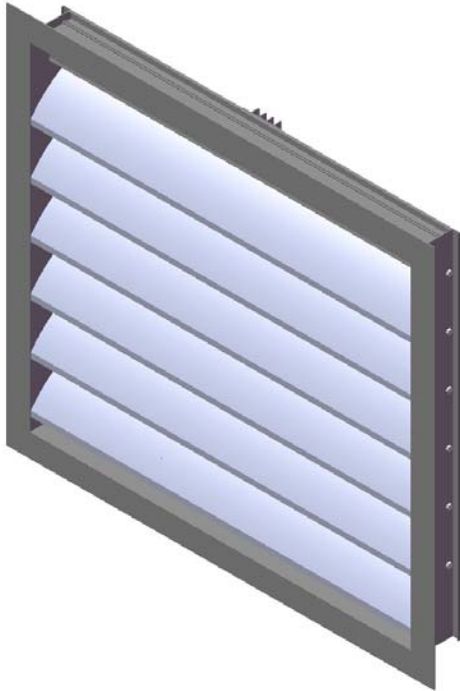

MODEL: 2420
FRAME: CHANNEL FRAME
DUCT-MOUNT (DM)

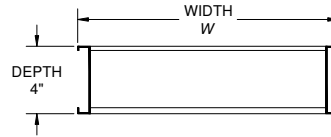

MODEL: 2425
FRAME: FLANGE FRAME
FLANGE-MOUNT (FM)

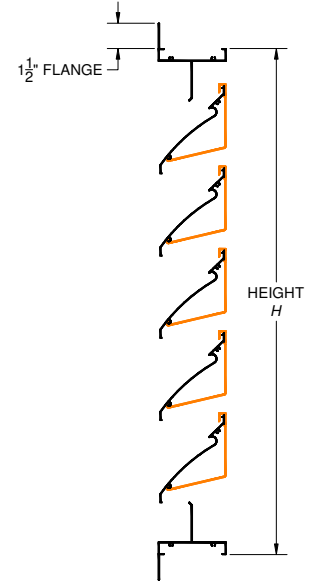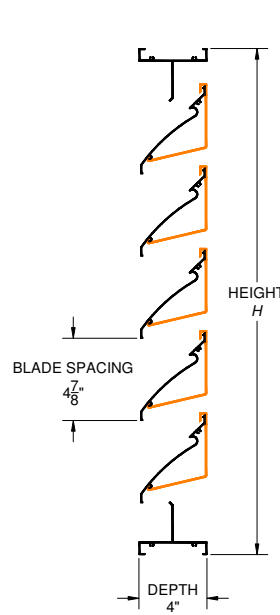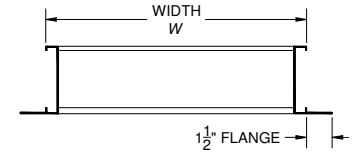

PERFORMANCE			
LOUVER UNIT SIZE	TOTAL AREA	FREE AREA	FREE AREA
48" x 48"	16 ft ²	8.0 ft ²	50.0%
(1219 x 1219 mm)	(1.49 m ²)	(0.74 m ²)	
BEGINNING POINT OF WATER PENETRATION AT 0.01 oz./ft ² FREE AREA:			638 FPM

305mm x 450mm MIN. AT 1830 O/C

STANDARD CONSTRUCTION	
DEPTH:	4" (102 mm)
MATERIAL:	EXTRUDED ALUMINUM - 6063-T5 ALLOY
FRAME THICKNESS:	0.081" (2.06 mm)
BLADE THICKNESS:	0.081" (2.06 mm)
BLADE ANGLE:	45°
BLADE CENTRES:	4.875" (124 mm)
BIRDSCREEN:	19 GA. GALVANIZED BIRDSCREEN - 1/2" x 1/2" OPENINGS
FINISH:	MILL

SIZE LIMITATIONS: SINGLE SECTION LOUVER		
	MINIMUM	MAXIMUM
WIDTH	12" (305 mm)	72" (1829 mm)
HEIGHT	12" (305 mm)	120" (3048 mm)
AREA	1 ft ² (0.09 m ²)	60 ft ² (5.57 m ²)

*LOUVER WILL BE MANUFACTURED 1/4" (6.4 mm) SMALLER (SINGLE SECTION) AND 1/2" (12.7 mm) SMALLER (MULTIPLE SECTION) THAN GIVEN OPENING DIMENSIONS UNLESS OTHERWISE SPECIFIED

COLOUR: DRIFTWOOD WHITE V1161 OR STONE GREY V1031 - TO BE COORD. WITH ROOF MEMBRANE SELECTION

AVAILABLE ACCESSORIES		
FINISH: <ul style="list-style-type: none"> BAKED ENAMEL FINISH DURANAR FINISH ANODIZED FINISH <ul style="list-style-type: none"> CLEAR ANODIZED LIGHT BRONZE MEDIUM BRONZE DARK BRONZE BLACK ANODIZED EXTENDED SILLS SECURITY BARS FILTER RACKS STAINLESS STEEL FASTENERS HINGED ACCESS DOORS ALL WELDED CONSTRUCTION CUSTOM GEOMETRIC SHAPES MONUMENTAL CONSTRUCTION WITH HEAVY GAUGE MATERIAL CONTINUOUS LINE CONSTRUCTION WITH HIDDEN MULLIONS TO PROVIDE AN UNINTERRUPTED APPEARANCE 	SCREENS: <ul style="list-style-type: none"> BIRDSCREEN <ul style="list-style-type: none"> 1/2" x 1/2" INTER CRIMPED ALUMINUM ALUMINUM BIRDSCREEN WITH FRAME INSECT SCREEN <ul style="list-style-type: none"> 18 x 14 MESH 	BLANK-OFF PANELS (ALUMINUM): VARIOUS GAUGES <ul style="list-style-type: none"> NON-INSULATED BLANK-OFF PANELS INSULATED BLANK-OFF PANELS <ul style="list-style-type: none"> 1" (25.4 mm) INSULATION 2" (50.8 mm) INSULATION

INSECT SCREEN NOTED ON DETAIL 2/A2.04


FREE AREA (Sq. Ft.)

WIDTH (INCHES)

HEIGHT (INCHES)	WIDTH (INCHES)															
	12	16	20	24	28	32	36	40	44	48	52	56	60	64	68	72
12	0.24	0.33	0.42	0.51	0.60	0.69	0.78	0.87	0.96	1.05	1.14	1.23	1.32	1.41	1.50	1.59
16	0.42	0.58	0.74	0.90	1.06	1.21	1.37	1.53	1.69	1.85	2.01	2.17	2.33	2.49	2.65	2.81
20	0.59	0.81	1.04	1.26	1.48	1.71	1.93	2.16	2.38	2.61	2.83	3.05	3.28	3.50	3.73	3.95
24	0.76	1.06	1.35	1.64	1.93	2.22	2.51	2.80	3.09	3.39	3.68	3.97	4.26	4.55	4.84	5.13
28	0.93	1.29	1.64	2.00	2.36	2.71	3.07	3.42	3.78	4.13	4.49	4.85	5.20	5.56	5.91	6.27
32	1.09	1.50	1.92	2.33	2.75	3.16	3.58	3.99	4.41	4.82	5.24	5.65	6.07	6.48	6.90	7.31
36	1.25	1.73	2.20	2.68	3.15	3.63	4.11	4.58	5.06	5.53	6.01	6.49	6.96	7.44	7.91	8.39
40	1.44	1.99	2.54	3.09	3.64	4.19	4.74	5.29	5.84	6.39	6.94	7.49	8.04	8.59	9.14	9.69
44	1.61	2.22	2.84	3.45	4.06	4.67	5.29	5.90	6.51	7.13	7.74	8.35	8.97	9.58	10.19	10.80
48	2.00	2.67	3.33	4.01	4.67	5.33	6.02	6.67	7.33	8.00	8.67	9.33	10.01	10.67	11.34	12.03
52	1.95	2.70	3.44	4.19	4.93	5.68	6.42	7.17	7.91	8.66	9.40	10.15	10.89	11.64	12.38	13.12
56	2.11	2.92	3.72	4.53	5.33	6.13	6.94	7.74	8.55	9.35	10.16	10.96	11.77	12.57	13.38	14.18
60	2.29	3.16	4.04	4.91	5.78	6.65	7.53	8.40	9.27	10.15	11.02	11.89	12.76	13.64	14.51	15.38
64	2.46	3.40	4.34	5.27	6.21	7.15	8.09	9.02	9.96	10.90	11.84	12.77	13.71	14.65	15.59	16.52
68	2.64	3.64	4.64	5.65	6.65	7.66	8.66	9.66	10.67	11.67	12.68	13.68	14.68	15.69	16.69	17.70
72	2.81	3.88	4.95	6.02	7.09	8.16	9.23	10.30	11.37	12.44	13.51	14.58	15.65	16.72	17.79	18.86
76	2.96	4.09	5.22	6.35	7.48	8.61	9.74	10.87	12.00	13.13	14.26	15.39	16.51	17.64	18.77	19.90
80	3.12	4.31	5.50	6.69	7.88	9.07	10.26	11.45	12.63	13.82	15.01	16.20	17.39	18.58	19.77	20.96
84	3.31	4.57	5.83	7.09	8.35	9.61	10.87	12.13	13.39	14.65	15.91	17.17	18.43	19.69	20.95	22.21
88	3.48	4.81	6.13	7.46	8.78	10.11	11.43	12.76	14.09	15.41	16.74	18.06	19.39	20.71	22.04	23.37
92	3.66	5.05	6.45	7.84	9.24	10.63	12.03	13.42	14.81	16.21	17.60	19.00	20.39	21.78	23.18	24.57
96	3.83	5.29	6.75	8.21	9.67	11.13	12.58	14.04	15.50	16.96	18.42	19.88	21.34	22.80	24.26	25.72
100	3.99	5.51	7.03	8.54	10.06	11.58	13.10	14.62	16.14	17.66	19.18	20.70	22.22	23.73	25.25	26.77
104	4.16	5.75	7.34	8.92	10.51	12.09	13.68	15.27	16.85	18.44	20.02	21.61	23.20	24.78	26.37	27.96
108	4.33	5.98	7.64	9.29	10.94	12.59	14.24	15.89	17.54	19.19	20.84	22.49	24.14	25.79	27.45	29.10
112	4.51	6.22	7.94	9.66	11.38	13.09	14.81	16.53	18.25	19.96	21.68	23.40	25.11	26.83	28.55	30.27
116	4.69	6.48	8.27	10.06	11.84	13.63	15.42	17.21	18.99	20.78	22.57	24.36	26.14	27.93	29.72	31.51
120	4.84	6.68	8.53	10.37	12.21	14.06	15.90	17.74	19.59	21.43	23.28	25.12	26.96	28.81	30.65	32.49


WATER PENETRATION - 2420 / 2425

15 MINUTE DURATION, TEST SIZE 48" x 48"

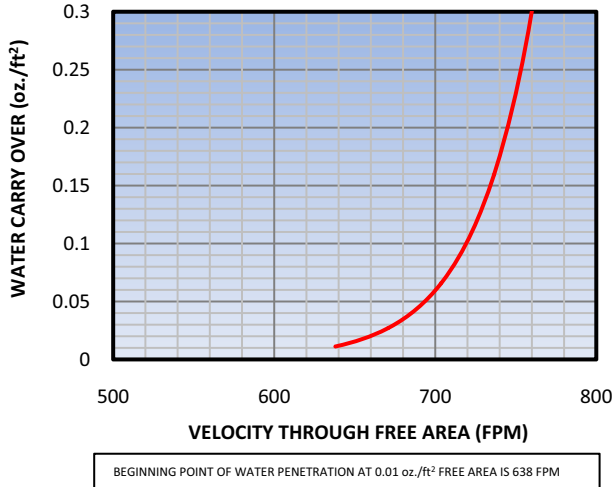

PRESSURE DROP - 2420 / 2425

FIGURE 5.5, TEST SIZE 48" x 48"

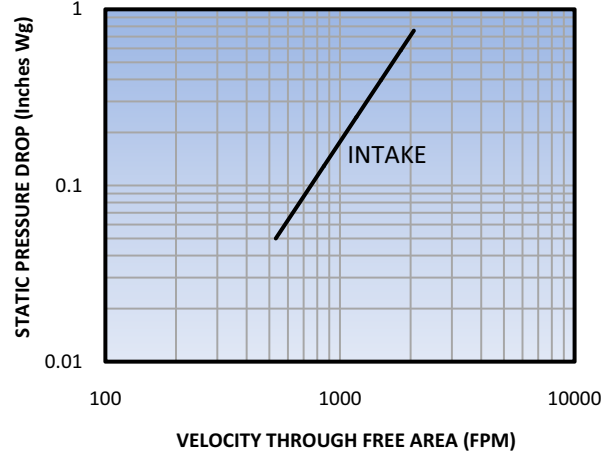

*TEST RESULTS DO NOT INCLUDE THE EFFECTS OF BIRDSCREEN

RECOMMENDED SPECIFICATION

Furnish and install stationary louver models 2420 / 2425 as manufactured by Ventex Inc, Bolton, Ontario. Louvers must be licensed to bear the AMCA seal. Louvers shall be 4" (102 mm) deep. Blades shall be 0.081" (2.06 mm) extruded 6063-T5 aluminum alloy and frame shall be 0.081" (2.06 mm) extruded 6063-T5 aluminum alloy. Louvers shall have 19 gauge galvanized 1/2" x 1/2" birdscreen. All materials shall be factory finished after assembly with Polyester Power Coat in a color selected from the Ventex Color Chart.

CERTIFIED RATINGS

Ventex Inc. certifies that the models 2420 / 2425 shown here are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The Certified Ratings Seal applies to air performance and water penetration ratings.

