

LIGHTING FIXTURE SCHEDULE

LABEL	MANUFACTURER	CATALOGUE MODEL NUMBER	DESCRIPTION	VOLTAGE	NO	BALLAST	WATTS	TYPE	REMARKS
"A"	ACUITY	WHSPR 2X4 400LM 35K 80 CRI MINI 347	T-BAR CEILING FIXTURE	347 V	-	LED	33.8	3500K	2x4 TYPE - OFFICE
"B"	ACUITY	CLX 148 3000LM SEF FOL 347	GYP/SM BOARD CEILING FIXTURE	347 V	-	LED	20.32	3500K	1x4 TYPE - OFFICE
"B-1"	AMULITE	VP4 L43 8/40K 347	SUSPENDED FIXTURE	120 V	-	LED	40-60	3500K	1x4 TYPE - VAPORPROOF
"C"	AMULITE	RAMB-1-12-20W0-WH1	WALL MOUNTED FIXTURE	347 V	1	-	20	-	SURFACE MOUNTED
1R-HEAD	AMULITE	RAMB-2-12-20W0-WH1	WALL FIXTURE	12 VDC	2	-	20	-	SURFACE MOUNTED
2R-HEAD	AMULITE	EEST-12-200-2MB-20W0-WH1-A1D	EMERGENCY BATTERY WALL FIXTURE	12 VDC	2	-	20	-	SURFACE MOUNTED
E-BATT. EXIT	AMULITE	EXST-U-M-WH1-BAT	WALL FIXTURE	12 VDC	1	-	1	-	LED UNI. MOUNTING

- ### ELECTRICAL DRAWING NOTES:
- PROVIDE T-BAR CEILING MOUNTED LIGHT FIXTURES TYPE "A", "B", & "C" TYPE. 347V, 1Ø, C/W CONTACTOR AND WALL MOUNTED SWITCH. FOR DETAILS REFER TO LIGHTING SCHEDULE DRAWING BESIDE.
 - PROVIDE SURFACE MOUNTED LIGHT FIXTURES TYPE "C" TYPE. 347V, 1Ø, C/W CONTACTOR AND WALL MOUNTED SWITCH. FOR DETAILS REFER TO LIGHTING SCHEDULE DRAWING BESIDE. COORDINATE MOUNTING HEIGHT WITH GENERAL TRADES PRIOR TO FINAL INSTALLATION (TYPICAL AS SHOWN).
 - PROVIDE LIGHTING CONTROL WALL SWITCH C/W CONTACTOR 347V, 1Ø. (TYPICAL AS SHOWN).
 - PROVIDE 2X4 TYPE T-BAR CEILING LIGHT FIXTURES FOR DETAILS AND SPECIFICATIONS REFER TO FIXTURE SCHEDULE BESIDE (TYPICAL FOR ALL).
 - PROVIDE NEW WALL MOUNTED POWER DISTRIBUTION PANELS "DP-1" 600V, 3Ø, 60Hz, 100A, 24 CIRCUITS, AND "DP-2" 208V, 3Ø, 60Hz, 125A, 42 CIRCUITS.
 - PROVIDE WALL MOUNTED BATTERY OPERATED EMERGENCY LIGHT FIXTURES C/W REMOTE HEADS 12VDC - 120V, 1Ø DEDICATED CIRCUIT. FOR DETAILS AND SPECIFICATIONS REFER TO FIXTURE SCHEDULE BESIDE (TYPICAL FOR ALL).

FLYNN ARCHITECT

165 PRESTON STREET OTTAWA, ONTARIO, K1R 7P7
T: 613-299-8506 F: 866-987-2021


Antares Engineering Group Inc.
Professional Engineers
Professional Mechanical Electrical Testing and
Inspection Engineers
1000 GARDINER DRIVE, SUITE 100, OTTAWA, ONTARIO
K1R 7P7
T: 613-299-8506 F: 866-987-2021

GENERAL NOTES

- DO NOT SCALE DRAWINGS. FIGURED DIMENSIONS ONLY TO BE USED.
- IT IS THE RESPONSIBILITY OF THE ARCHITECT TO VERIFY ALL DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE ARCHITECT.
- ALL WORK RESCRIBED UNDER THIS CONTRACT TO COMPLY WITH THE MOST CURRENT EDITION OF THE ONTARIO BUILDING CODE, AND/OR NATIONAL BUILDING CODE, AND OTHER CODES AND BY-LAWS IN EFFECT.


ISSUE RECORD

No	DATE	REVISION
1	14-02-2020	ISSUED FOR CONSTRUCTION
2	8-11-2019	ISSUED FOR TENDER
3	27-06-2019	ISSUED FOR BUILDING PERMIT
4	28-09-2018	ISSUED FOR REVIEW
5	13-05-2018	ISSUED FOR CLIENT REVIEW

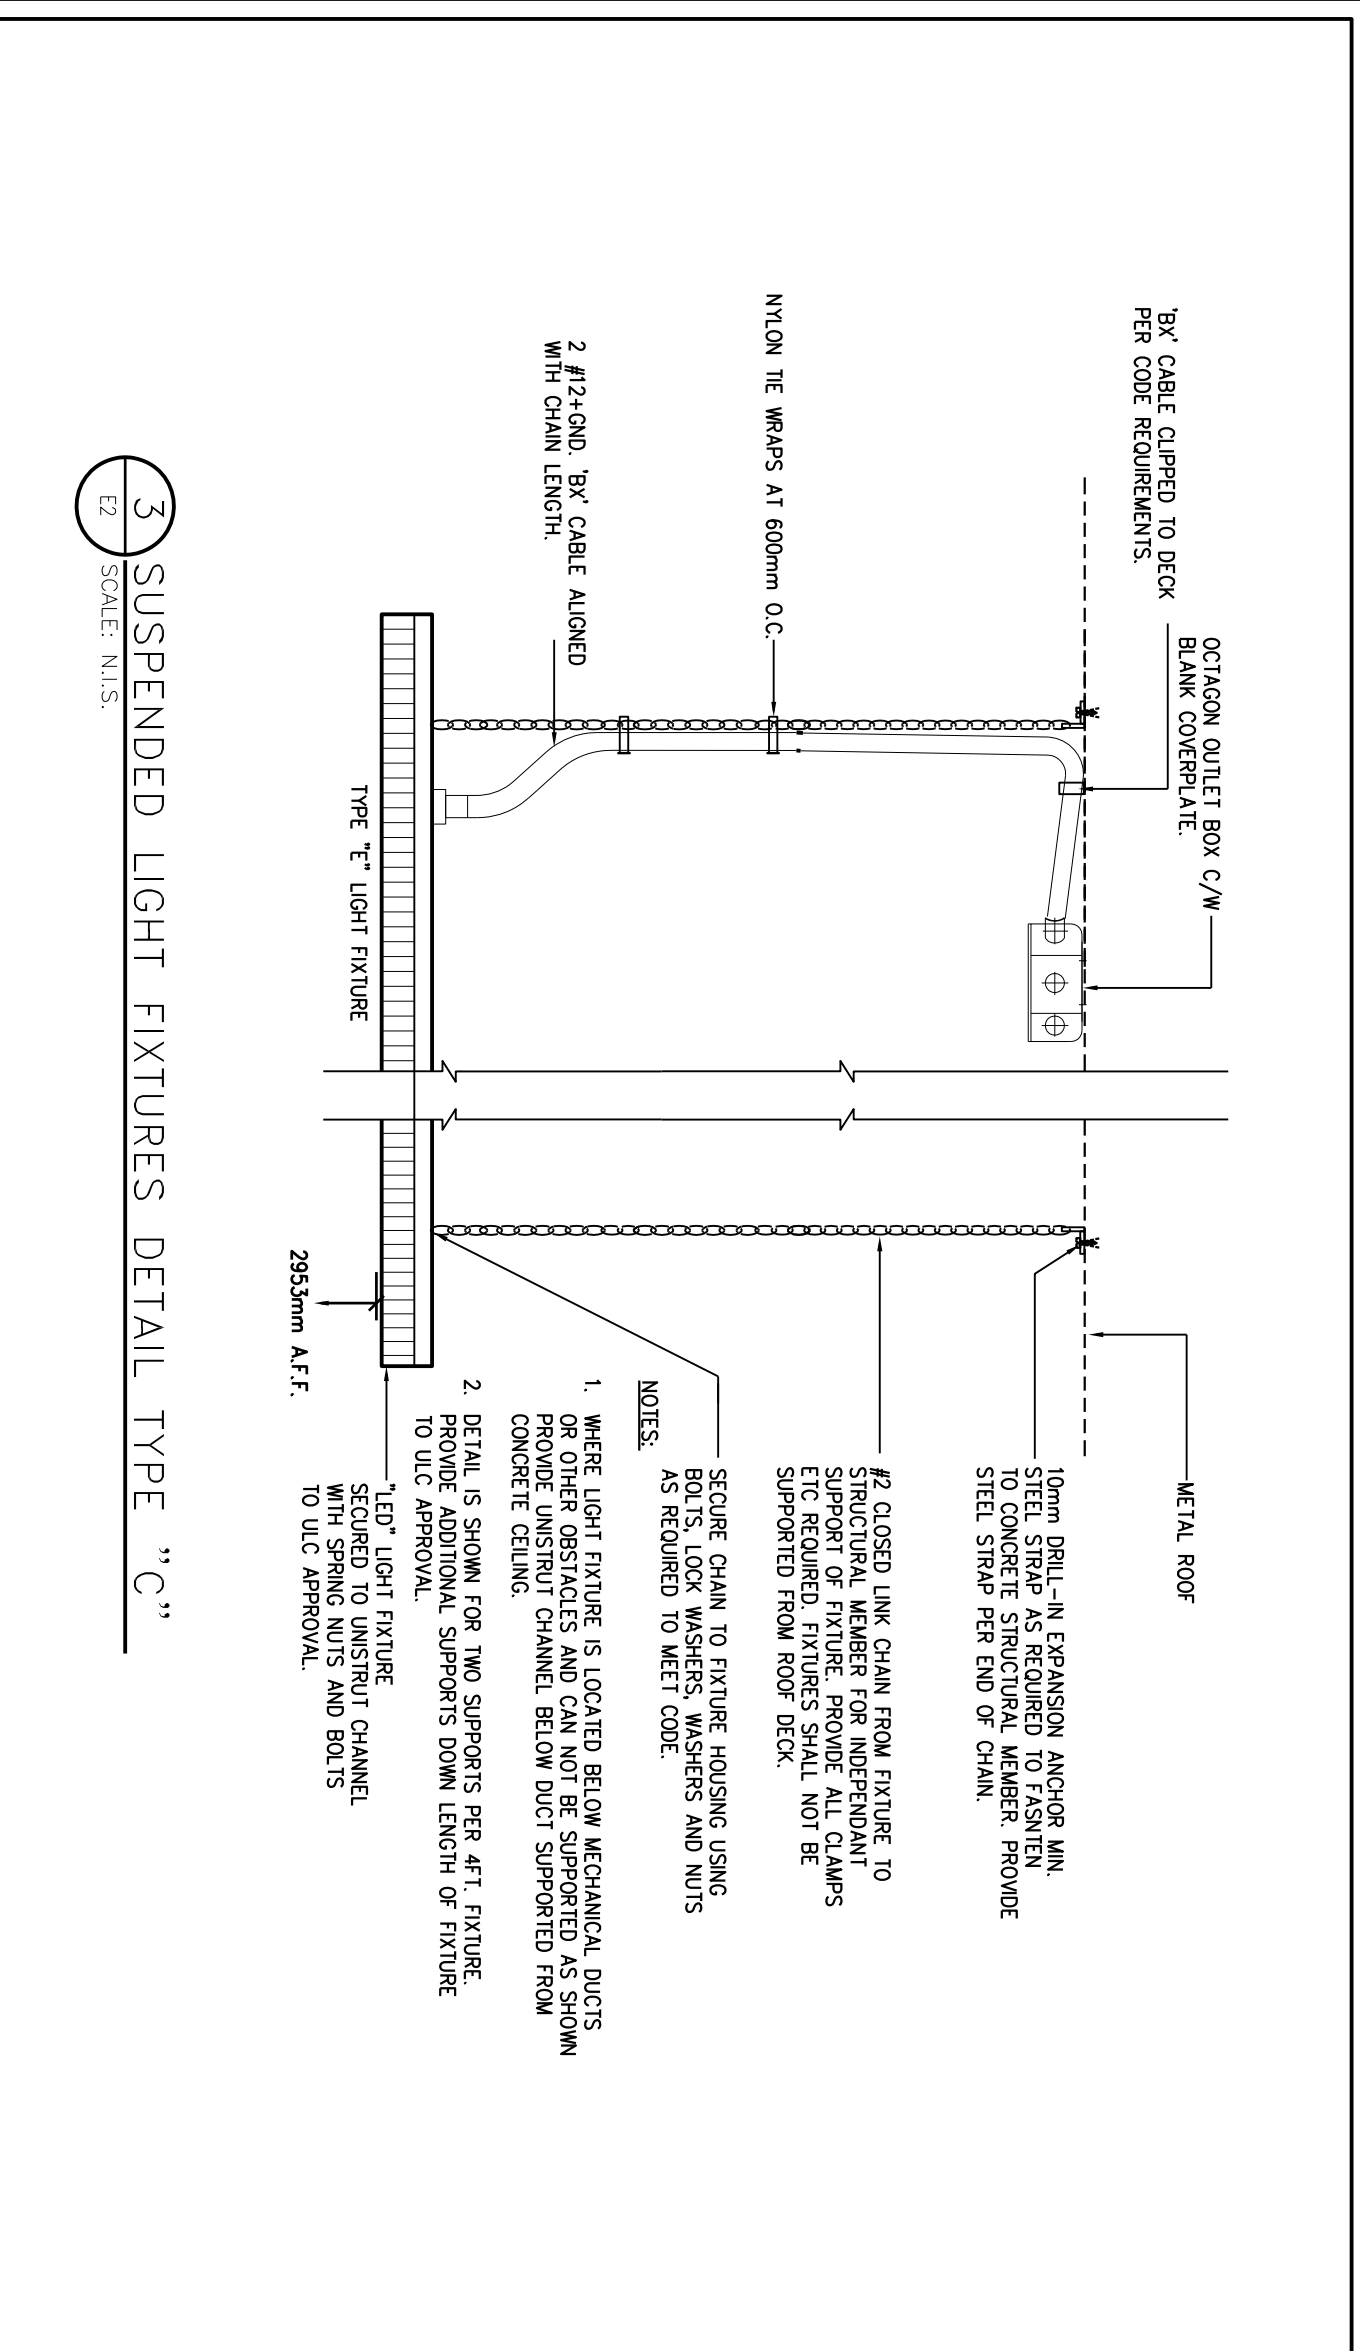

ELECTRICAL LEGEND

SYMBOL	DESCRIPTION
	2x4 LIGHT FIXTURE
	1x4 LIGHT FIXTURE
	WALL AND CEILING MOUNTED EXIT SIGN
	EXTERIOR WALL MOUNTED LIGHT FIXTURE
	2x4x2" SIDE-MOUNT SURFACE STRIP LIGHT FIXTURE
	EMERGENCY BATTERY OPERATED LIGHTING
	EMERGENCY REMOTE HEADS LIGHTING
	SINGLE RECEPTACLE 240V, 7A
	DUPLEX RECEPTACLE 120V, 15A
	GROUND FAULT INTERRUPTED CIRCUIT BREAKER RECEPTACLE 120V, 20A
	SPLIT SEPARATE CIRCUIT DUPLEX RECEPTACLE 120V, 20A
	DATA OUTLET
	TELEPHONE OUTLET
	POWER DISTRIBUTION SPLITTER
	MOTION LIGHT SWITCH 120V TYPE WALL MOUNTED LIGHT SWITCH 347 V TYPE WALL MOUNTED LIGHT 347 V TYPE
	ELECTRICAL DISTRIBUTION JUNCTION BOX
	DIRECT ELECTRICAL CONNECTION
	ELECTRICAL DISTRIBUTION PANEL
	ELECTRICAL DISCONNECT SWITCH
	WEATHER PROOF
	UIC APPROVAL

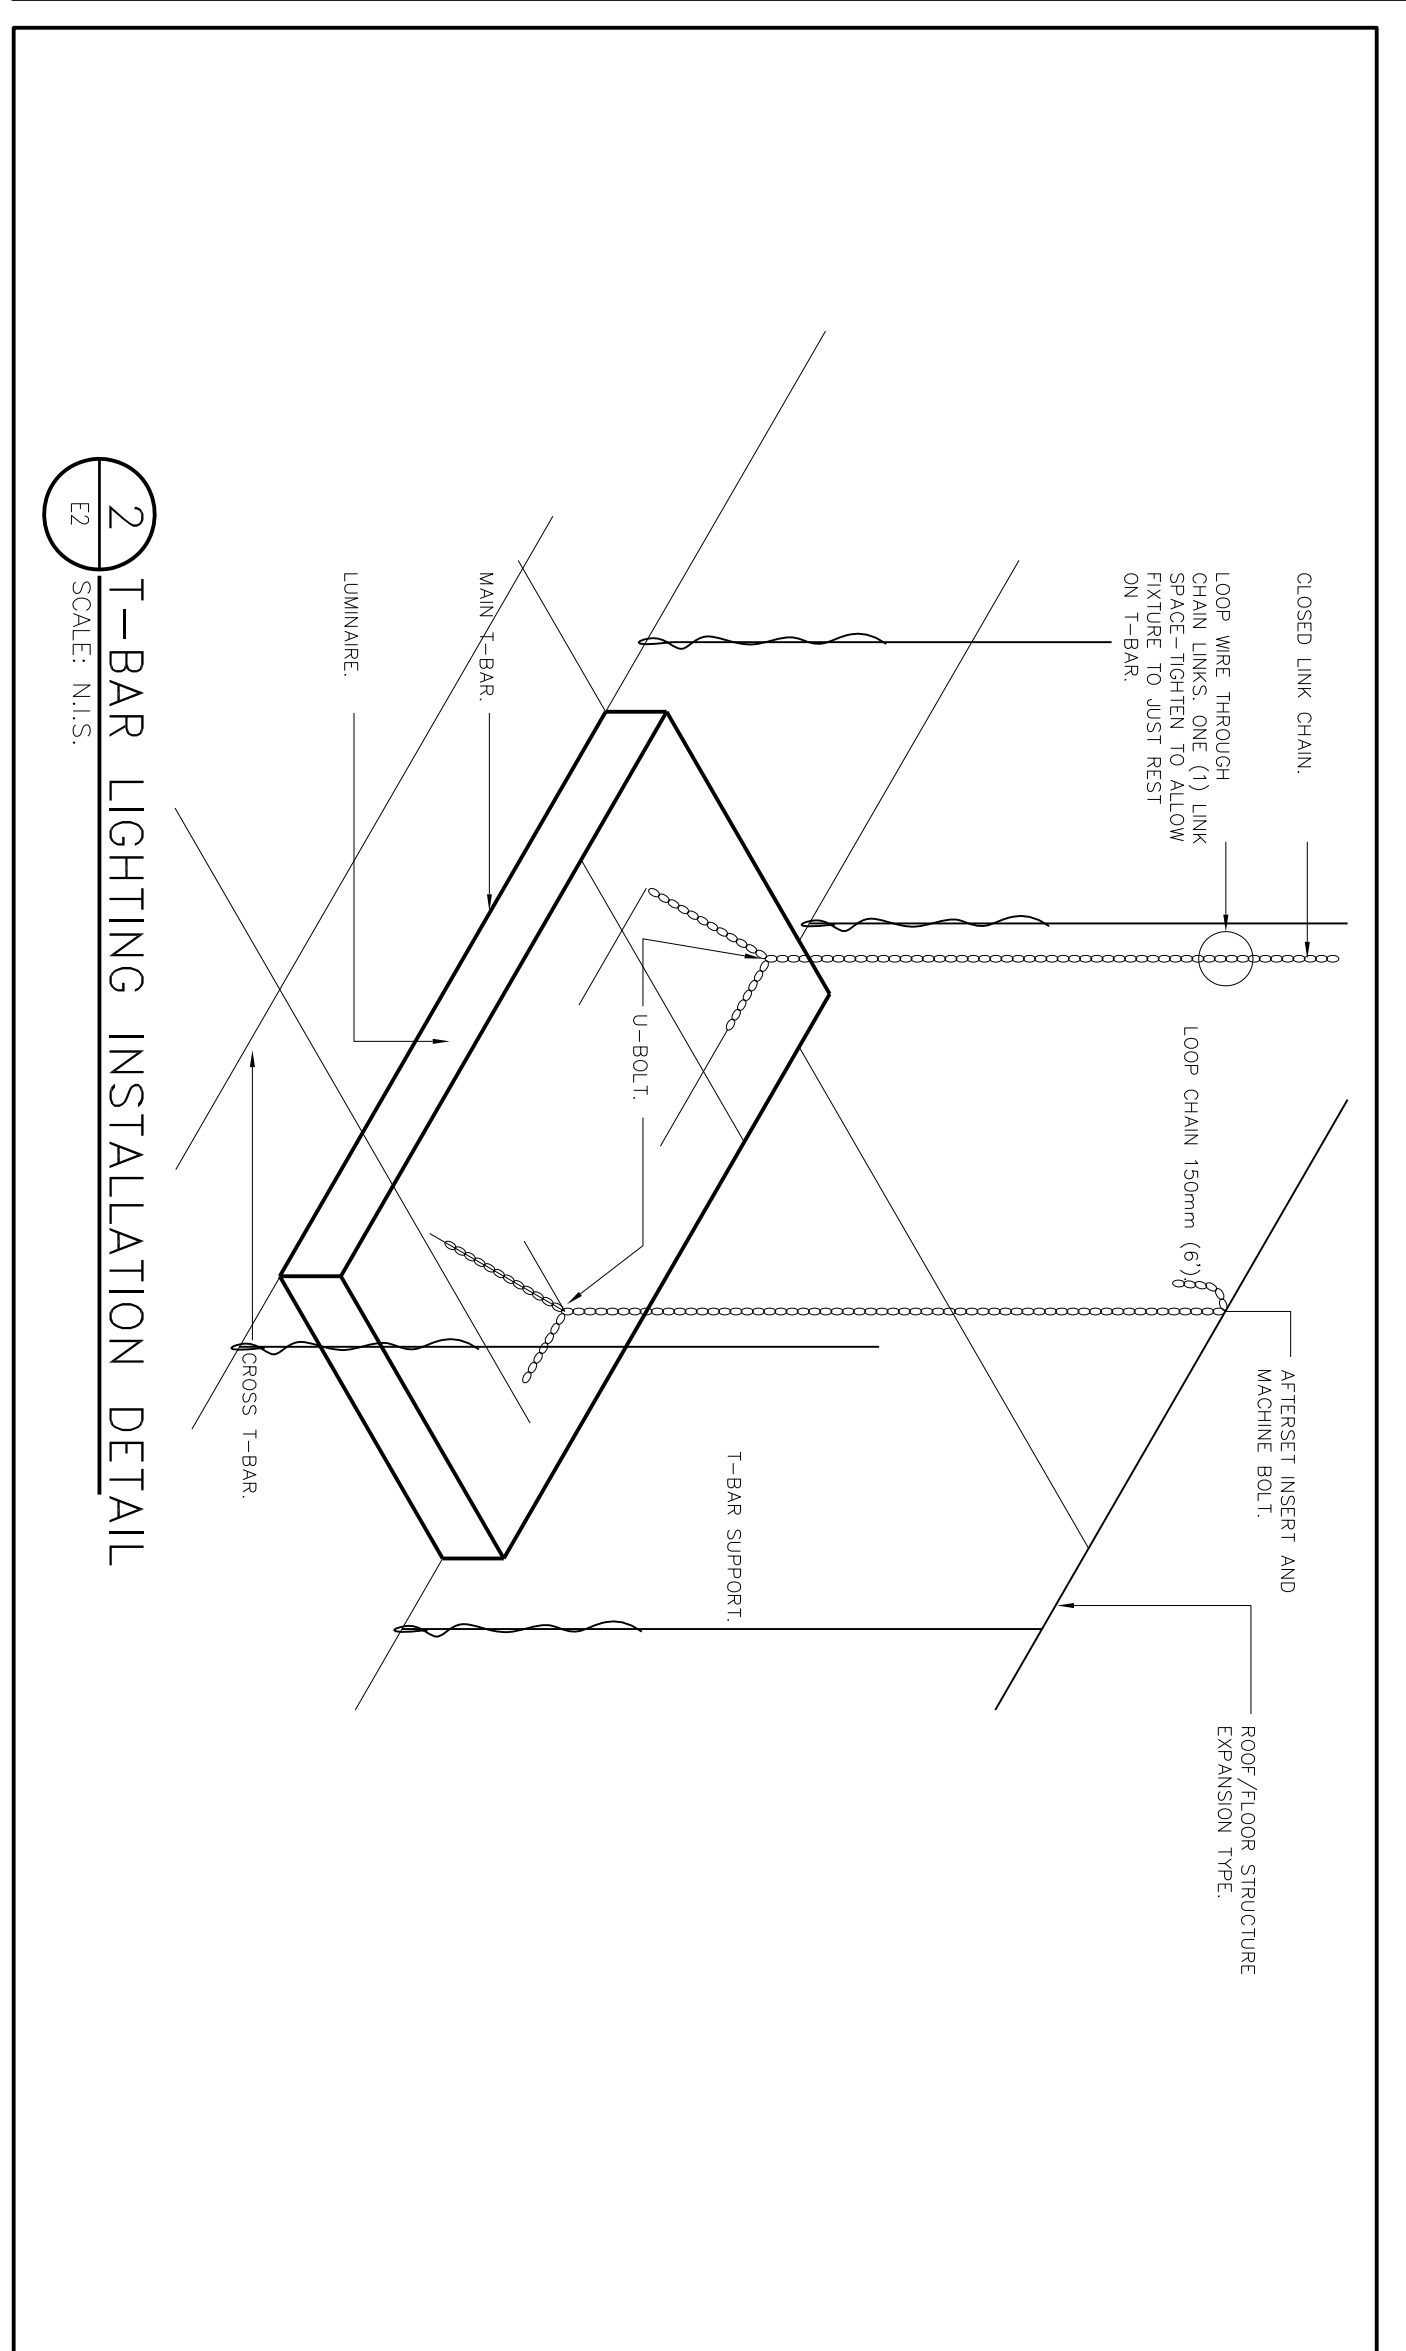

PROJECT TITLE:
228 HUNTMAR DRIVE
HUNTMAR/PALLADIUM DR. ENTERPRISE

DRAWING TITLE:
ELECTRICAL
LIGHTING DISTRIBUTION

DRAWN BY: S.J.S.
CHECKED BY: J.C.J.
SCALE: 1:50

JOB NO.: 15-610
DRAWING NO.: E-3

CLIENT:
ENTERPRISE RENT-A-CAR
RYAN FRILOTTE
T: 613-274-6934
F: 1-800-495-2412

CONSULTANTS:
HOLZMAN CONSULTANTS INC.
(LAND DEVELOPMENT CONSULTANTS)
1076 CASTLE HILL CRES
OTTAWA, ONTARIO
K2C 2A8
T: 613-226-1386

MMI GROUP LTD
(CIVIL ENGINEERING)
1145 HUNT CLUB ROAD, SUITE 300
OTTAWA, ONTARIO
K1V 0Y3
T: 613-736-7200
F: 613-736-8710

VALLEY ENGINEERING
(STRUCTURAL ENGINEERING)
521 DICKINSON AVENUE
OTTAWA, ONTARIO
K1V 7J4
T: 613-521-9002

ANTARES ENGINEERING
(M&E ENGINEERING)
1-159 COLONNADE ROAD
NEPEAN, ONTARIO
K2E 7J4
T: 613-723-6034