

LARRY GAINES • ARCHITECT

Old Town Hall
14 Bridge Street, PO 706
Almonte, Ontario
K0A 1A0

T: 613-256-3630
gaines@bellnet.ca

CIR Response

CIR #11

To:

TALCO BUILDING INNOVATIONS LTD.
4728 Bank Street, Suite A
Ottawa, Ontario

Project:

Carleton Place Arena
Renovation and Addition

Date:

September 29, 2020

CIR Responses are issued only for the purpose of recording any clarification or interpretation of the contract documents or giving direction on problems resulting from field conditions. These instructions are subject to the provisions of the contract documents and unless stated herein and specifically co-authorized by the Client, will not affect the contract


REFERENCES:

CIR #11 submitted September 20, 2020

PER:

Larry Gaines

Architect

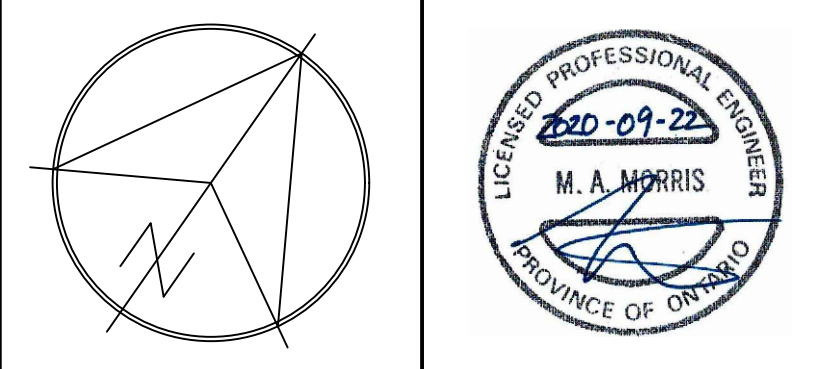

No.	Date	Revision
0	2020-09-22	FOR REVIEW

- LEGEND:**
- ⊗ HEAT DETECTOR
 - ⊙ SMOKE DETECTOR
 - ⊕ DUCT SMOKE DETECTOR
 - ▣ PULL STATION
 - ▾ FIRE ALARM HORN/STROBE


Client:
LARRY GAINES
ARCHITECT
Almonte, ON

Project:
CARLETON PLACE
ARENA ADDITION
Carleton Place, ON


Drawing:
Fire Alarm System

Design:	M.MORRIS
Drawn:	A.M.
Date:	SEP 2020
Project:	205
Scale:	AS SHOWN

FA1

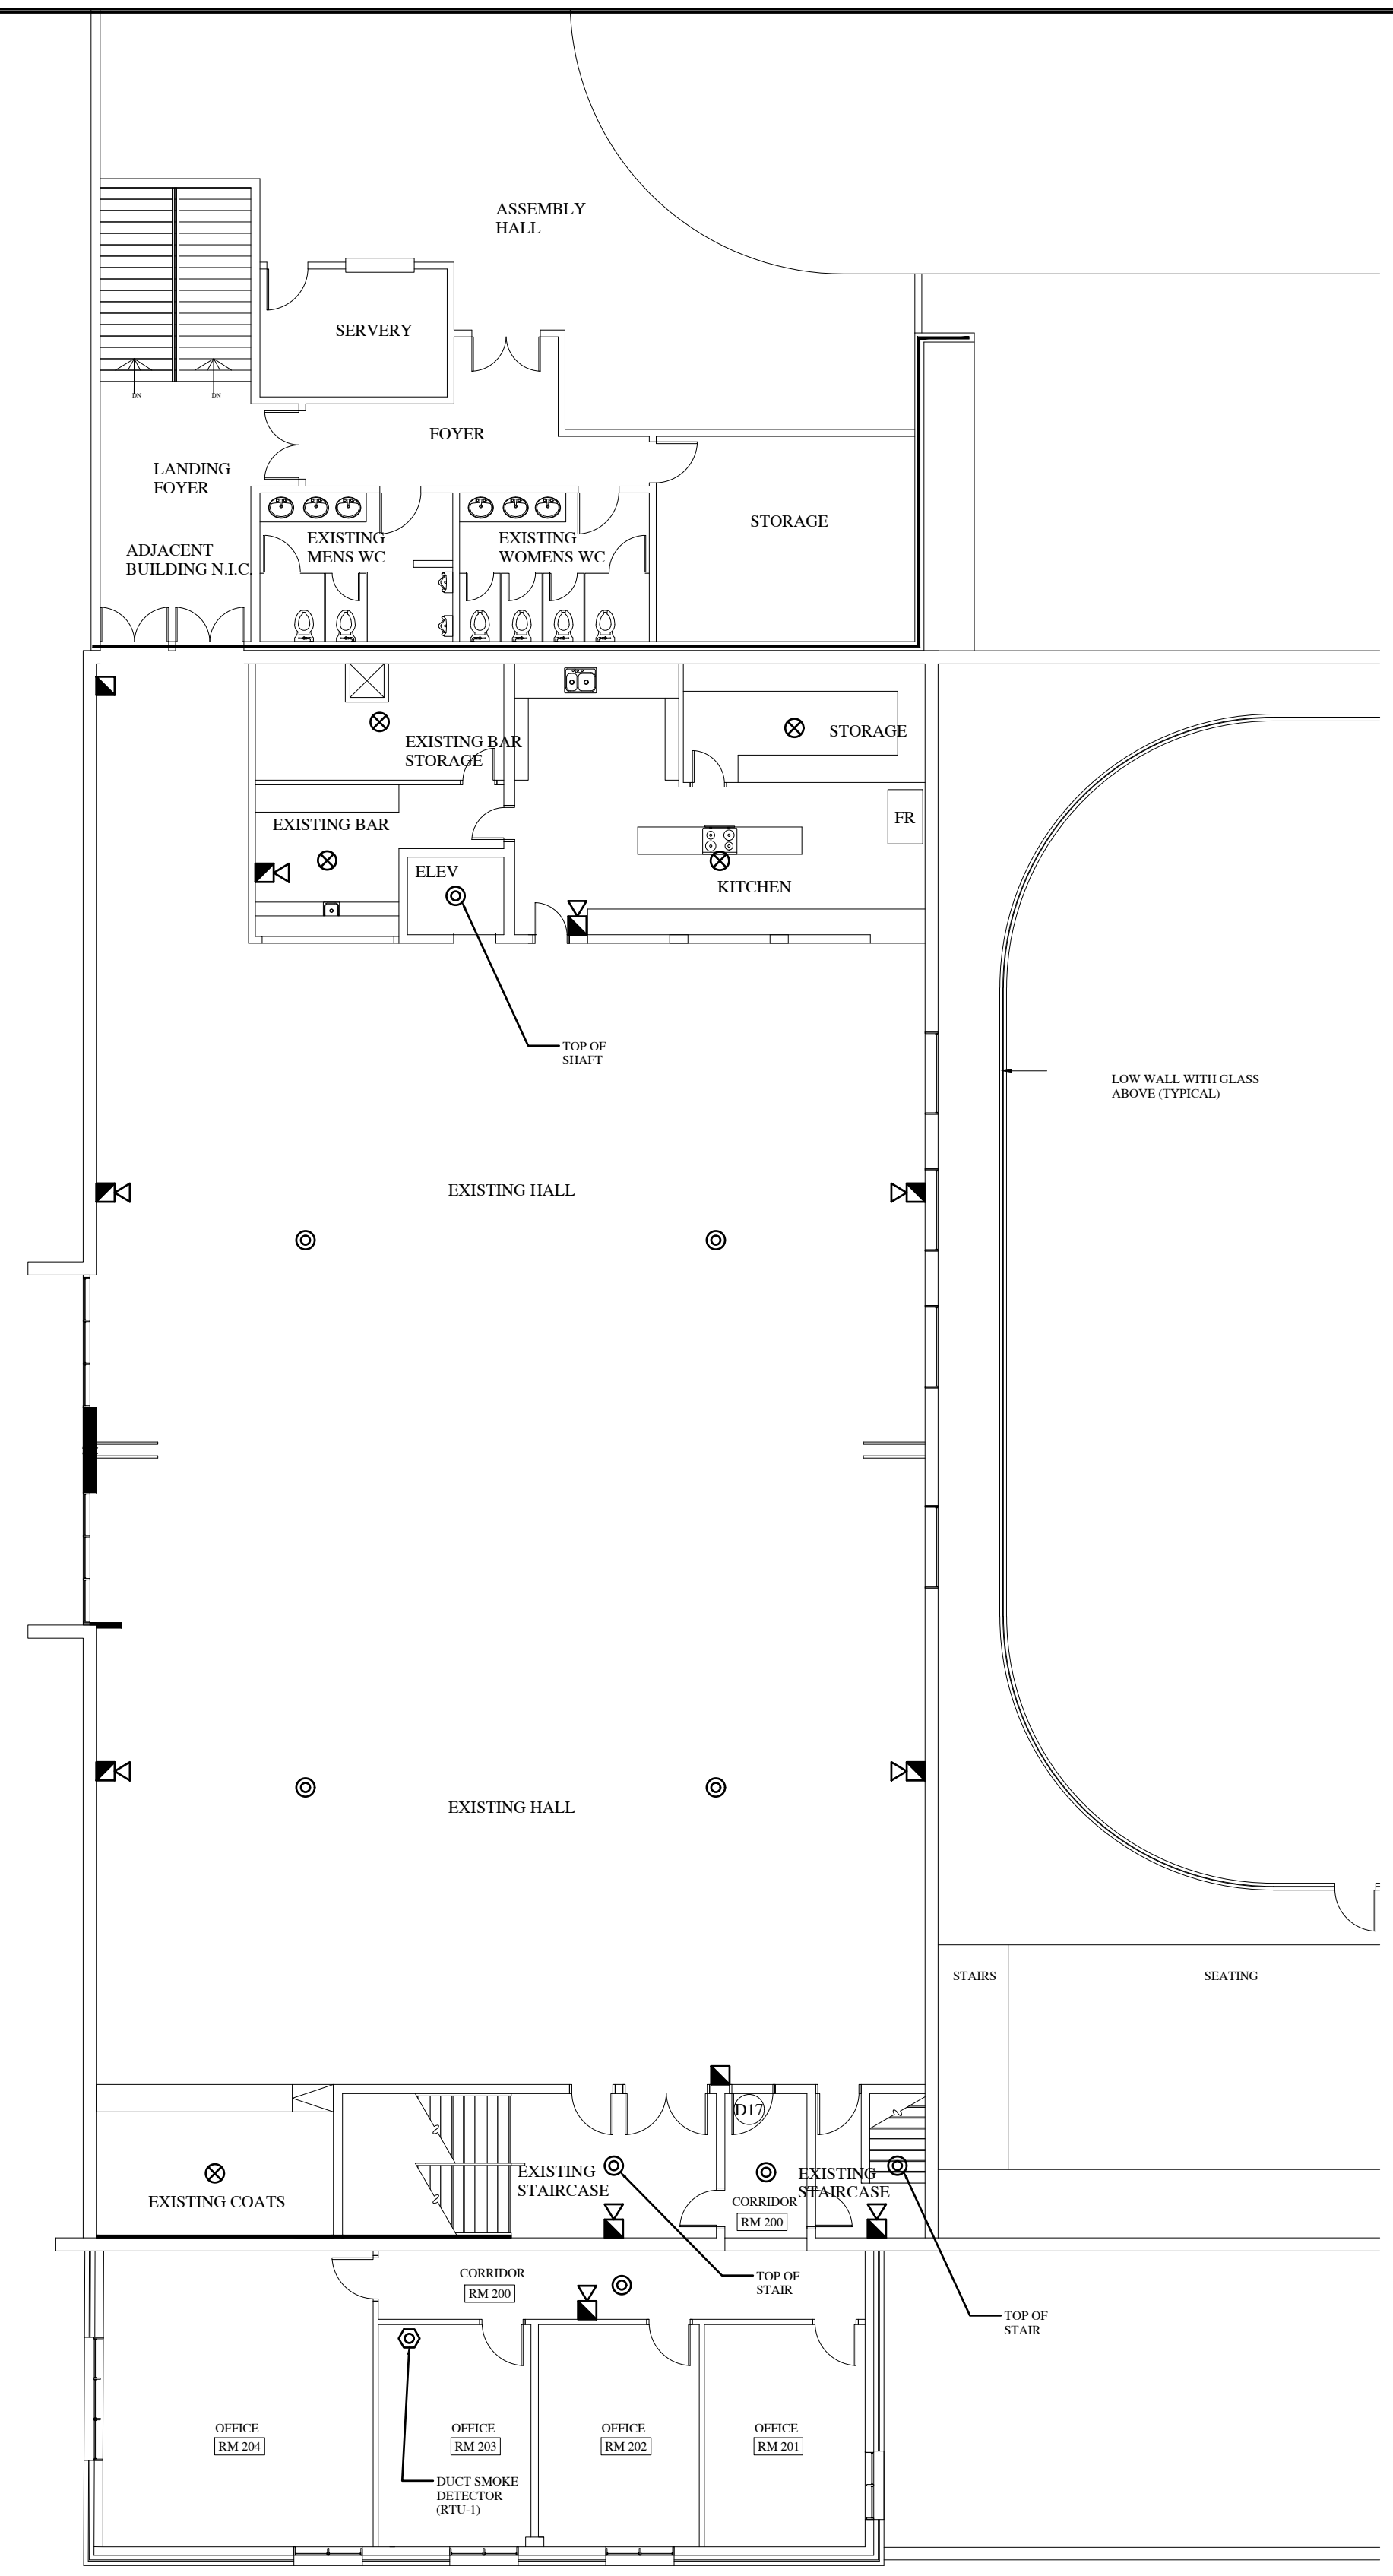

2 SECOND FLOOR PLAN
FA1 SCALE: 3/32" = 1'-0"

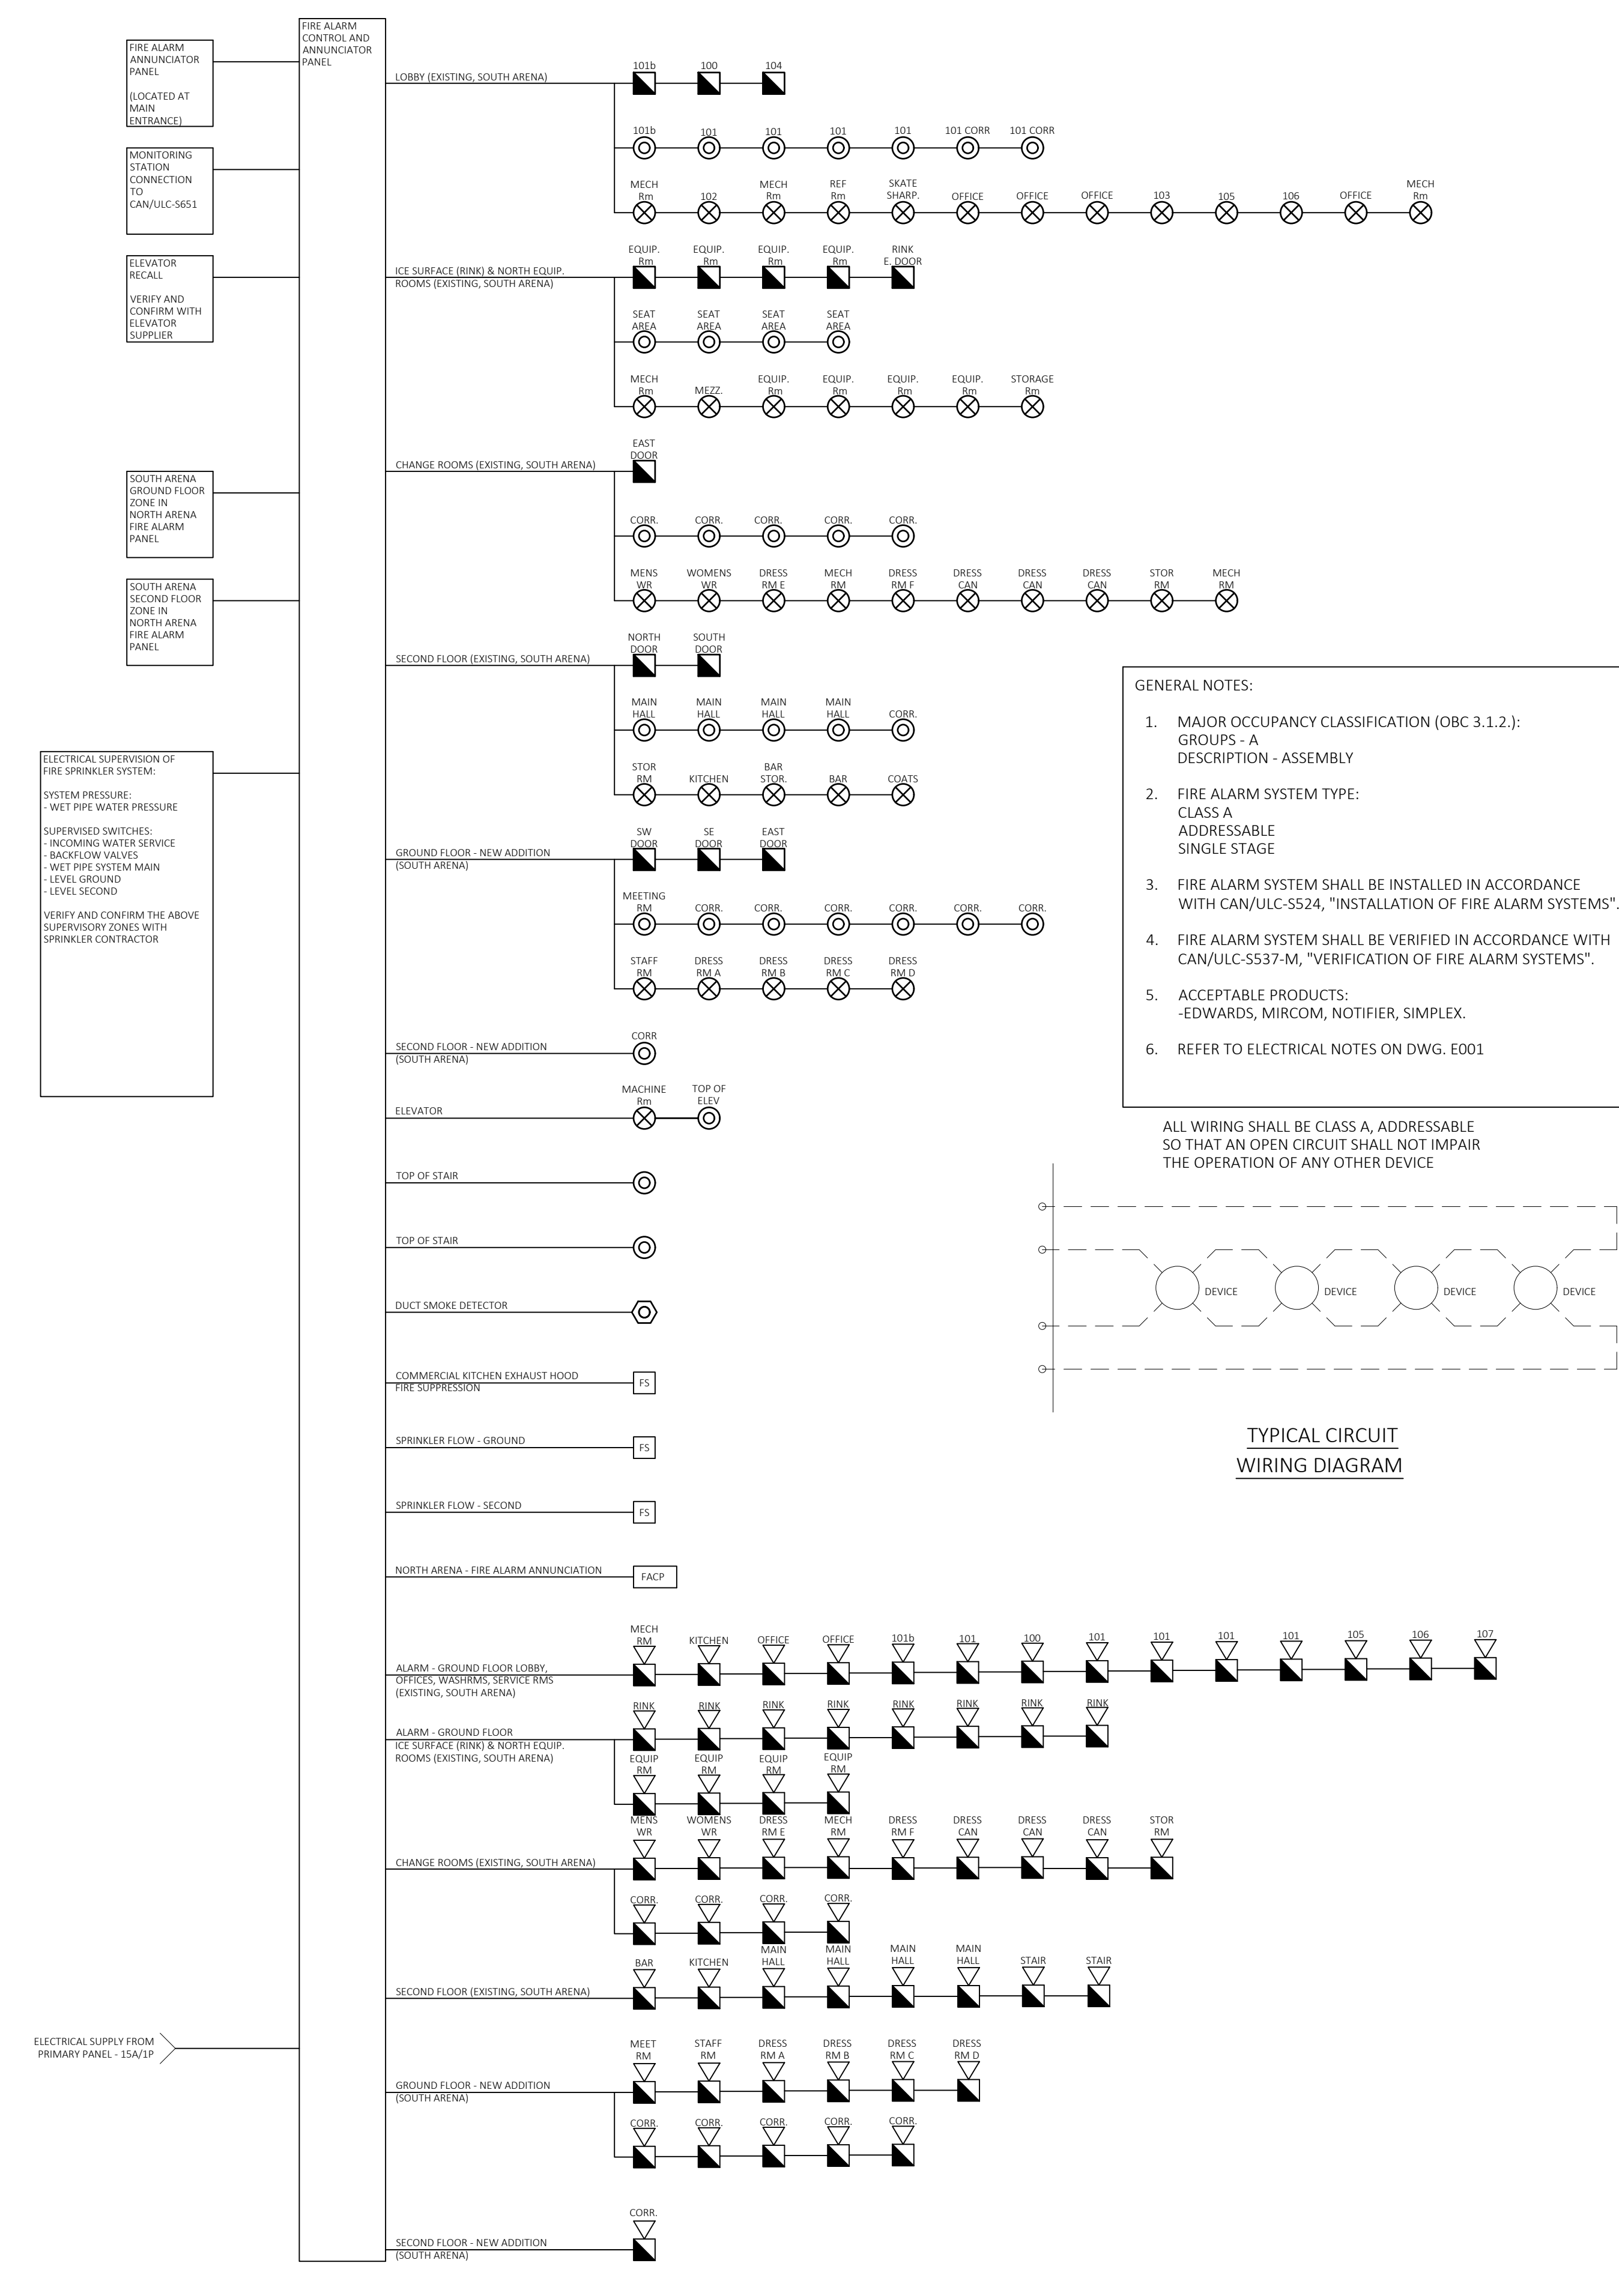

1 FIRE ALARM - SCHEMATIC DIAGRAM
FA1 NTS



**CARLETON PLACE ARENA
ADDITION AND RENOVATIONS
75 Neelin Street Carleton Place, Ontario**

TAL-CO Building Innovations Limited
4728 Bank Street, Suite A
Gloucester, Ontario K1T 3W7
Tel: 613-821-3959
Fax: 613-821-2938

Issue date: 10-Sep-20
Revision date: N/A
Revision #: N/A

CIR #11 Detailed Summary

Questions:

1. As per Addendum #3 E1.4.2 (Page 7), please provide the drawing of the Fire Alarm System device locations.

Refer to attached.

End of CIR No. 11

AND ELECTRICAL.

- .2 Drawing of device locations (as noted and outlined in ADDENDUM NO.1) in existing building will be provided post-tender.

All bidders shall acknowledge receipt and acceptance of this Addendum No. 3 by signing within the space provided and submitting the signed Addendum with the final tender submission. Bids submitted without this addendum may be considered incomplete.

Receipt acknowledged and conditions agreed to this _____ day of _____, 2020.

BIDDING FIRM NAME

SIGNATURE

Diane Smithson, CAO
Town of Carleton Place
Phone 613-257-6255
Fax: 613-257-8170
Email: dsmithson@carletonplace.ca