

No.	Date	Revision
2	2020-12-01	REVISIONS, PER SITE MEETING
1	2020-10-29	REVISIONS, PER SITE DISCUSSION
0	2020-09-22	FOR REVIEW

- LEGEND:**
- ⊗ HEAT DETECTOR
  - ⊙ SMOKE DETECTOR
  - ⊕ DUCT SMOKE DETECTOR
  - ▣ PULL STATION
  - ▾ FIRE ALARM HORN/STROBE


Client:  
**LARRY GAINES**  
ARCHITECT  
Almonte, ON

Project:  
**CARLETON PLACE**  
ARENA ADDITION  
Carleton Place, ON

Drawing:  
**Fire Alarm System**

Design:	M.MORRIS
Drawn:	A.M.
Date:	SEP 2020
Project:	205
Scale:	AS SHOWN

**FA1**

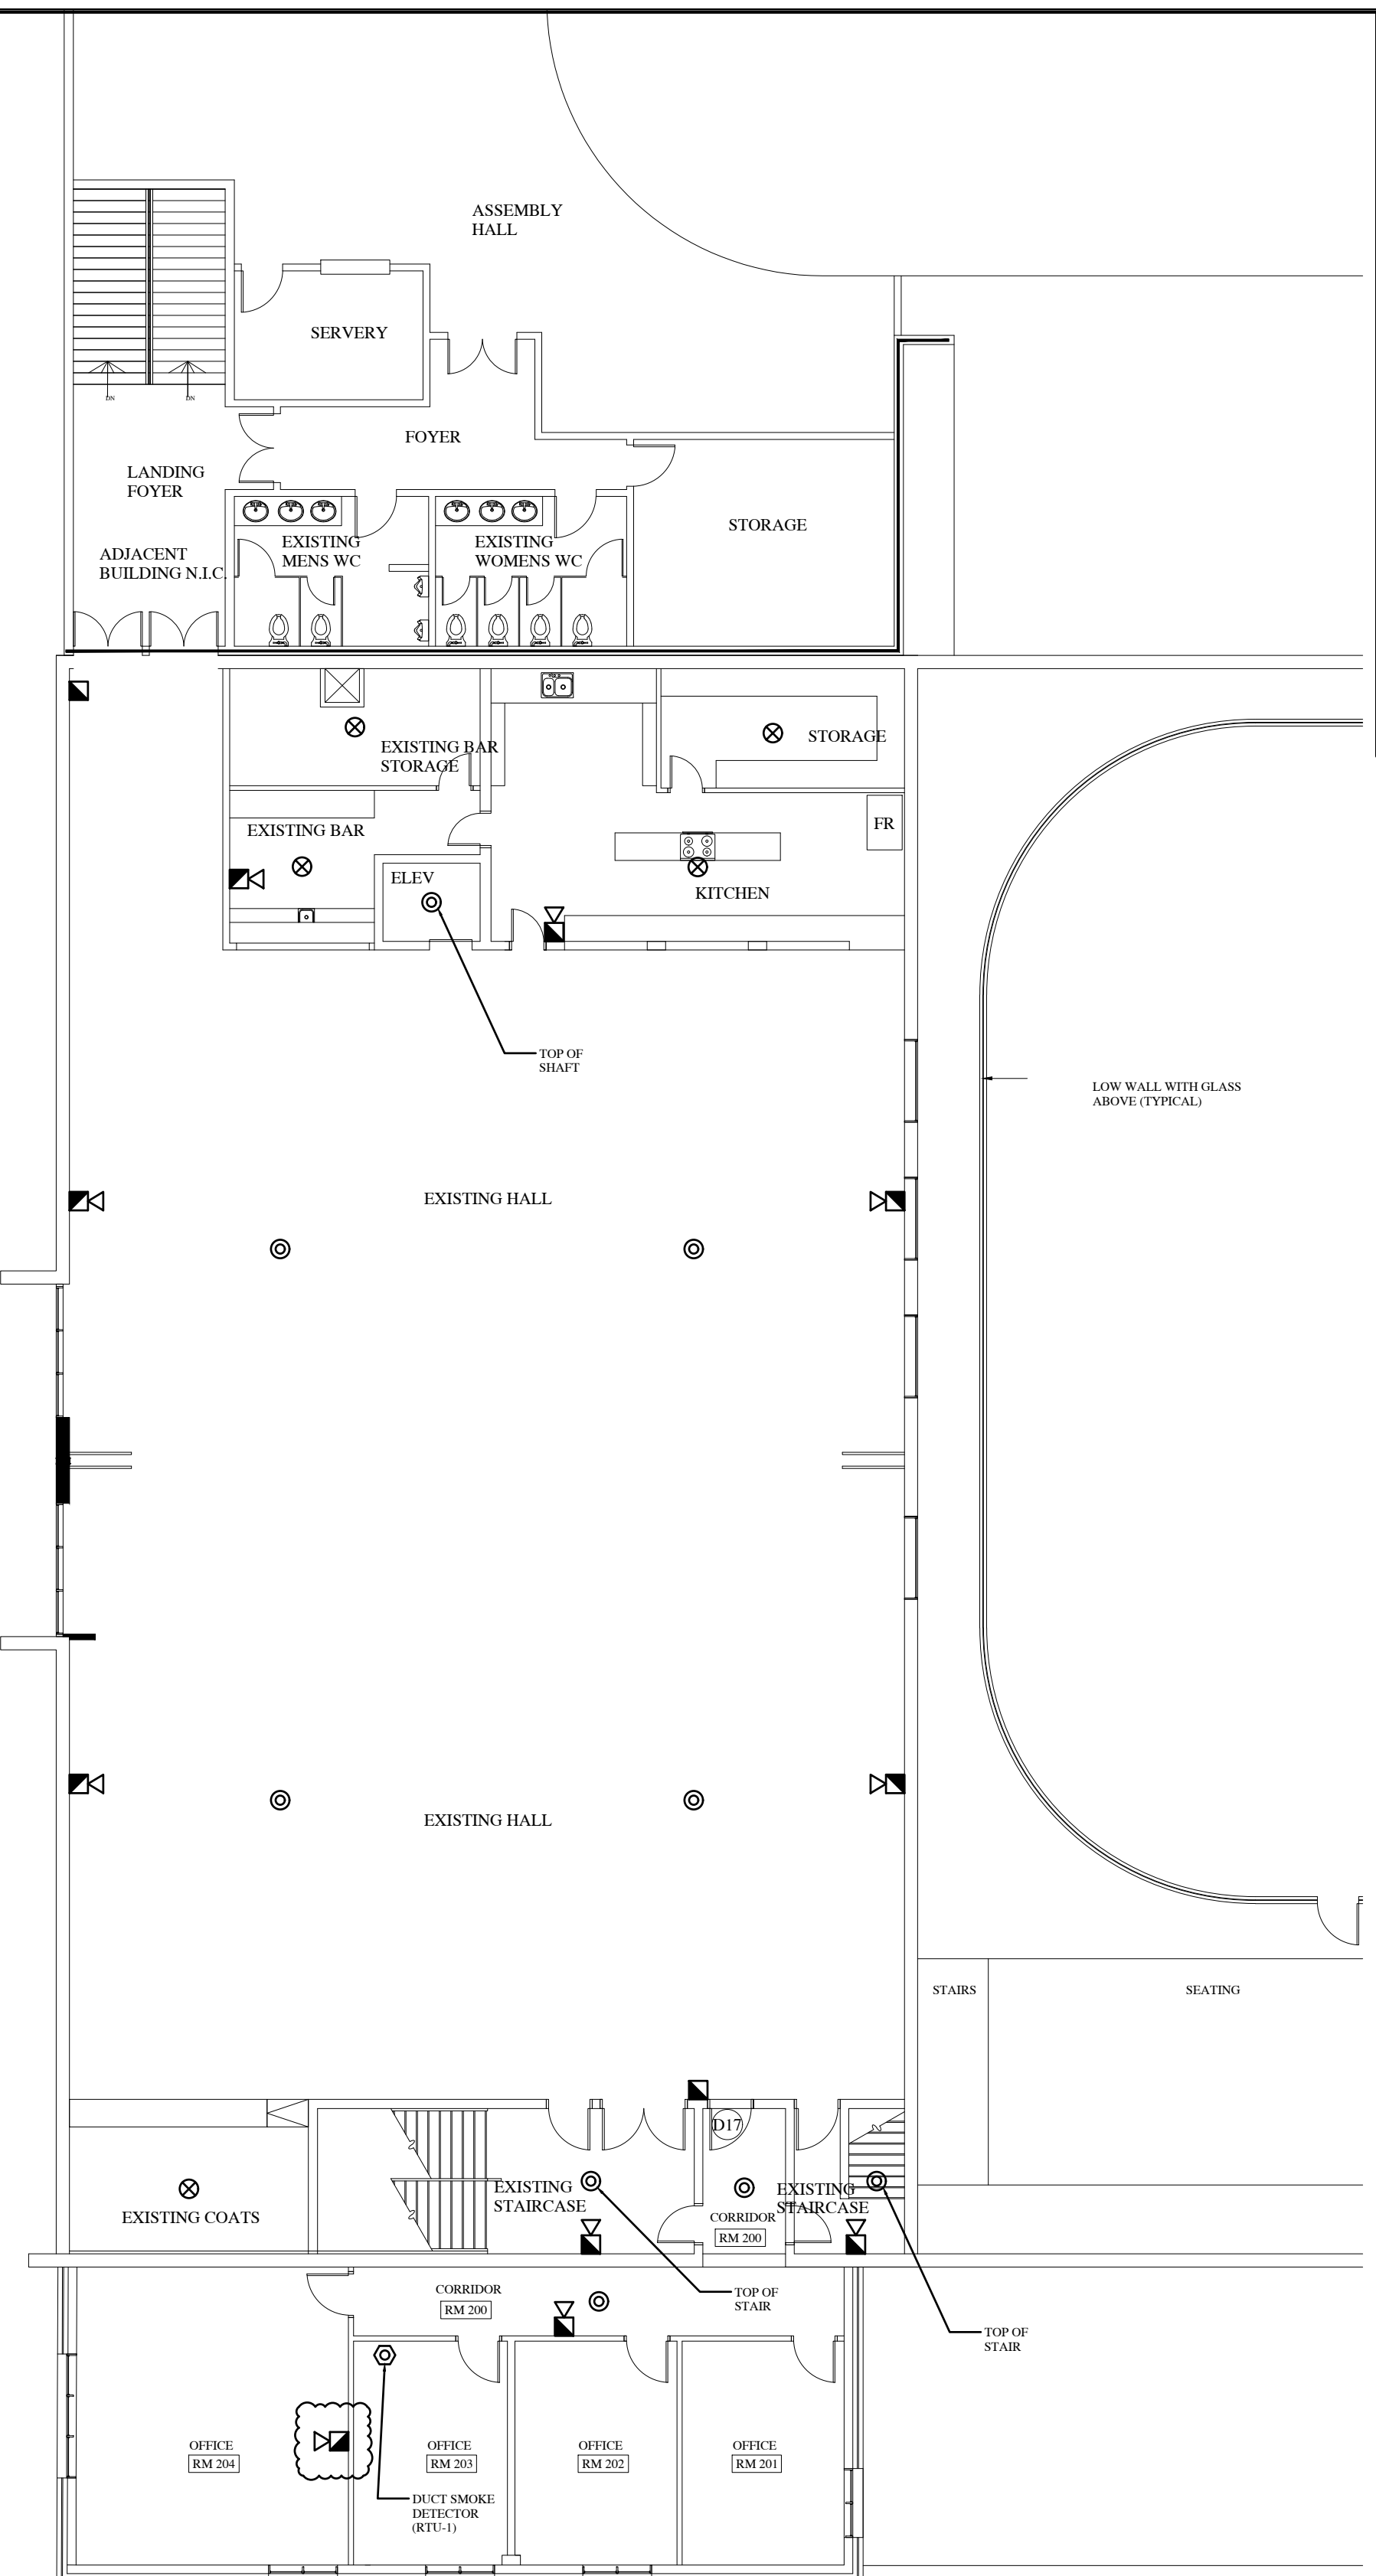

**GENERAL NOTES:**

- NORTH ARENA:**
  - ALL DEVICES SHALL REMAIN, INCLUDING BELLS
  - EXISTING ZONES (3-4) SHALL BE CONNECTED TO NEW FIRE ALARM SYSTEM IN SOUTH ARENA
- FIRE ALARM PHASING:**

**STEP #1:**


  - INSTALLATION OF NEW FIRE ALARM CONTROL & ANNUNCIATOR PANEL
  - CONNECTION OF ALL EXISTING NORTH AND SOUTH ARENA ZONES TO NEW FIRE ALARM CONTROL PANEL
  - DAILY WORK SHALL BE LEFT SAFE, WITH FIRE WATCH PROVIDED BY THE OWNER, AS REQUIRED
  - FIRE ALARM VERIFICATION OF SYSTEM ALTERATIONS

**STEP #2:**

  - INSTALLATION & CONNECTION OF FIRE ALARM DEVICES IN NEW ADDITION
  - FIRE ALARM VERIFICATION OF SYSTEM ALTERATIONS

**STEP #3:**

  - INSTALLATION & CONNECTION OF NEW FIRE ALARM DEVICES IN EXISTING SOUTH ARENA, LOBBY & ADJACENT AREAS
  - DAILY WORK SHALL BE LEFT SAFE, WITH FIRE WATCH PROVIDED BY THE OWNER, AS REQUIRED
  - FIRE ALARM VERIFICATION OF SYSTEM ALTERATIONS

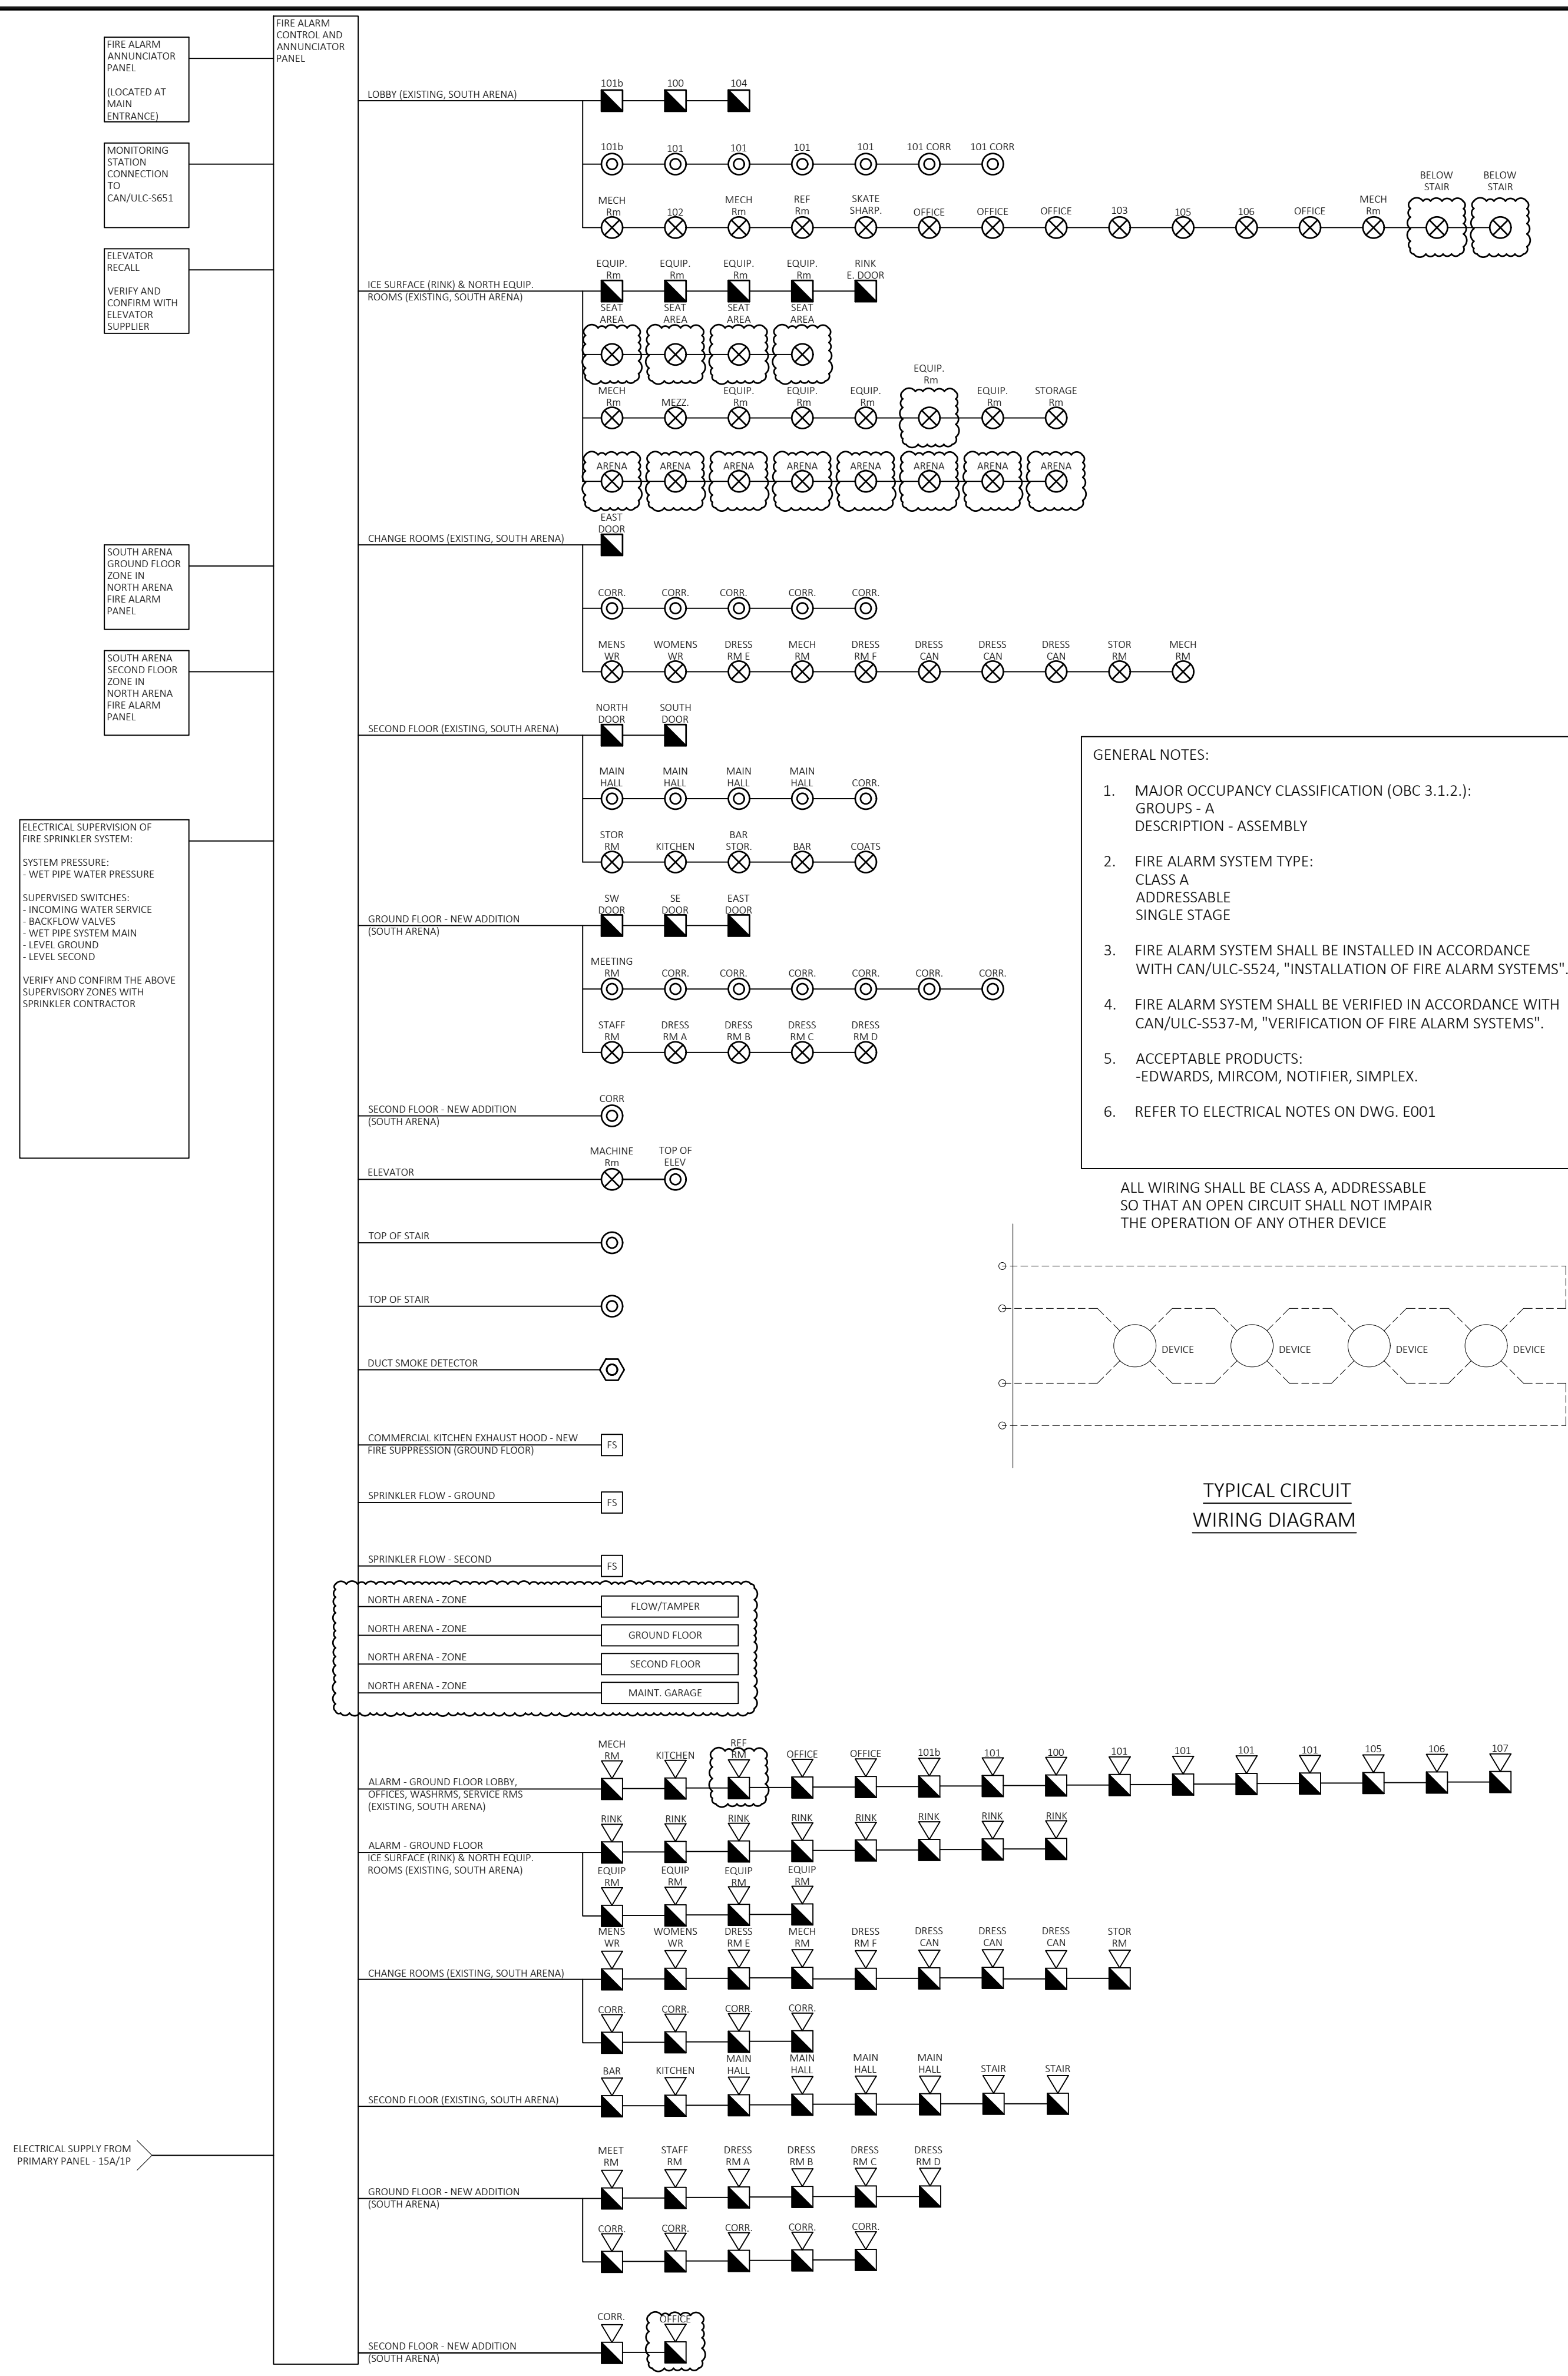

**2 SECOND FLOOR PLAN**  
SCALE: 3/32" = 1'-0"

**1 FIRE ALARM - SCHEMATIC DIAGRAM**  
NTS