

# LARRY GAINES • ARCHITECT

Old Town Hall  
14 Bridge Street, PO 706  
Almonte, Ontario  
K0A 1A0

T: 613-256-3630  
gaines@bellnet.ca

## Site Instruction #04

**To:** Talco Building Innovations Ltd.  
4728 Bank Street, Suite A  
Ottawa, Ontario, K1T 3W7

**Project:** Carleton Place Arena  
Neelin Street

**Date:** February 8, 2021

---

Site instructions are issued only for the purpose of recording any clarification or interpretation of the contract documents or giving direction on problems resulting from field conditions. These instructions are subject to the provisions of the contract documents and unless stated herein and specifically co-authorized by the Client, will not affect the contract. Should the contractor require a change in the contract price or project schedule, he shall submit to the architect within ten (10) days of the date hereof, an itemized proposal. If the proposal is accepted by the client, this site instruction will be superseded by a Change Order

---

### REFERENCES:

Two sketches attached

### GENERAL:

1. Revised Lobby light switching reducing 7 switches to 4 switches and adding receptacle in new kitchen
2. Add four data connections and one new receptacle

**PER:** \_\_\_\_\_  
Larry Gaines  
Architect

ED)  
R I  
ER  
VE  
OT  
NE  
2  
VE  
TE  
VE

20amp  
single  
receptacle

SUPPLY & INSTALL  
INTERLOCK TO SHUTDOWN  
POWER TO THESE UNITS  
UPON FIRE-EXTINGUISHING  
SYSTEM ACTIVATION

SW2


SW1


SW1 - SW7

SW3

include 2 corridor  
lights on SW4

SW4

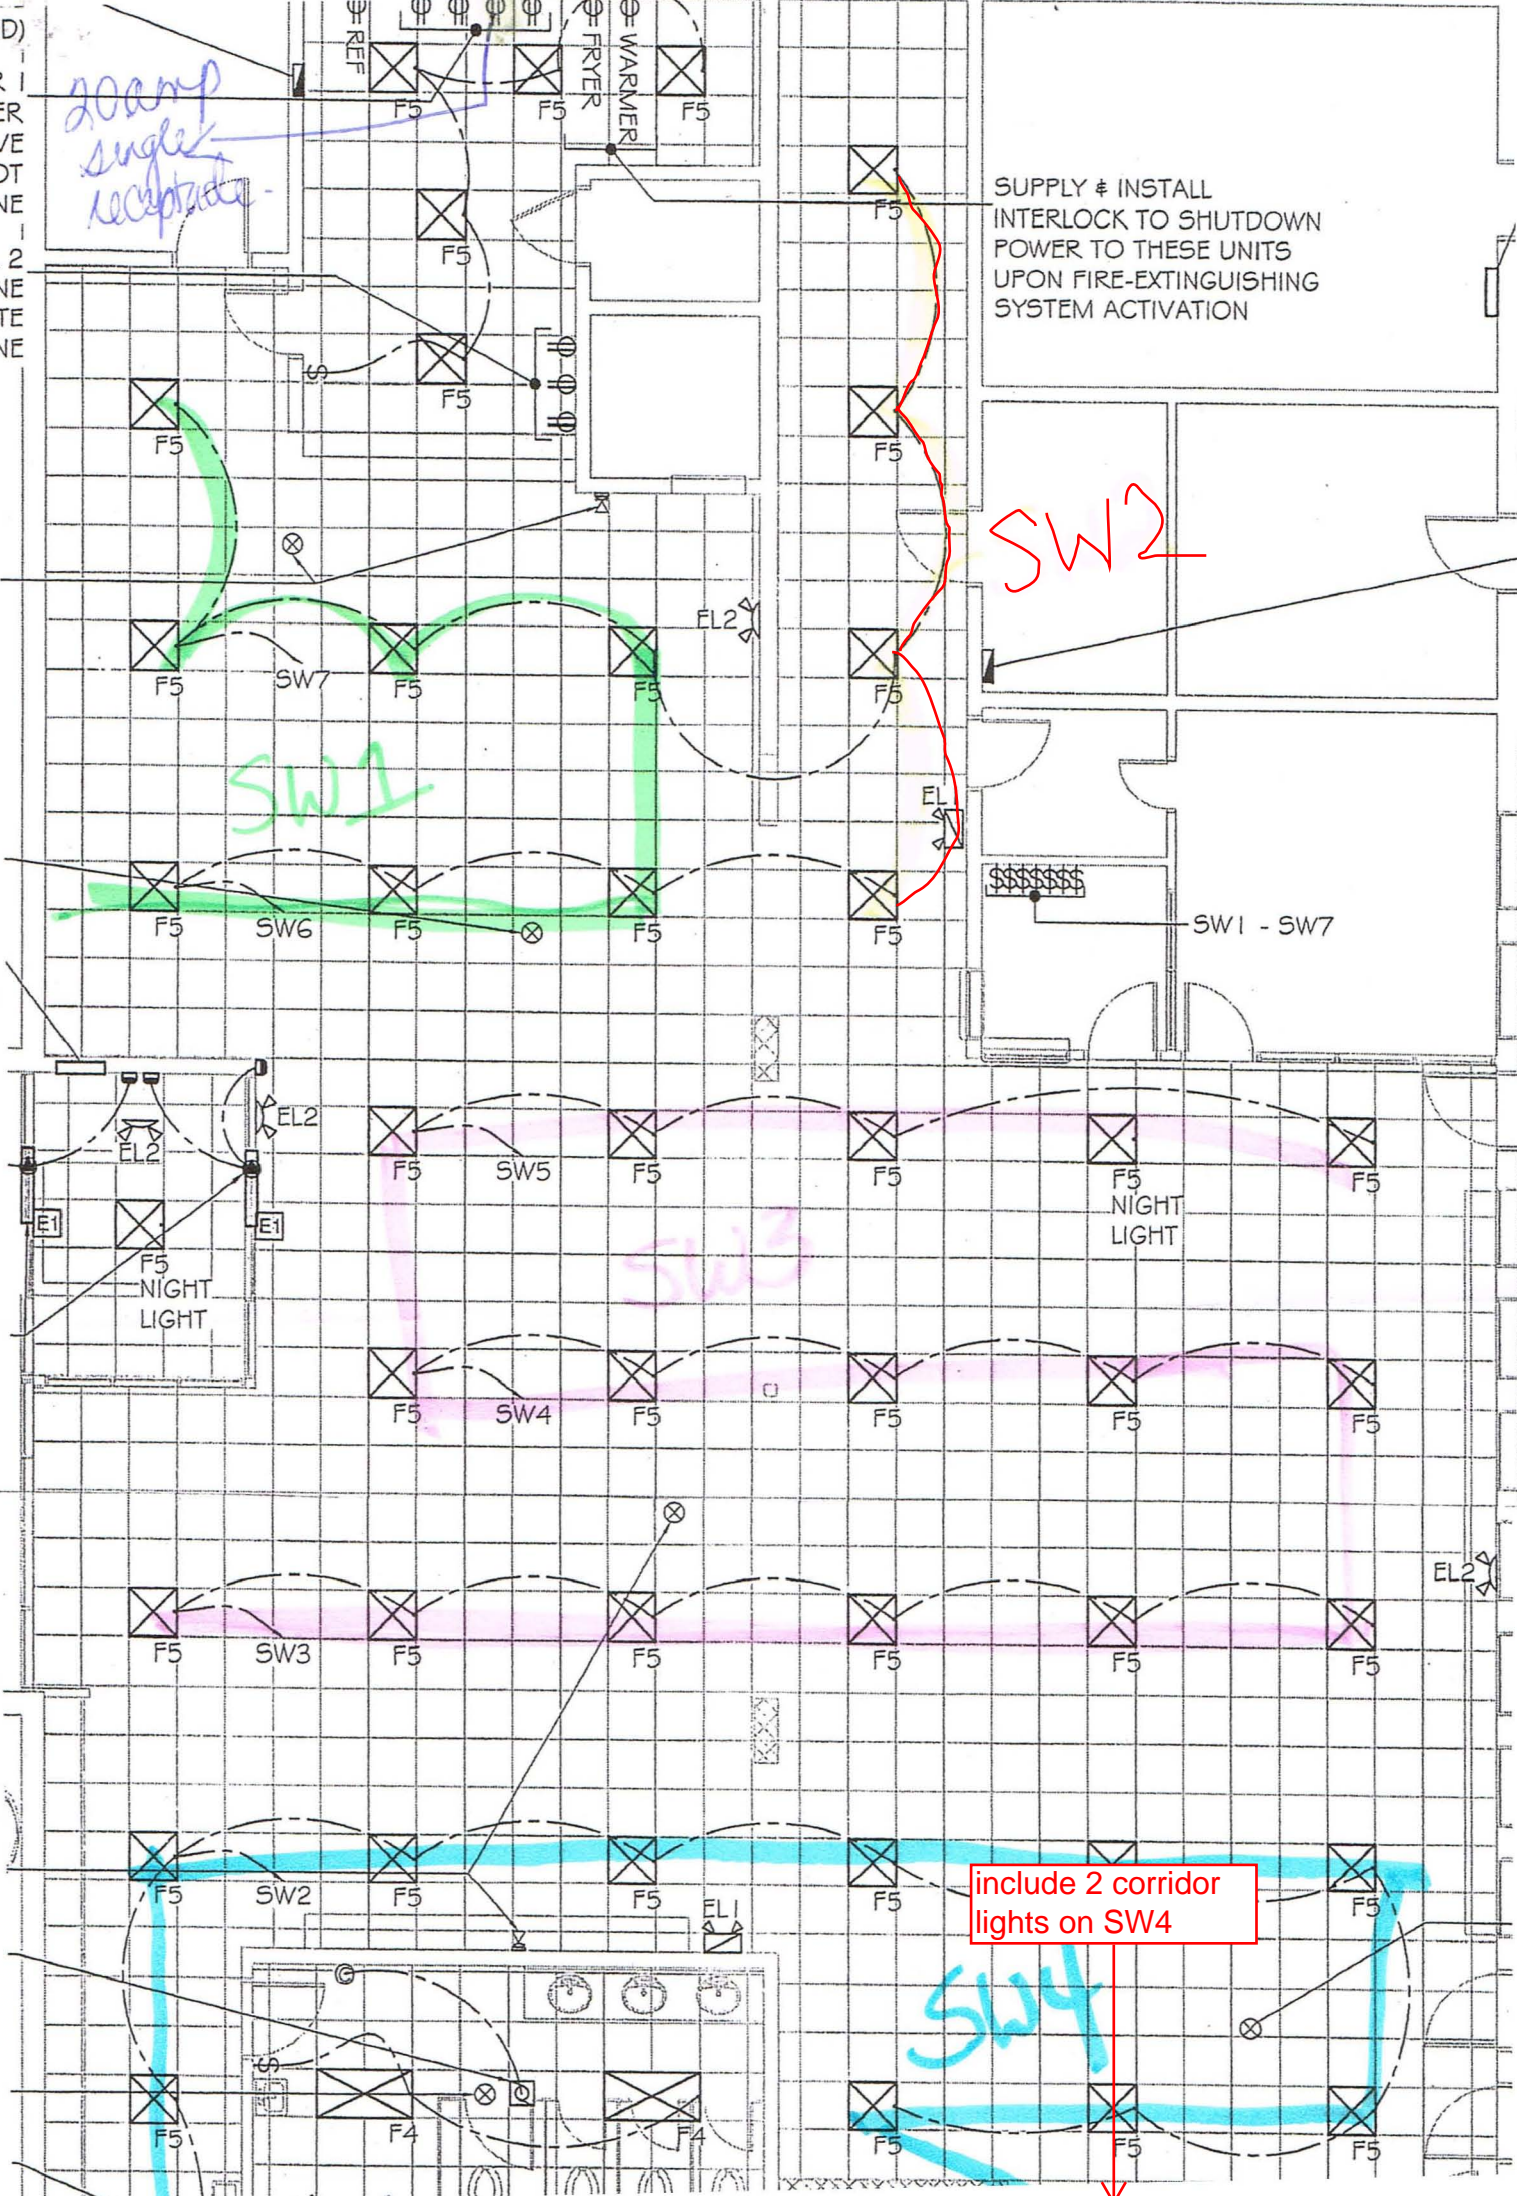

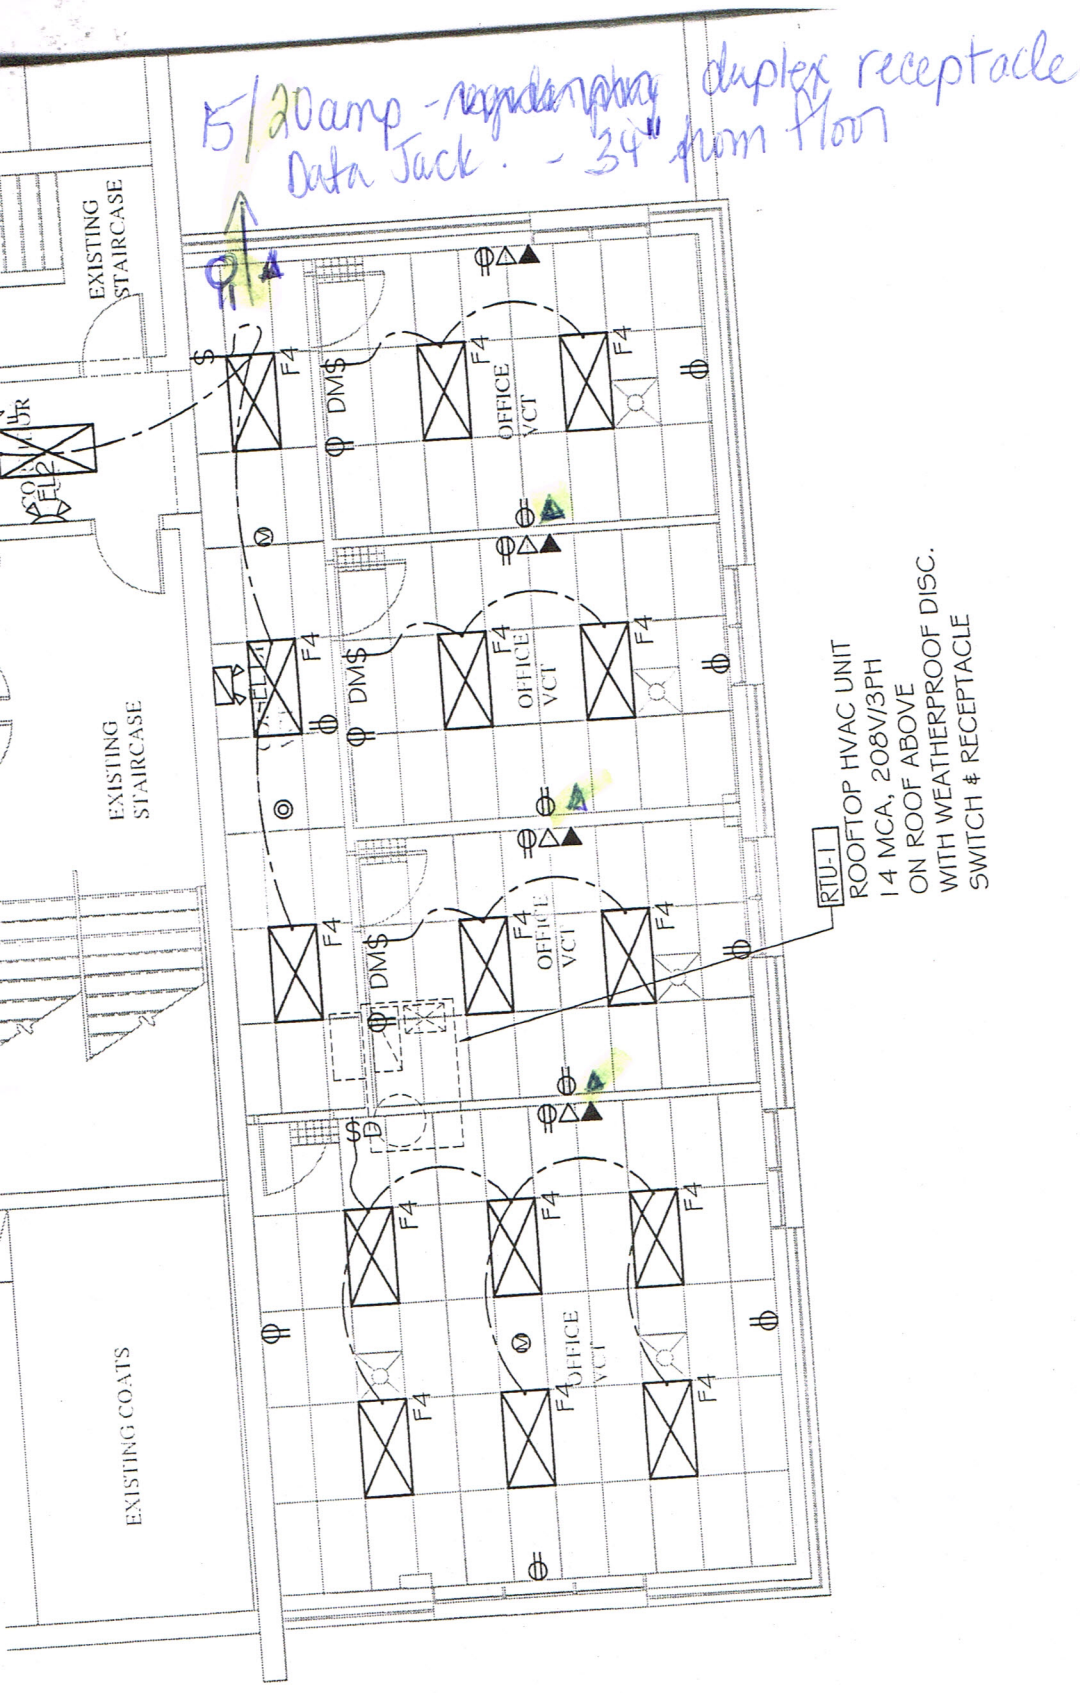

ROOFTOP HVAC UNIT  
14 MCA, 208V/3PH  
ON ROOF ABOVE  
WITH WEATHERPROOF DISC.  
SWITCH & RECEPTACLE

Larry Gaines  
Architect

**MORRIS**  
Engineering Ltd.

**ASTERN**  
**ENGINEERING**  
CONSULTING

100 Strouger Blvd  
Calgary, Alberta T2C 1S7