


PANNEAU D'ÉCLAIRAGE - LIGHTING PANEL						
120/208 VOLTS 3Ø 4W						
WATTS	DESCRIPTION	DISJ. BRKR.	CCT. NO.	CCT. NO.	DESCRIPTION	WATTS
2400	DRYER	15A	1	2	7- RECEPT. (EXT.)	700
			3	4	6- RECEPTACLE	600
2400	"	15A	5	6	WORKSHOP RECEPTACLE	2000
			7	8	"	
2400	"	15A	9	10	"	2000
			11	12	"	
2000	COUNTER RECEPTACLE	15A	13	14	"	2000
			15	16	"	
2000	"	15A	17	18	"	2000
			19	20	"	
300	3- RECEPTACLES	15A	21	22	"	2000
400	"	15A	23	24	"	
700	"	15A	25	26	"	2000
800	"	15A	27	28	"	
600	"	15A	29	30	"	2000
600	"	15A	31	32	"	
800	"	15A	33	34	10-LUMIN + 1-FAN	1100
200	"	15A	35	36	7- " (S.F.)	900
	SPARE	15A	37	38	8- " "	1000
	"	15A	39	40	10- " 1-FAN	1200
	"	15A	41	42	SPARE	

PANNEAU D'ÉCLAIRAGE - LIGHTING PANEL						
120/208 VOLTS 3Ø 4W						
WATTS	DESCRIPTION	DISJ. BRKR.	CCT. NO.	CCT. NO.	DESCRIPTION	WATTS
1000	2- GAS HEATER FAN	15A	1	2	COPIER	4500
1000	2- " " "	15A	3	4	"	
500	1- " " "	15A	5	6	"	7000
750	3 EXT. LUMIN.	15A	7	8	"	
1000	7- LUM. (S.F.)	15A	9	10	COUNTER RECEPTACLE	2000
900	9- " " (S.F.)	15A	11	12	"	
1200	12- " " "	15A	13	14	6 RECEPTACLE	600
	SPARE	15A	15	16	8- " "	800
	"	15A	17	18	6- " "	600
650	13 LIGHTING	15A	19	20	7- " "	700
	"	15A	21	22	16-LUMIN. (G.F.)	1100
3/4 HP + 1 HP	DOORS	3P	23	24	11- " " "	550
	"		25	26	6- " " "	1200
3/4 HP + 1 HP	DOORS	3P	27	28	6- " " "	1200
	"		29	30	7- " " 1-FAN	800
	"		31	32	2- " " (G.F.)	100
800	G-LUMIN. (G.F.)	15A	33	34	9- " "	900
900	6- " 2-FAN	15A	35	36	8- " (EXT)	800
1000	10- " (G.F.)	15A	37	38	5- " (G.F.)	900
	EXIT LIGHT 4CM LG	15A	39	40	3- " " "	500
	SPARE	15A	41	42	11- " 1-FAN	1100

PANNEAU D'ÉCLAIRAGE - LIGHTING PANEL						
347/600 VOLTS 3Ø 4W						
WATTS	DESCRIPTION	DISJ. BRKR.	CCT. NO.	CCT. NO.	DESCRIPTION	WATTS
8000	HEATING	30A	1	2	SECURITY LTG	1400
5000	"	30A	3	4	PLANT LIGHTING	3000
8500	"	30A	5	6	"	3000
8000	"	30A	7	8	"	3000
5250	"	30A	9	10	"	3000
4500	"	15A	11	12	"	3000
	SPARE		13	14	EXTERIOR LTG	2500
	"		15	16	"	600
	"		17	18	SECURITY LTG	300
	"		19	20	SPARE	
	"		21	22	"	
	"		23	24	"	

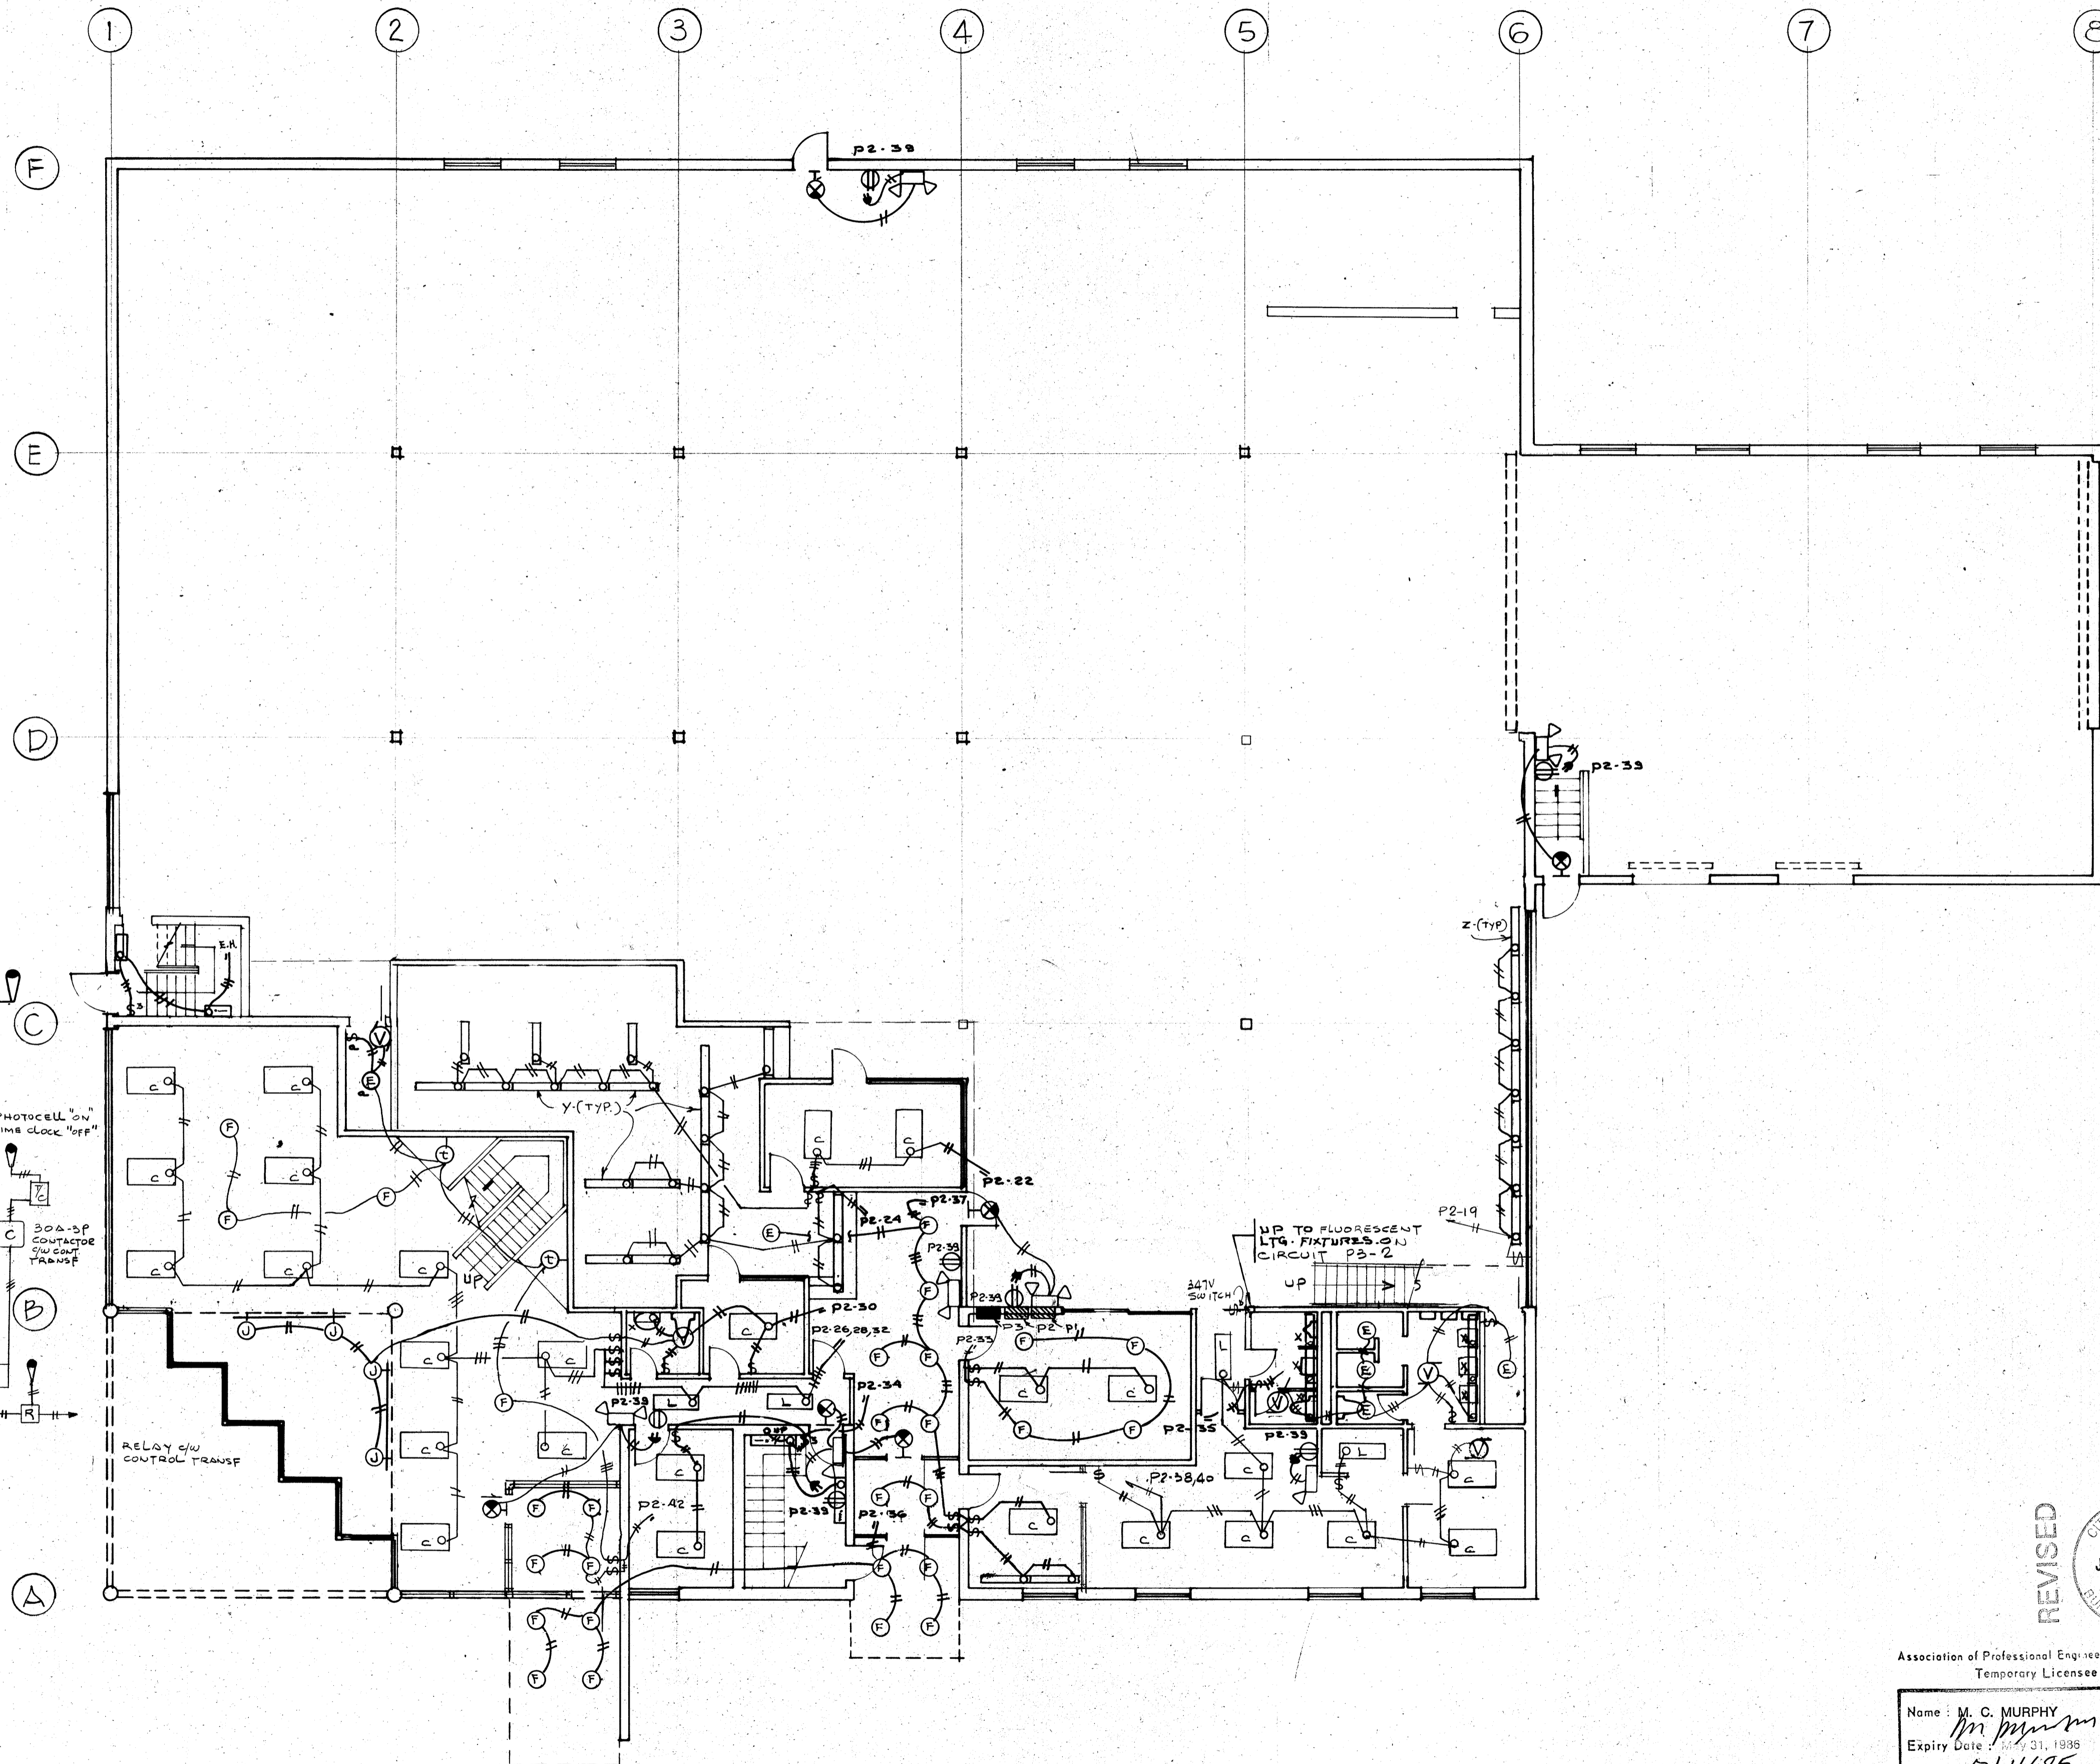

- FIXTURES**
- ⊕ PHILLIPS 97170 347V LPS 55W
 - ⊙ LUMEC 400 RL-MH 347 - YPTHN5 (lampe T15)
 - ⊗ LUMEC 250 MH-RSV 134T - 120 PTHN5
 - ⊕ LUMEC 100 SHP - RSV 1338 - 120 PTHN5
 - ⊙ PHILLIPS 97000 347V LPS 15W
 - ⊗ SYLVANIA, MDS - 99-400 COATED METAL HALIDE
 - ⊕ SYLVANIA, KTS - 72 - 248
 - ⊙ SYLVANIA, K12A - 58 - 448
 - ⊗ SYLVANIA, K12A - 58 - 248
 - ⊕ LIGHTOLIER SYST. RAIL 1 #6002 c/a 6061 -
 - ⊙ LIGHTOLIER SYST. RAIL 2 #6353
 - ⊗ LIGHTOLIER 7264
 - ⊕ LIGHTOLIER 84573
 - ⊙ LIGHTOLIER 84675
 - ⊗ LIGHTOLIER 1102-1121
 - ⊕ LIGHTOLIER 1102-1122
 - ⊙ LIGHTOLIER FRM- 7002-TRM 7055A8
 - ⊗ LIGHTOLIER FRM- 7001-TRM 7054A8
 - ⊕ LIGHTOLIER 5416
 - ⊙ LIGHTOLIER 10467
 - ⊗ LIGHTOLIER 4742
 - ⊕ PEERLESS LS-148
 - ⊙ PEERLESS ILS - 148
 - ⊗ SYLVANIA KPA 448-96 347V

- NOTES**
- 1- ALL FLUORESCENT TUBES SHALL BE WARM WHITE
 - 2- ALL FLUORESCENT FIXTURES SHALL HAVE CGE GOLD LABEL BALLAST
 - 3- ALL FIXTURES SHALL BE COMPLETE WITH BULB OR TUBE
 - 4- ALL INCANDESCENT BULBS SHALL BE RATED 130V.
 - 5- THIS CONTRACTOR SHALL SUPPLY ALL MOUNTING HARDWARE & SUSPENSION FOR FIXTURES IF REQ'D.

CITY OF OTTAWA
BUILDINGS BRANCH
SEP 19 1985
CHECKED MECHANICAL

REVISED
CITY OF OTTAWA
RECEIVED
JUL 16 1985
BUILDINGS BRANCH

Association of Professional Engineers of Ontario
Temporary Licensee
Name: M. C. MURPHY No. 01
Expiry Date: 31/31/1986
1/14/85
Limitations: Ottawa -
Holder of North America -
Electrical & Mechanical Services

NOTE
REFER TO ARCHITECTURAL
DRAWING FOR EXACT
LOCATION OF FIXTURES

FOR COORDINATION	
REV.	DESCRIPTION
ingénieurs conseils maurice murphy et associés 293, boul. maple grove maple grove, que. tel.: 429-5888	
HOLDER OF NORTH AMERICA	
PROJET DISTRIBUTION CENTRE OTTAWA CANADA	
TITRE ELECTRICAL DISTRIBUTION (2) GROUND FLOOR	
PROJET NO. 8466	APP. PAR M.M.
ECHELLE 1/100	DATE JANV. 85
DESSIN NO. E-3	REV. 0

MICROFILMED